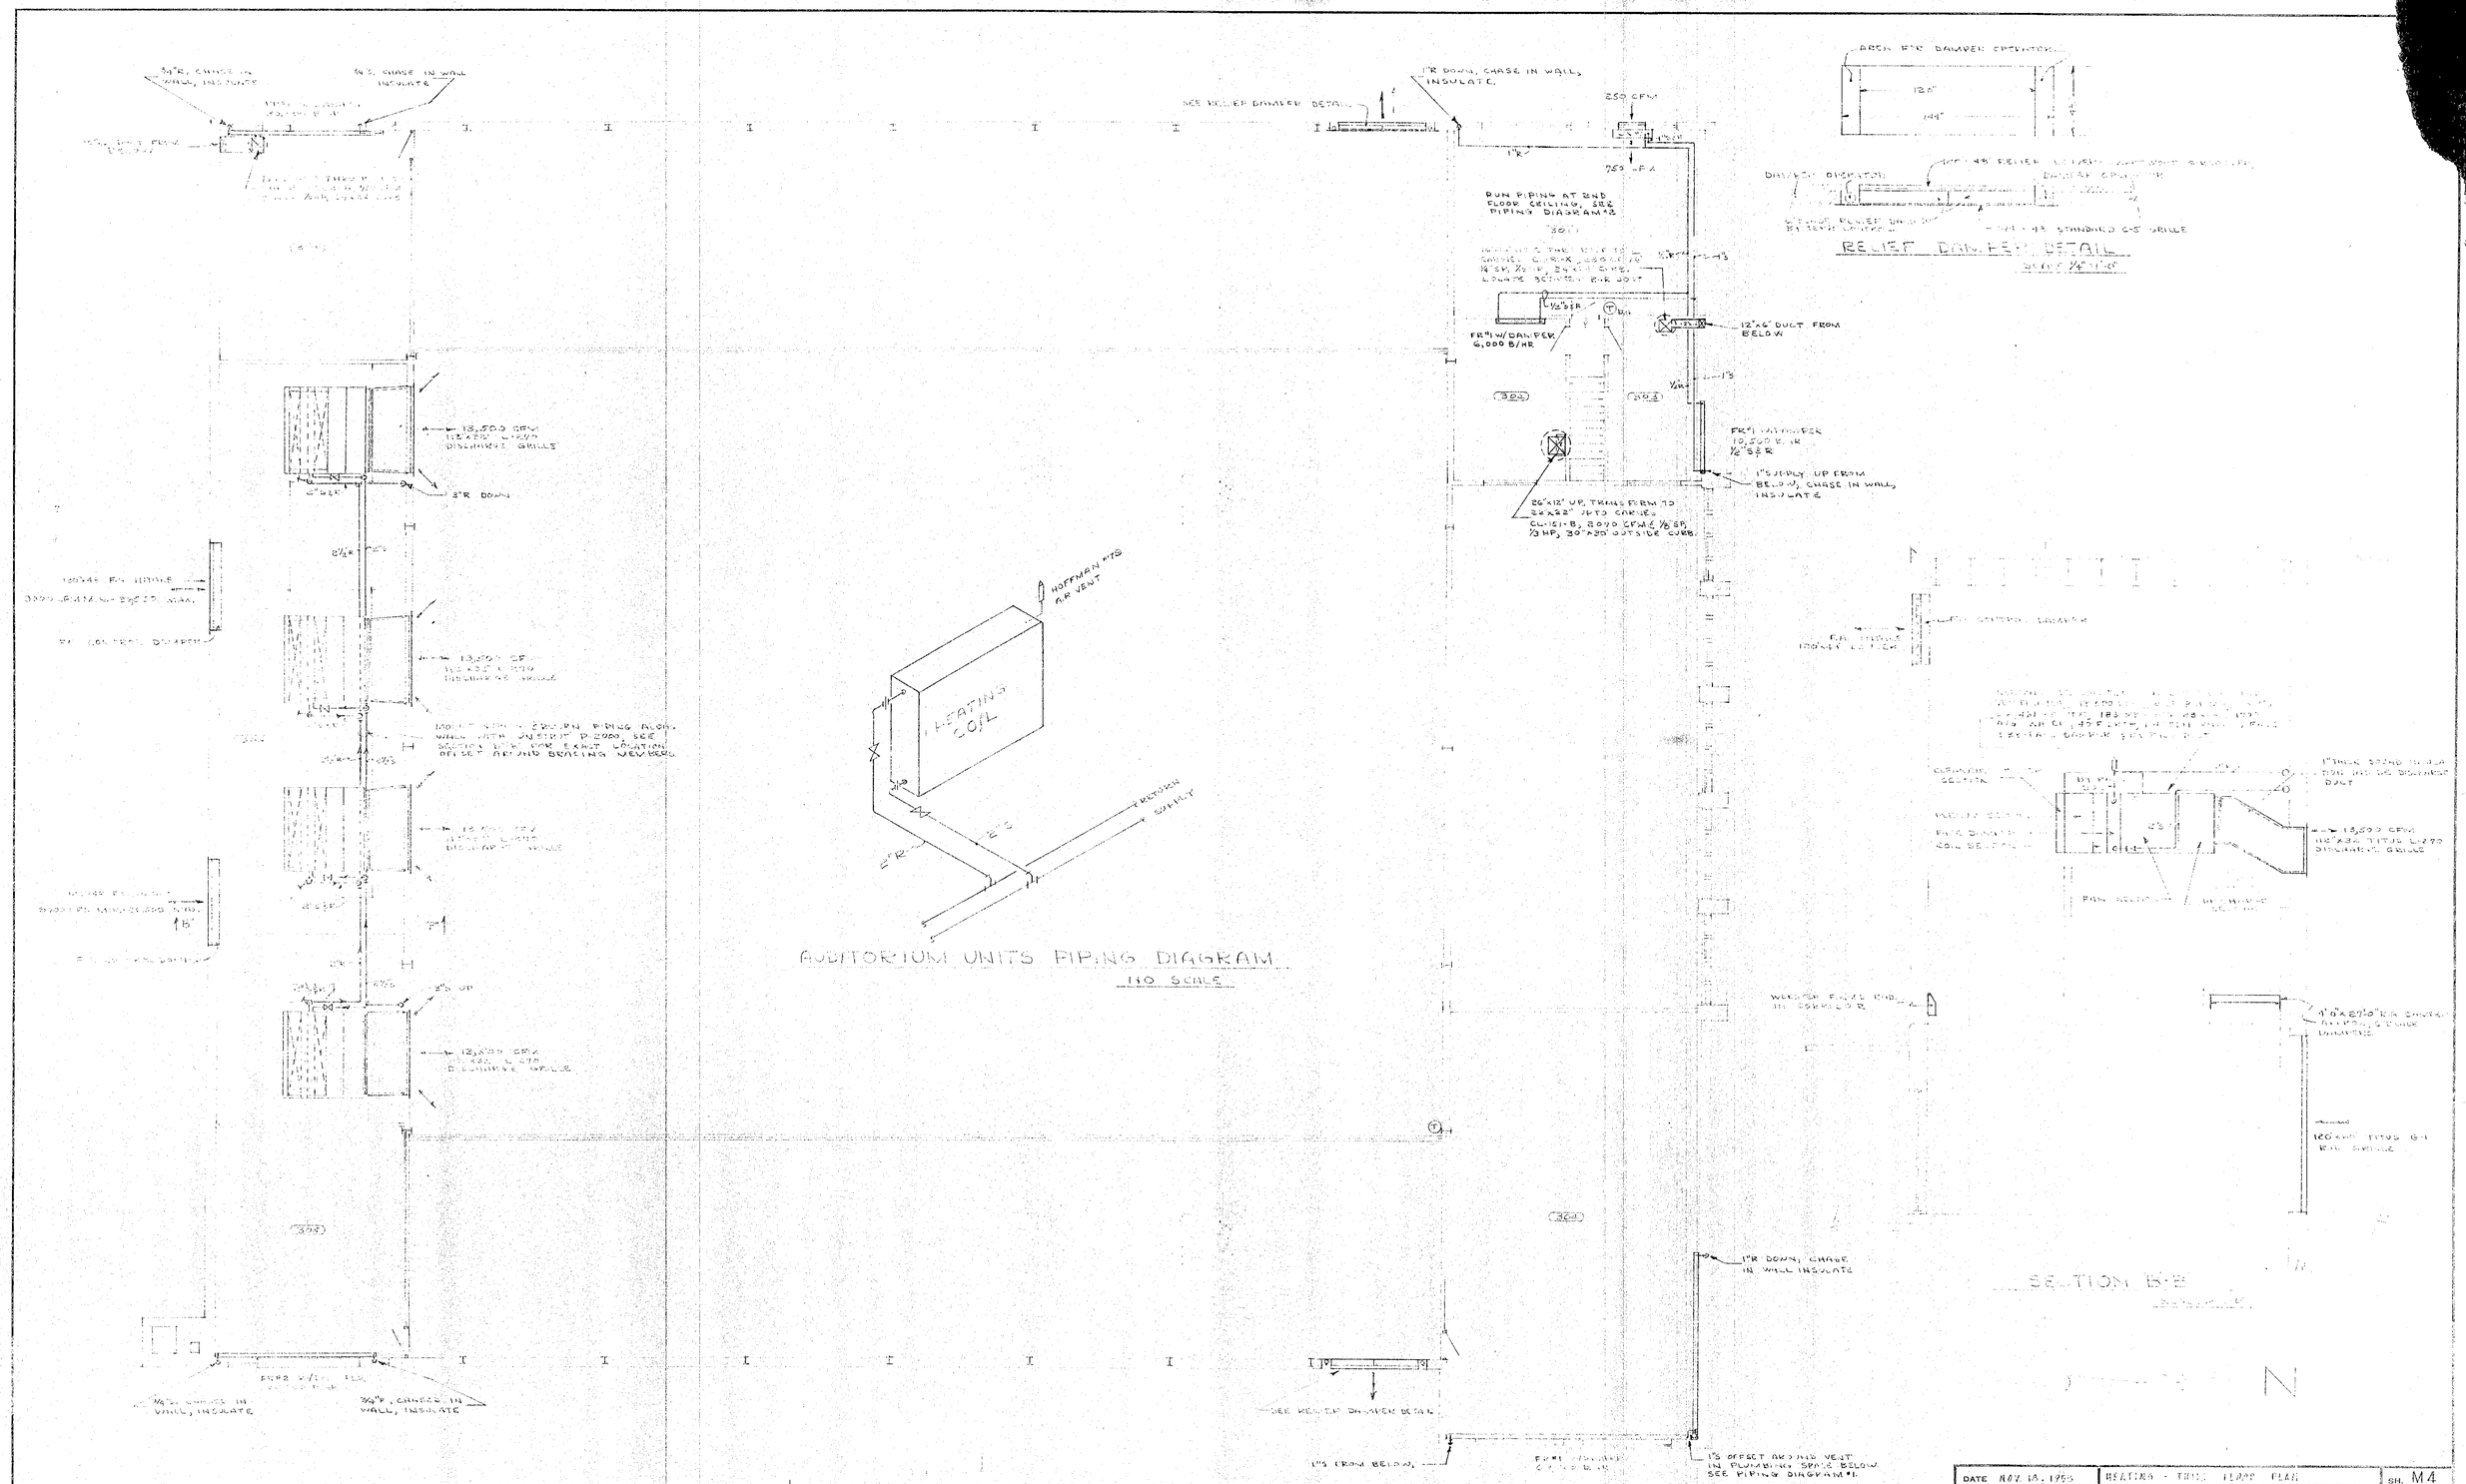
AUDITORIUM UNITS PIPING DIAGRAM
1/10 SCALE
HEATING COIL
HOFFMAN #175 AIR VENT
RELIEF DAMPER DETAIL
SEE RELIEF DAMPER DETAIL
250 CFM
RUN PIPING AT 2ND FLOOR CEILING, SEE PIPING DIAGRAM #2
12"x6" DUCT FROM BELOW
1" SUPPLY UP FROM BELOW, CHASE IN WALL, INSULATE
1"R DOWN, CHASE IN WALL, INSULATE
13,500 CFM
3"R DOWN
UPPER FLOOR HEATING & VENTILATING PLAN
SCALE 1/4"=1'-0"
SECTION B-B
1"R DOWN, CHASE IN WALL INSULATE
IS OFFSET AROUND VENT IN PLUMBING SPACE BELOW. SEE PIPING DIAGRAM #1.
REYNOLDS, SMITH & HILLS, ENGINEERS
DATE NOV. 18, 1955
HEATING - THIRD FLOOR PLAN
SH. M4
PHYSICAL EDUCATIONAL BUILDING
WESTCHESTER TOWNSHIP HIGH SCHOOL
SCHUTT-HALEY, ASSOCIATES
ARCHITECTS AND ENGINEERS
510 JEFFERSON ST. GARY, IND.