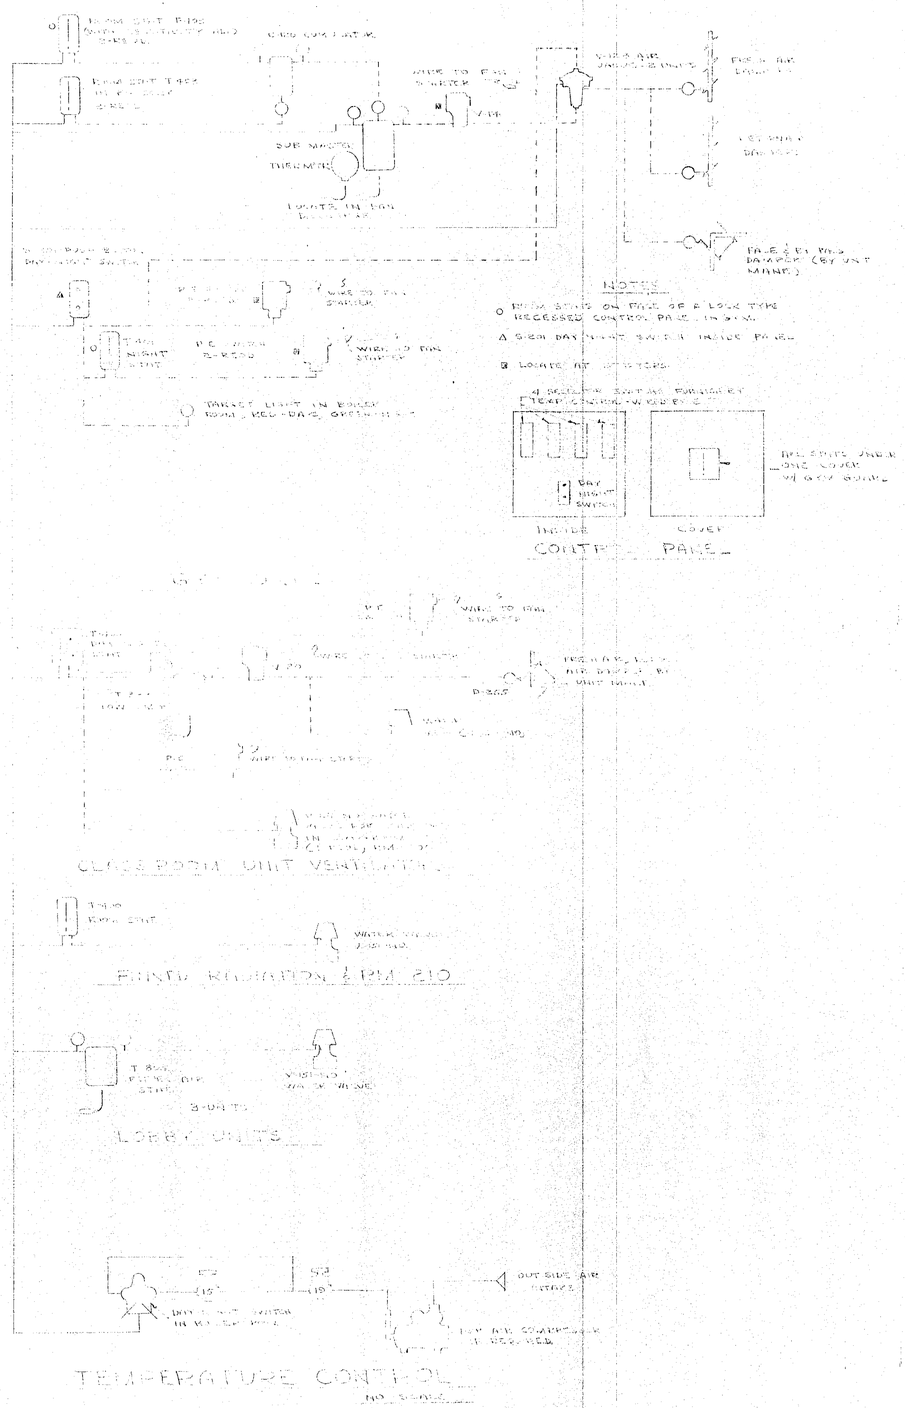


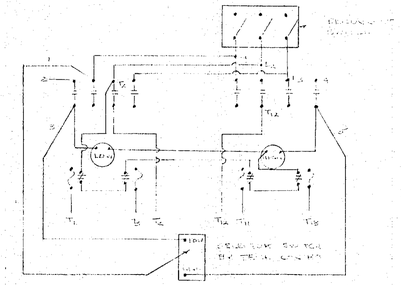

TYPICAL WIRING DIAGRAM FOR 2-SPEED 3Ø/ATH. - 3/4 H.P. UNITS




CABINET HEATER PIPING DIAGRAM



PANEL RADIATOR PIPING DIAGRAM

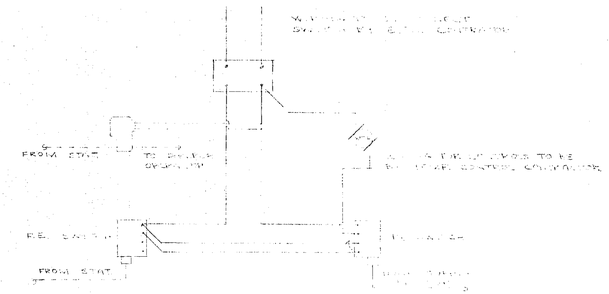


UNIT VENTILATOR TEMPERATURE CONTROL WIRING DIAGRAM

LEGEND

- AUTOMATIC SELF-RESETTING
- EXPANSION LIMIT-SET THERMOSTATIC
- ROOM STAT
- DAY & NIGHT THERMOSTAT
- THERMOSTATIC AIR VENT
- PRESSURE VALVE W/ SIGHT GLASS
- THERMOMETER W/ SIGHT GLASS
- GATE VALVE (FOR ISOLATING UNIT FOR CHECKING UNIT)

GENERAL NOTES

1. ALL HEATING PIPING TO BE INSTALLED AS SHOWN EXCEPT AS NOTED.
2. ALL SUPPLY PIPING TO BE INSTALLED ON THE SIDE OF THE BELOW CEILING.
3. ALL OUTSIDE LOUVERS SHALL HAVE BIRD SCREENS

REYNOLDS & DARICH, ENGINEERS
5401 CLEVELAND STREET
GARY, INDIANA

| | | |
|---|---|---|
| DATE NOV. 15, 1954 | HEATING - DETAILS | SH. M5 |
| CERTIFIED BY | PHYSICAL EDUCATIONAL BUILDING<br>WESTCHESTER TOWNSHIP HIGH SCHOOL<br>CHESTERTON INDIANA | |
| | SCHUTT-HALEY, ASSOCIATES<br>ARCHITECTS AND ENGINEERS<br>510 JEFFERSON ST. GARY, IND. | |