



UNIT VENTILATOR SCHEDULE									
TAG	MAKE/BILT TYPE	CFM	%MAXIMUM TOTAL OUTSIDE AIR	WATER FLOW	REMARKS				
①	UNIT VENTILATOR TYPE H	750	33% 47"	65	45	3.5	125"	UNIT SHALL BE 6" HIGH	
②	UNIT VENTILATOR TYPE H	750	33% 47"	65	45	3.5	125"	UNIT 'ADDED TO ' " UNDR. SHELVE	
③	UNIT VENTILATOR TYPE H	1500	33% 47"	65	45	3.5	125"	CELINGS MOUNTED EX-750"	
④	UNIT VENTILATOR TYPE H	1500	33% 47"	65	45	3.5	125"	DITTO	

FORCE FLOW UNITS								
TAG	MAKE & STYLE	SIZE	FEEL	CFM	HP	RMPD	REMARKS	
①	MODINE FF-DG	C-375	4 1/2"	22.1	375	1750	150	SEMI-RECEIVED
②	MODINE FF-DG	C-375	4 1/2"	17.2	215	1080	130	SEMI-RECEIVED
③	MODINE FF-DG	C-250	4 1/2"	18.3	235	1090	130	SEMI-RECEIVED
④				22.1	375	1750	150	SEMI-RECEIVED
⑤				17.2	215	1080	130	SEMI-RECEIVED
⑥				18.3	235	1090	130	SEMI-RECEIVED

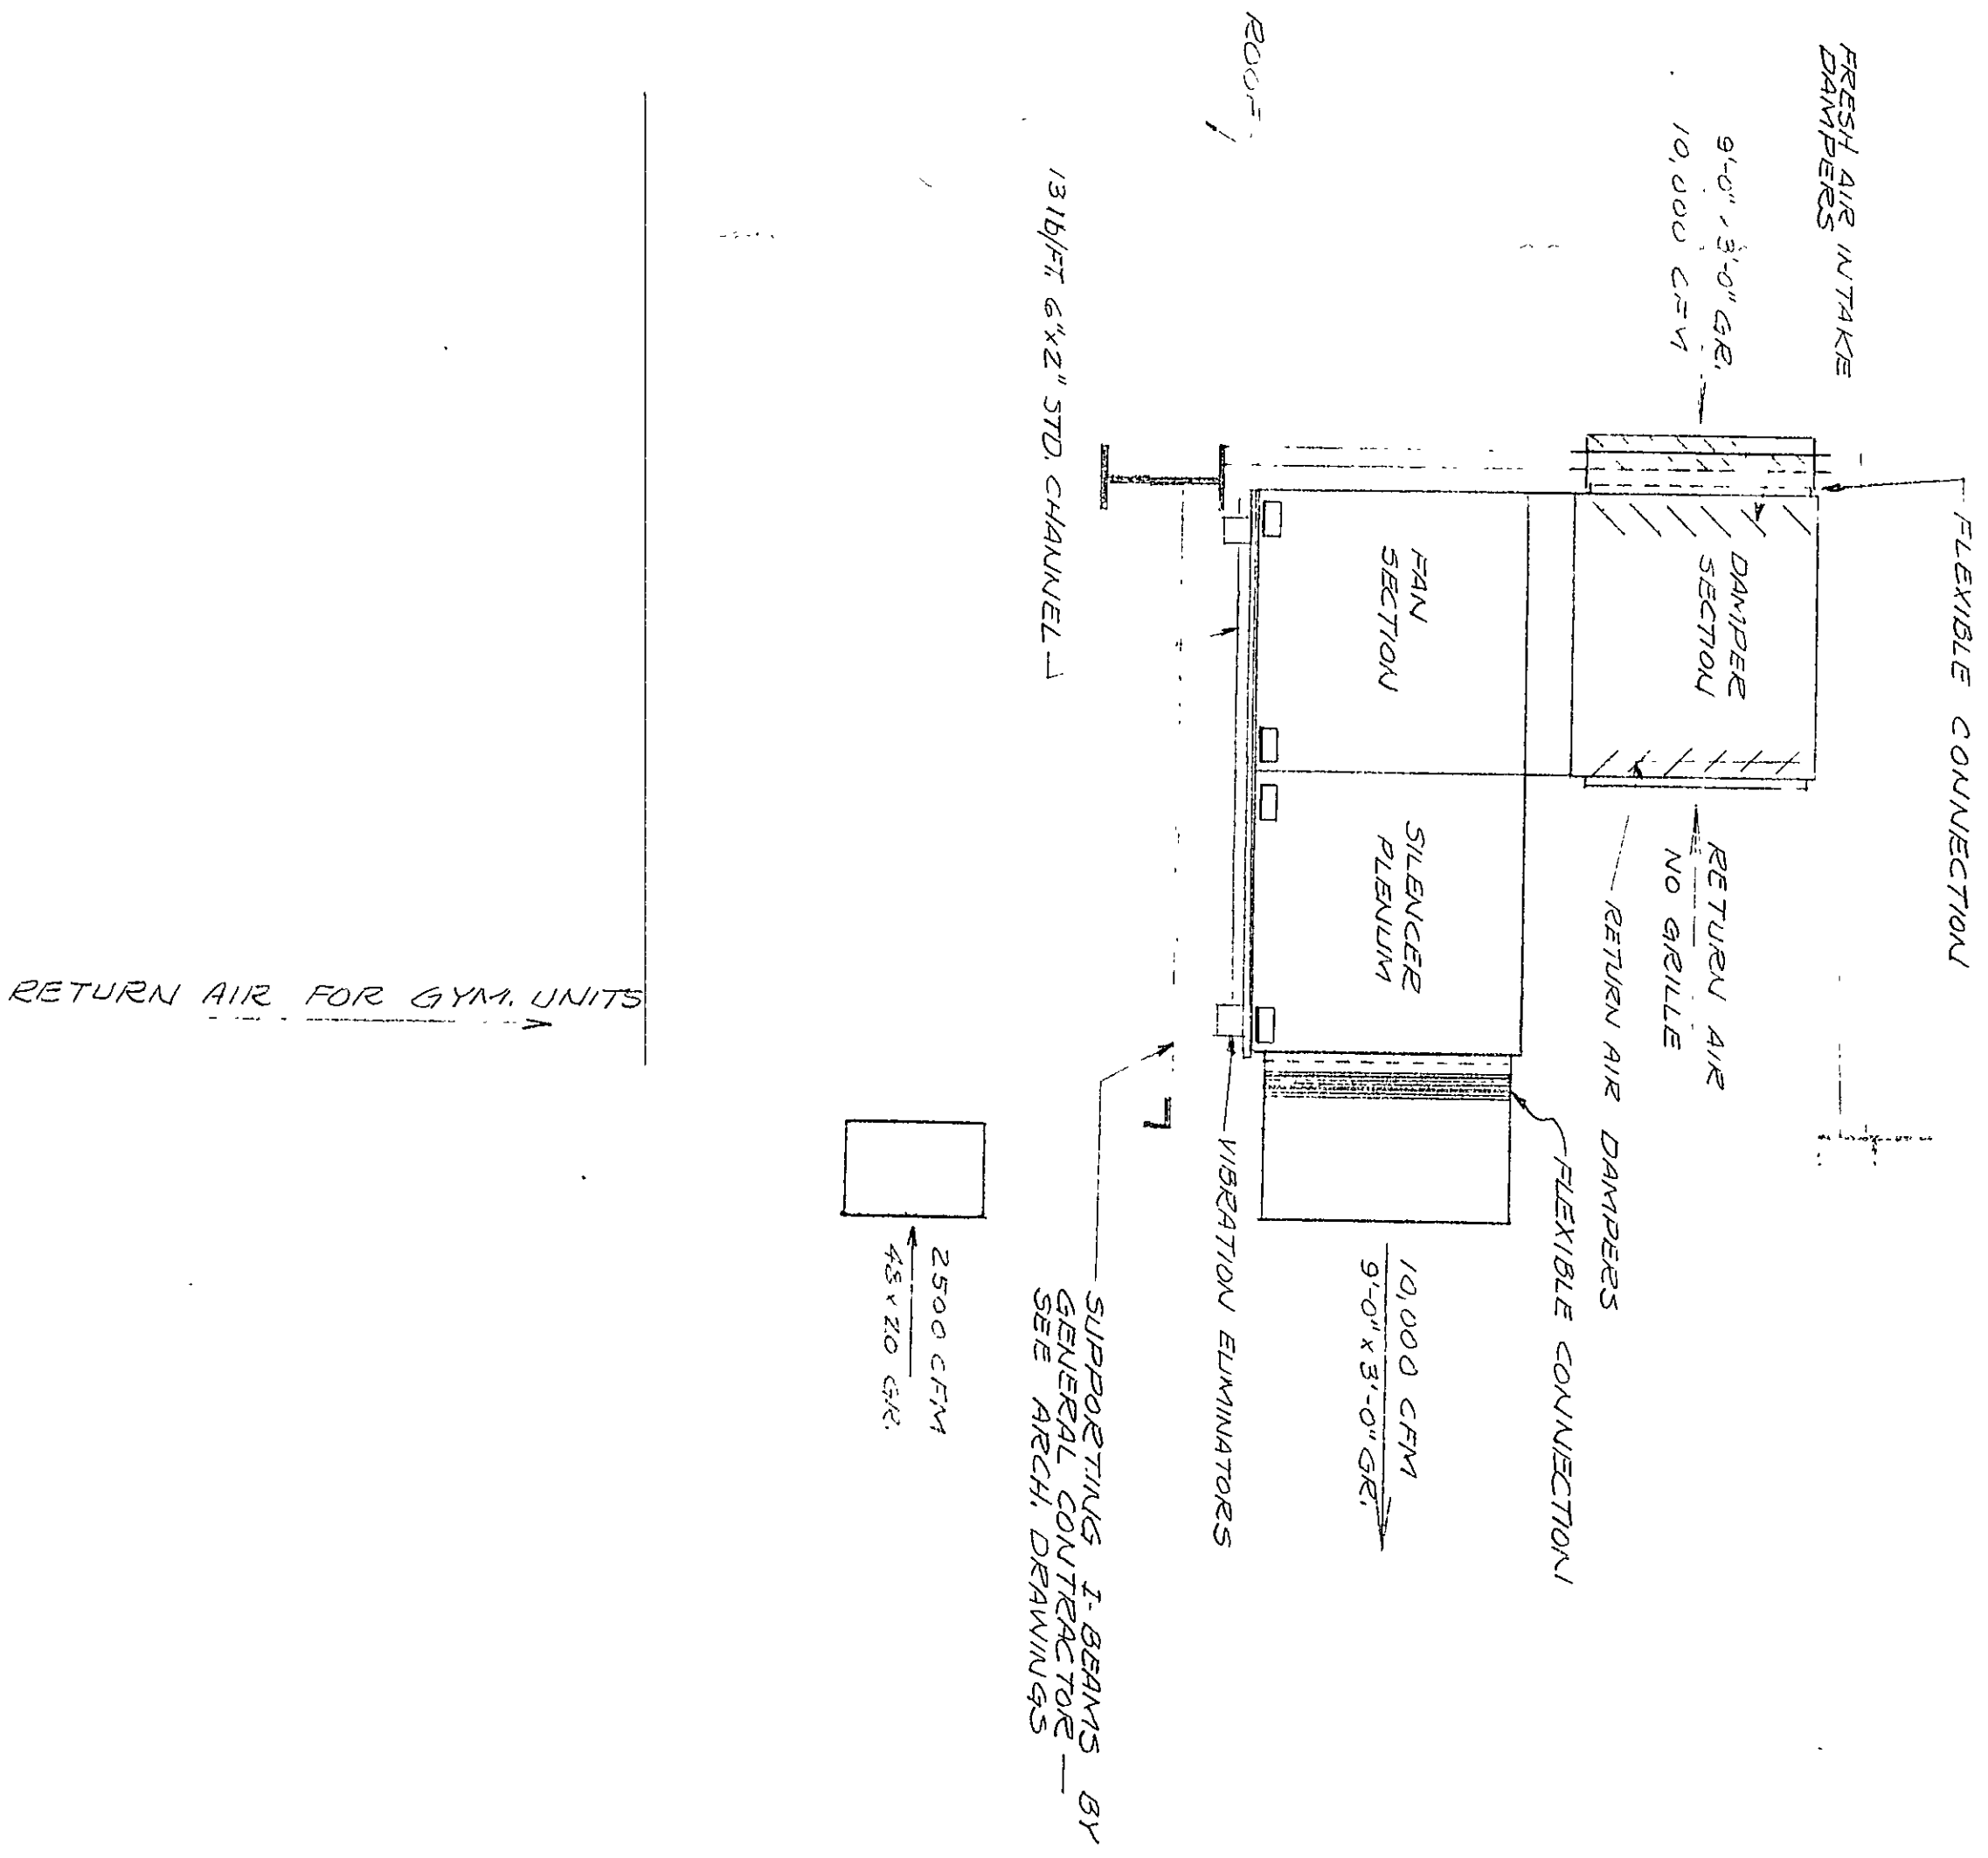


GYMNASIUM AIR HANDLING UNIT
1/2 SCALE

AIR HANDLING UNIT									
TAG	MAKE & STYLE	CFM	WATER FLOW	WATER DATA	WATER DATA	WATER DATA	WATER DATA	WATER DATA	WATER DATA
①	UNIT VENTILATOR	1000	1150	3	45"	1.5"	2.0"	3.0	1.75
②	UNIT VENTILATOR	1000	1150	3	45"	1.5"	2.0"	3.0	1.75
③	UNIT VENTILATOR	1000	1150	3	45"	1.5"	2.0"	3.0	1.75
④	UNIT VENTILATOR	1000	1150	3	45"	1.5"	2.0"	3.0	1.75
⑤	UNIT VENTILATOR	1000	1150	3	45"	1.5"	2.0"	3.0	1.75

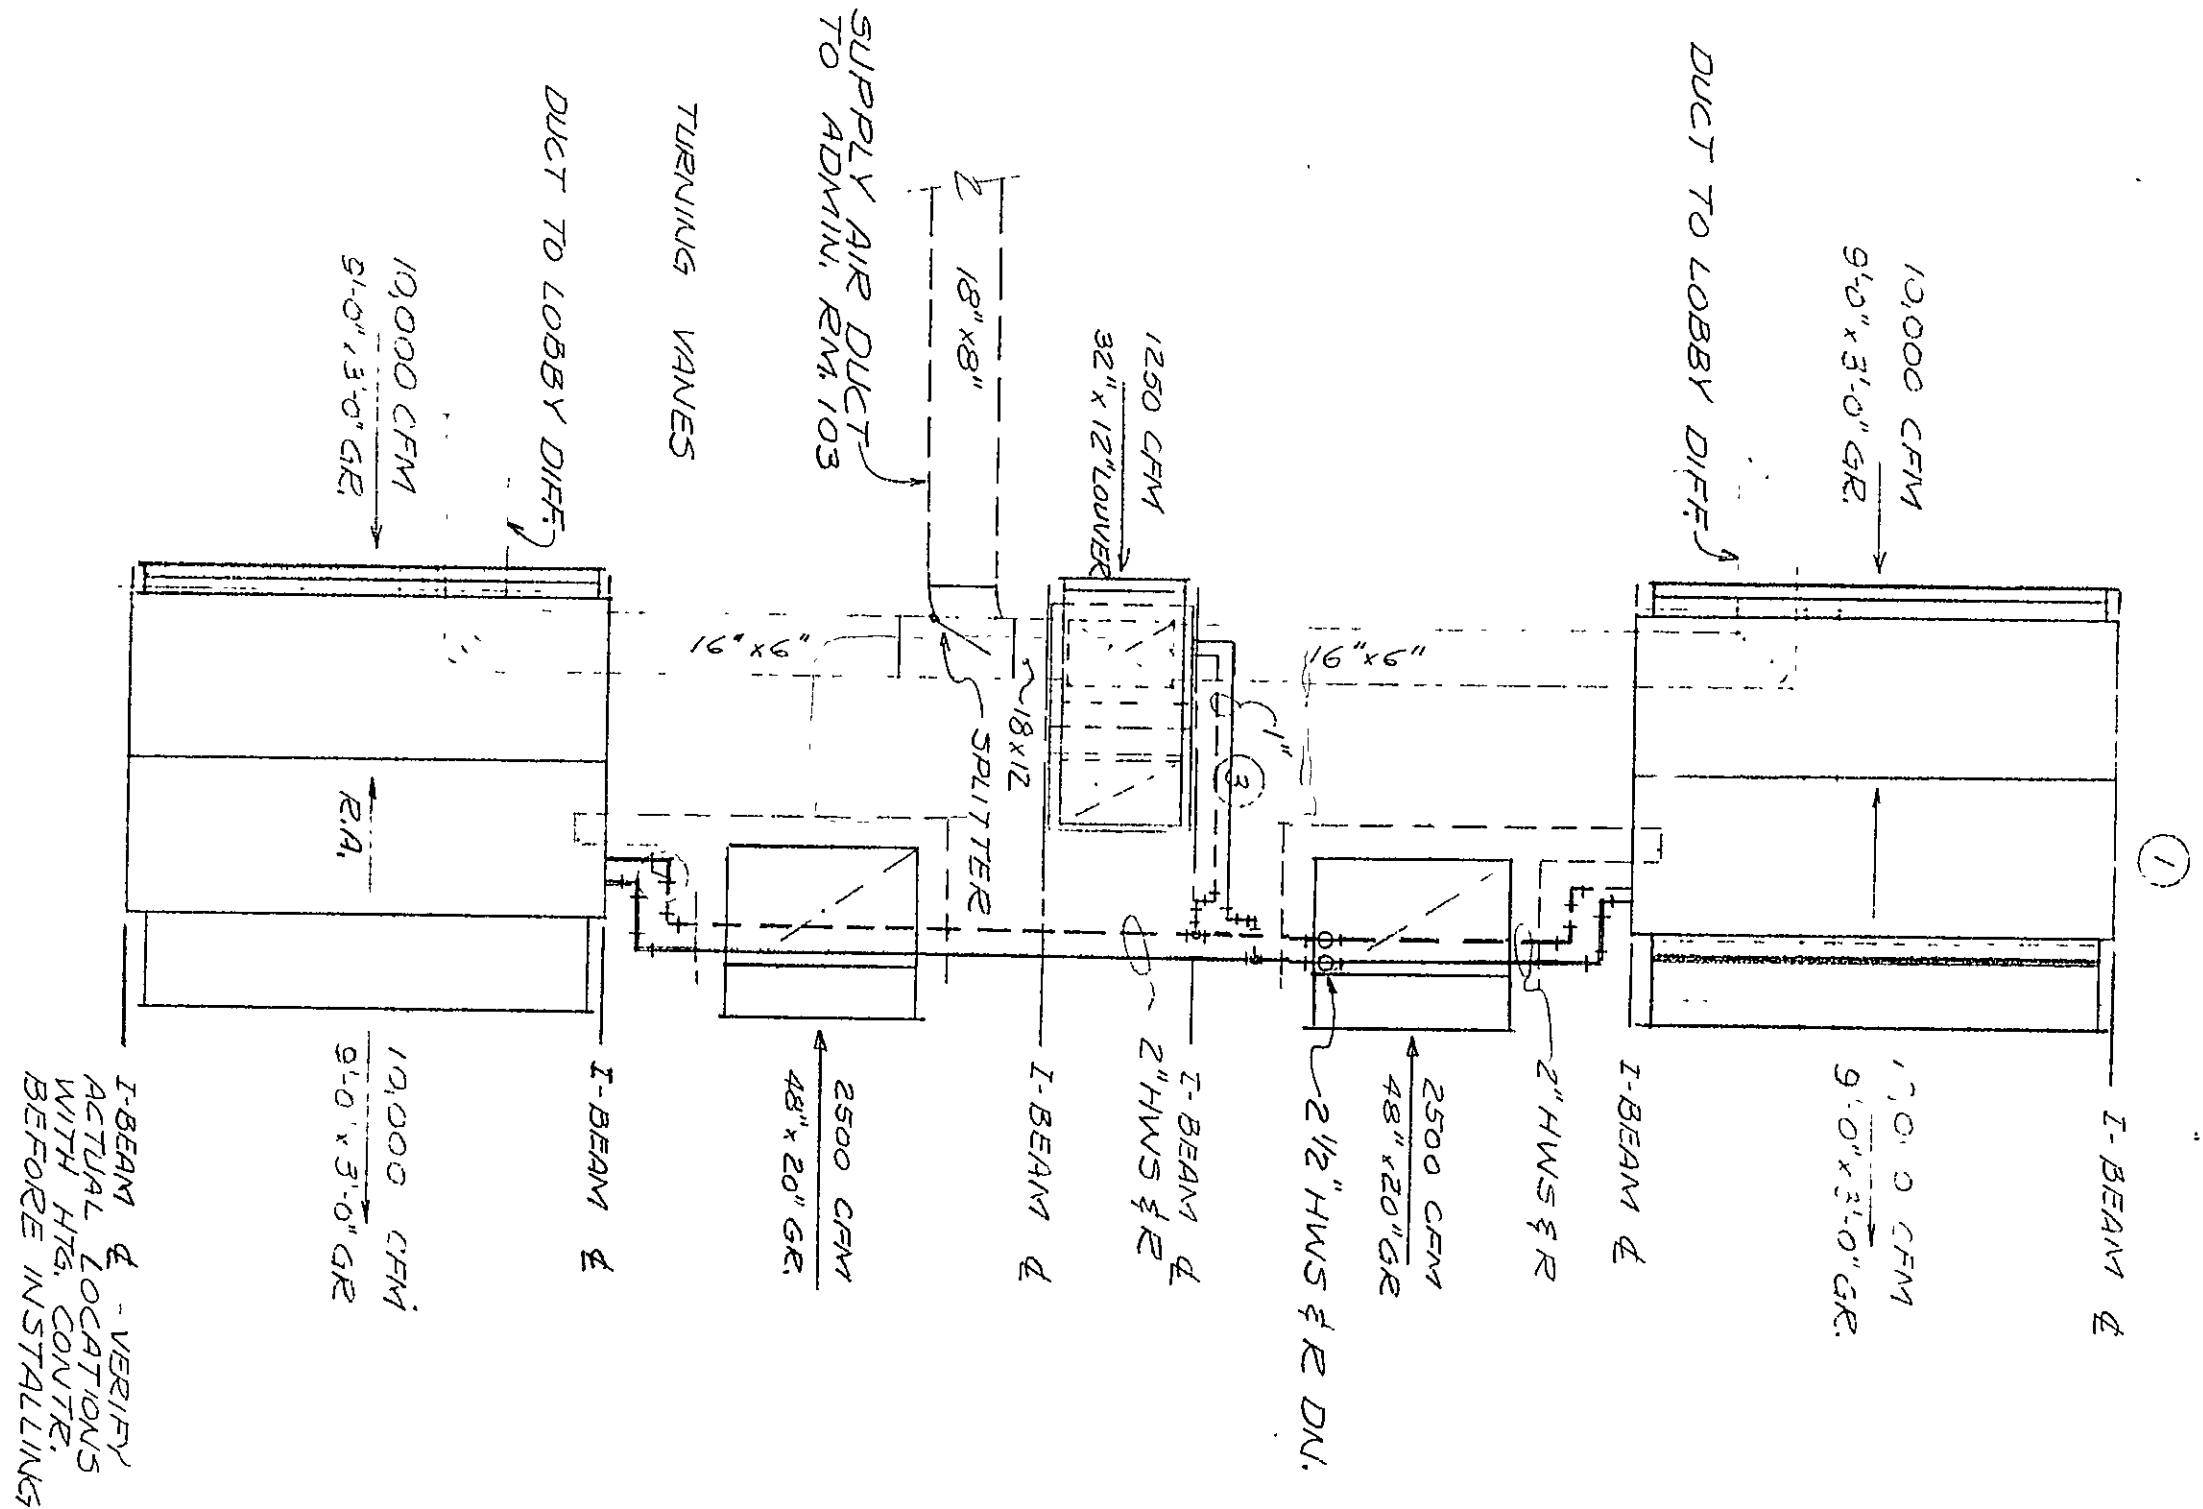

PARTIAL PENTHOUSE PLAN
1/8 SCALE

EXHAUST FLOW SCHEDULE					
TAG	MAKE & STYLE	CFM	WATER FLOW	WATER DATA	WATER DATA
①	UNIT VENTILATOR	1000	1150	3	45"
②	UNIT VENTILATOR	1000	1150	3	45"
③	UNIT VENTILATOR	1000	1150	3	45"
④	UNIT VENTILATOR	1000	1150	3	45"
⑤	UNIT VENTILATOR	1000	1150	3	45"

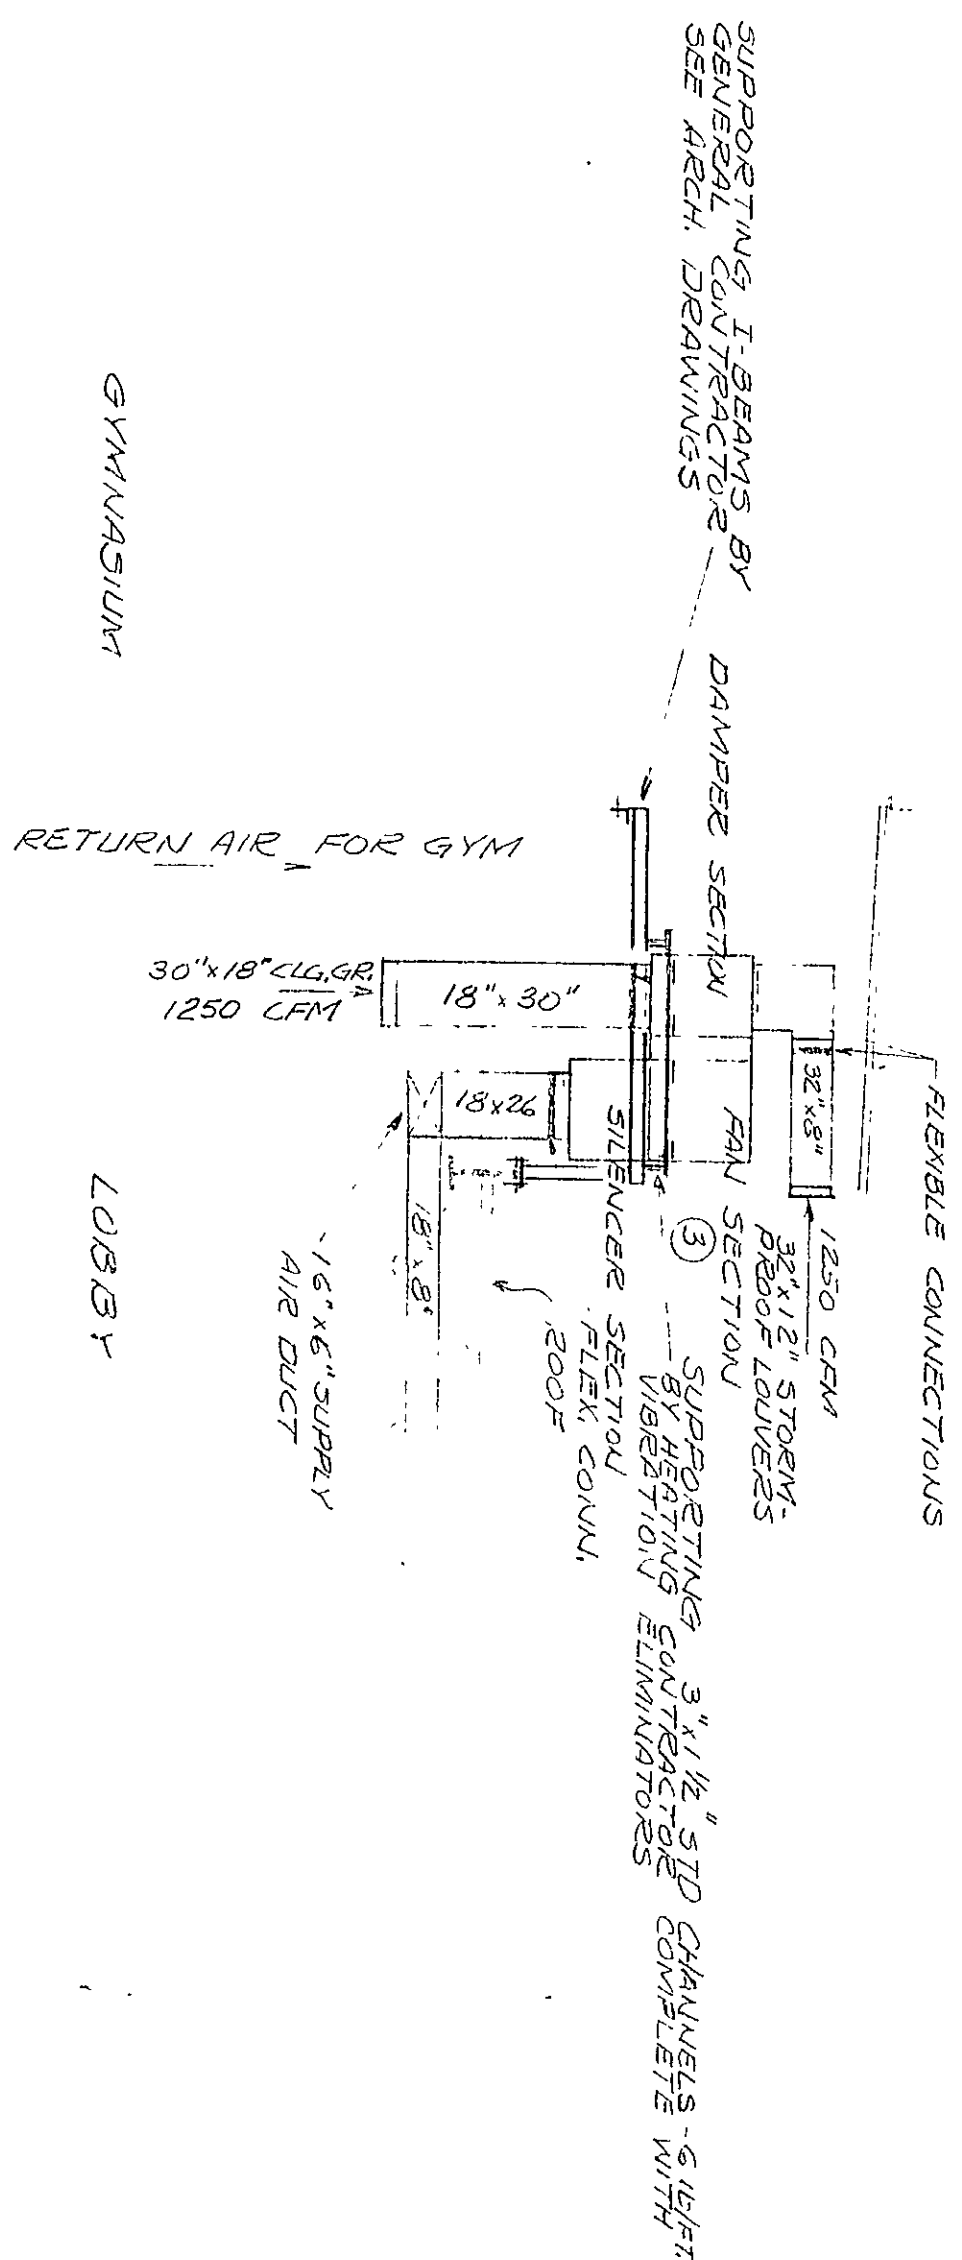

LOBBY AIR HANDLING UNIT
1/8 SCALE