




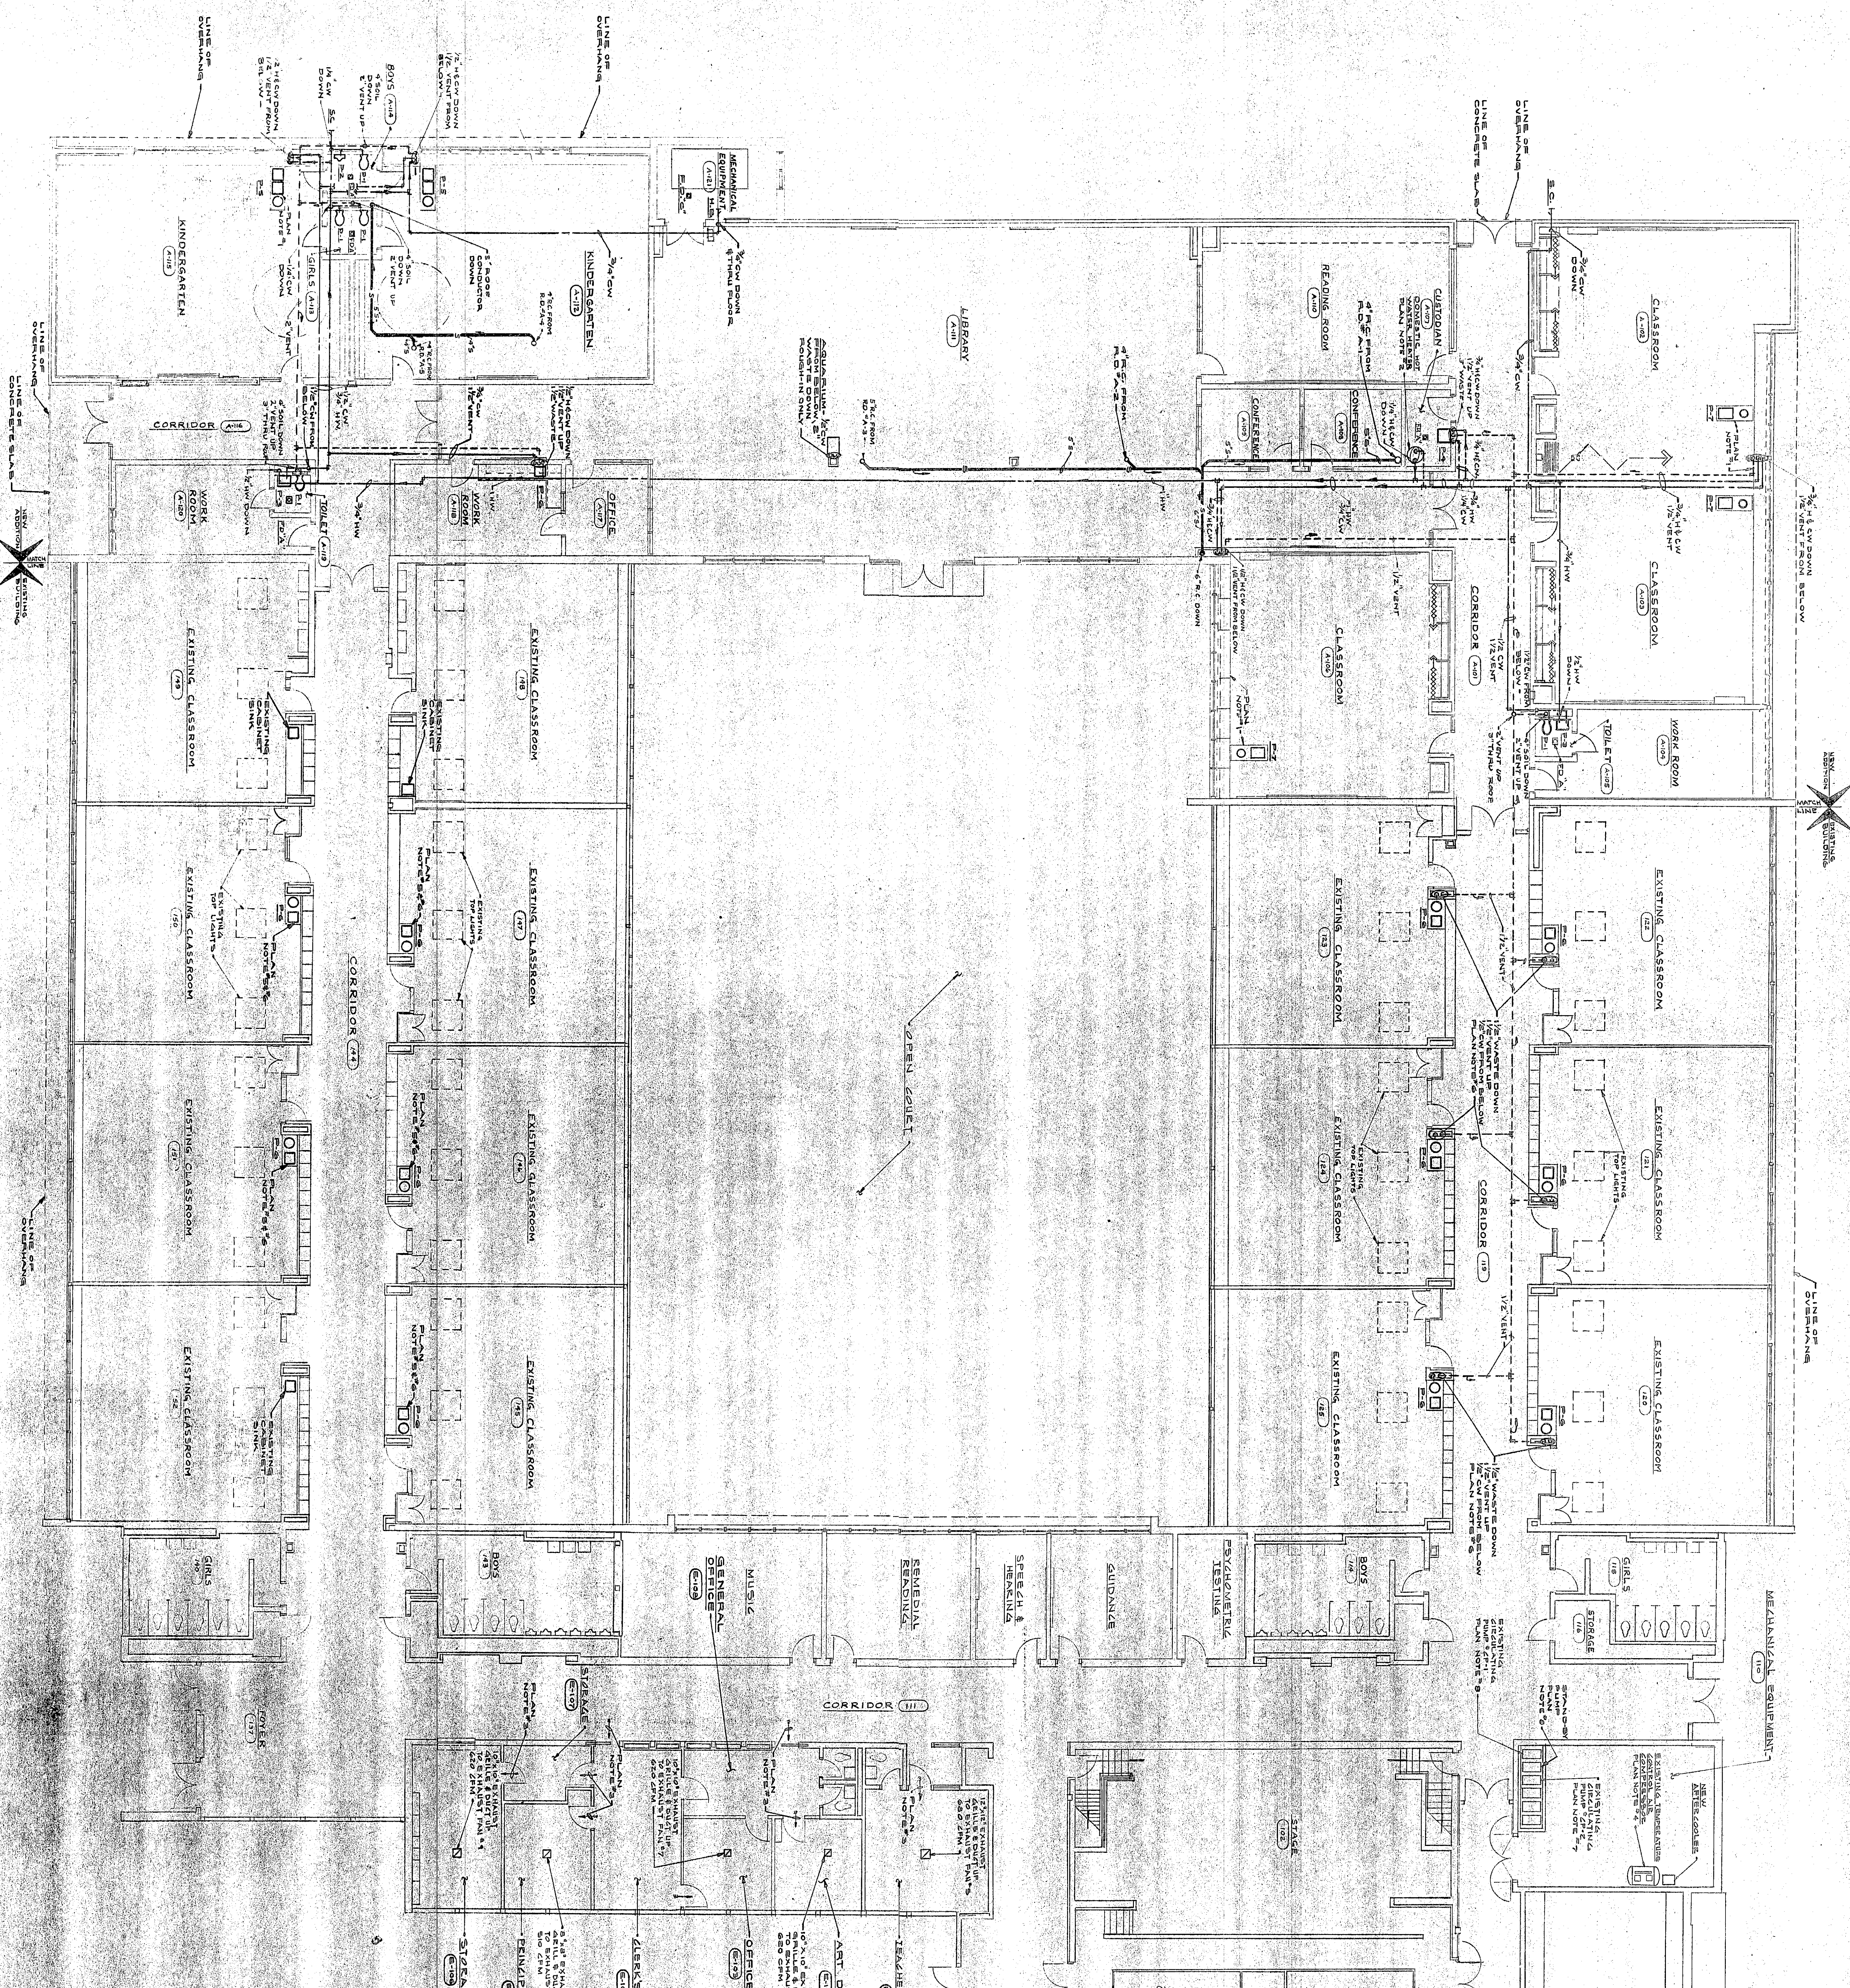


- PLAN NOTE**
1. ALL NEW AND EXISTING PIPING SHALL BE RUN IN CONFORMANCE WITH THE LATEST EDITION OF THE NATIONAL PLUMBING INSTITUTE (NPI) AND THE NATIONAL FIRE PROTECTION ASSOCIATION (NFPA) STANDARDS.
 2. ALL NEW PIPING SHALL BE INSTALLED IN ACCORDANCE WITH THE LATEST EDITION OF THE NATIONAL PLUMBING INSTITUTE (NPI) AND THE NATIONAL FIRE PROTECTION ASSOCIATION (NFPA) STANDARDS.
 3. ALL EXISTING PIPING SHALL BE MAINTAINED IN GOOD WORKING ORDER AND SHALL BE REPAIRED OR REPLACED AS NECESSARY.
 4. ALL NEW PIPING SHALL BE INSTALLED IN ACCORDANCE WITH THE LATEST EDITION OF THE NATIONAL PLUMBING INSTITUTE (NPI) AND THE NATIONAL FIRE PROTECTION ASSOCIATION (NFPA) STANDARDS.
 5. ALL EXISTING PIPING SHALL BE MAINTAINED IN GOOD WORKING ORDER AND SHALL BE REPAIRED OR REPLACED AS NECESSARY.
 6. ALL NEW PIPING SHALL BE INSTALLED IN ACCORDANCE WITH THE LATEST EDITION OF THE NATIONAL PLUMBING INSTITUTE (NPI) AND THE NATIONAL FIRE PROTECTION ASSOCIATION (NFPA) STANDARDS.
 7. ALL EXISTING PIPING SHALL BE MAINTAINED IN GOOD WORKING ORDER AND SHALL BE REPAIRED OR REPLACED AS NECESSARY.
 8. ALL NEW PIPING SHALL BE INSTALLED IN ACCORDANCE WITH THE LATEST EDITION OF THE NATIONAL PLUMBING INSTITUTE (NPI) AND THE NATIONAL FIRE PROTECTION ASSOCIATION (NFPA) STANDARDS.
 9. ALL EXISTING PIPING SHALL BE MAINTAINED IN GOOD WORKING ORDER AND SHALL BE REPAIRED OR REPLACED AS NECESSARY.
 10. ALL NEW PIPING SHALL BE INSTALLED IN ACCORDANCE WITH THE LATEST EDITION OF THE NATIONAL PLUMBING INSTITUTE (NPI) AND THE NATIONAL FIRE PROTECTION ASSOCIATION (NFPA) STANDARDS.

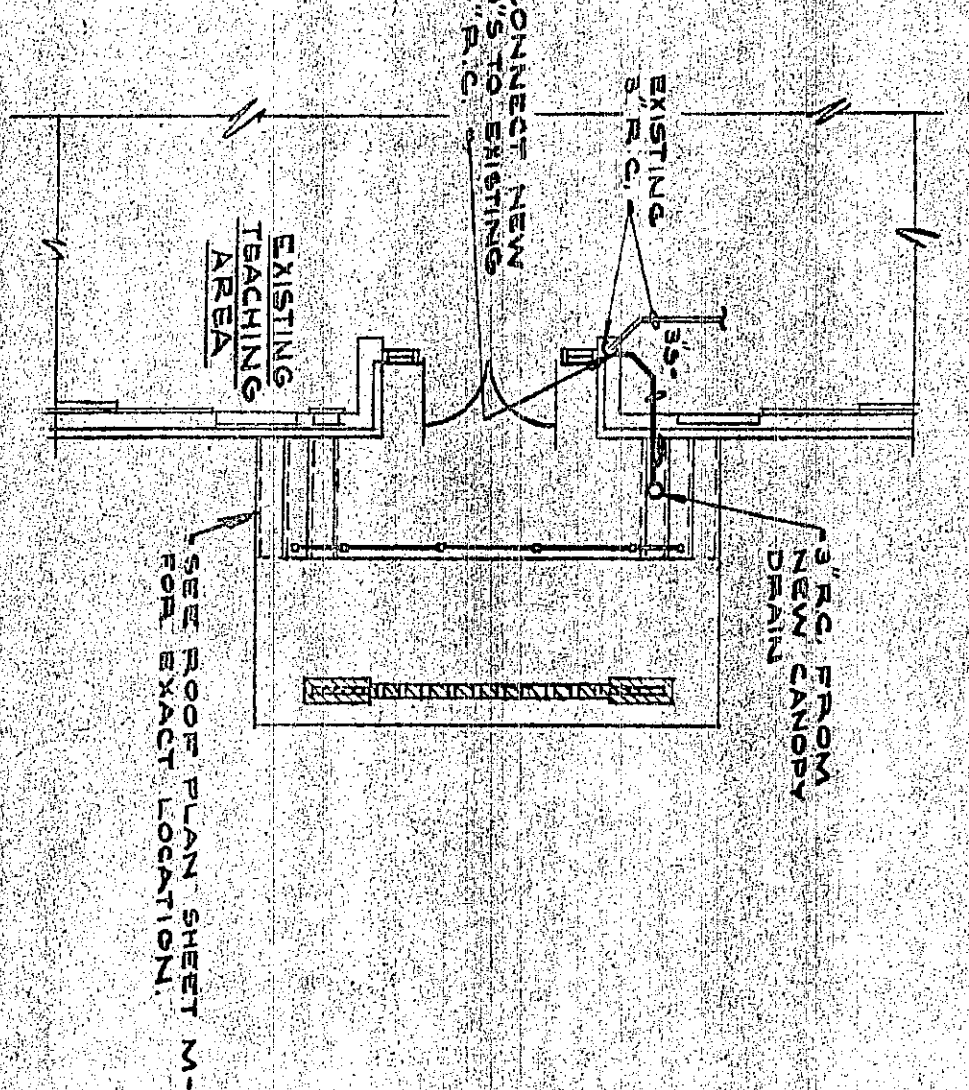

DETAIL OF NEW CANOPY DRAIN ON EXISTING BUILDING

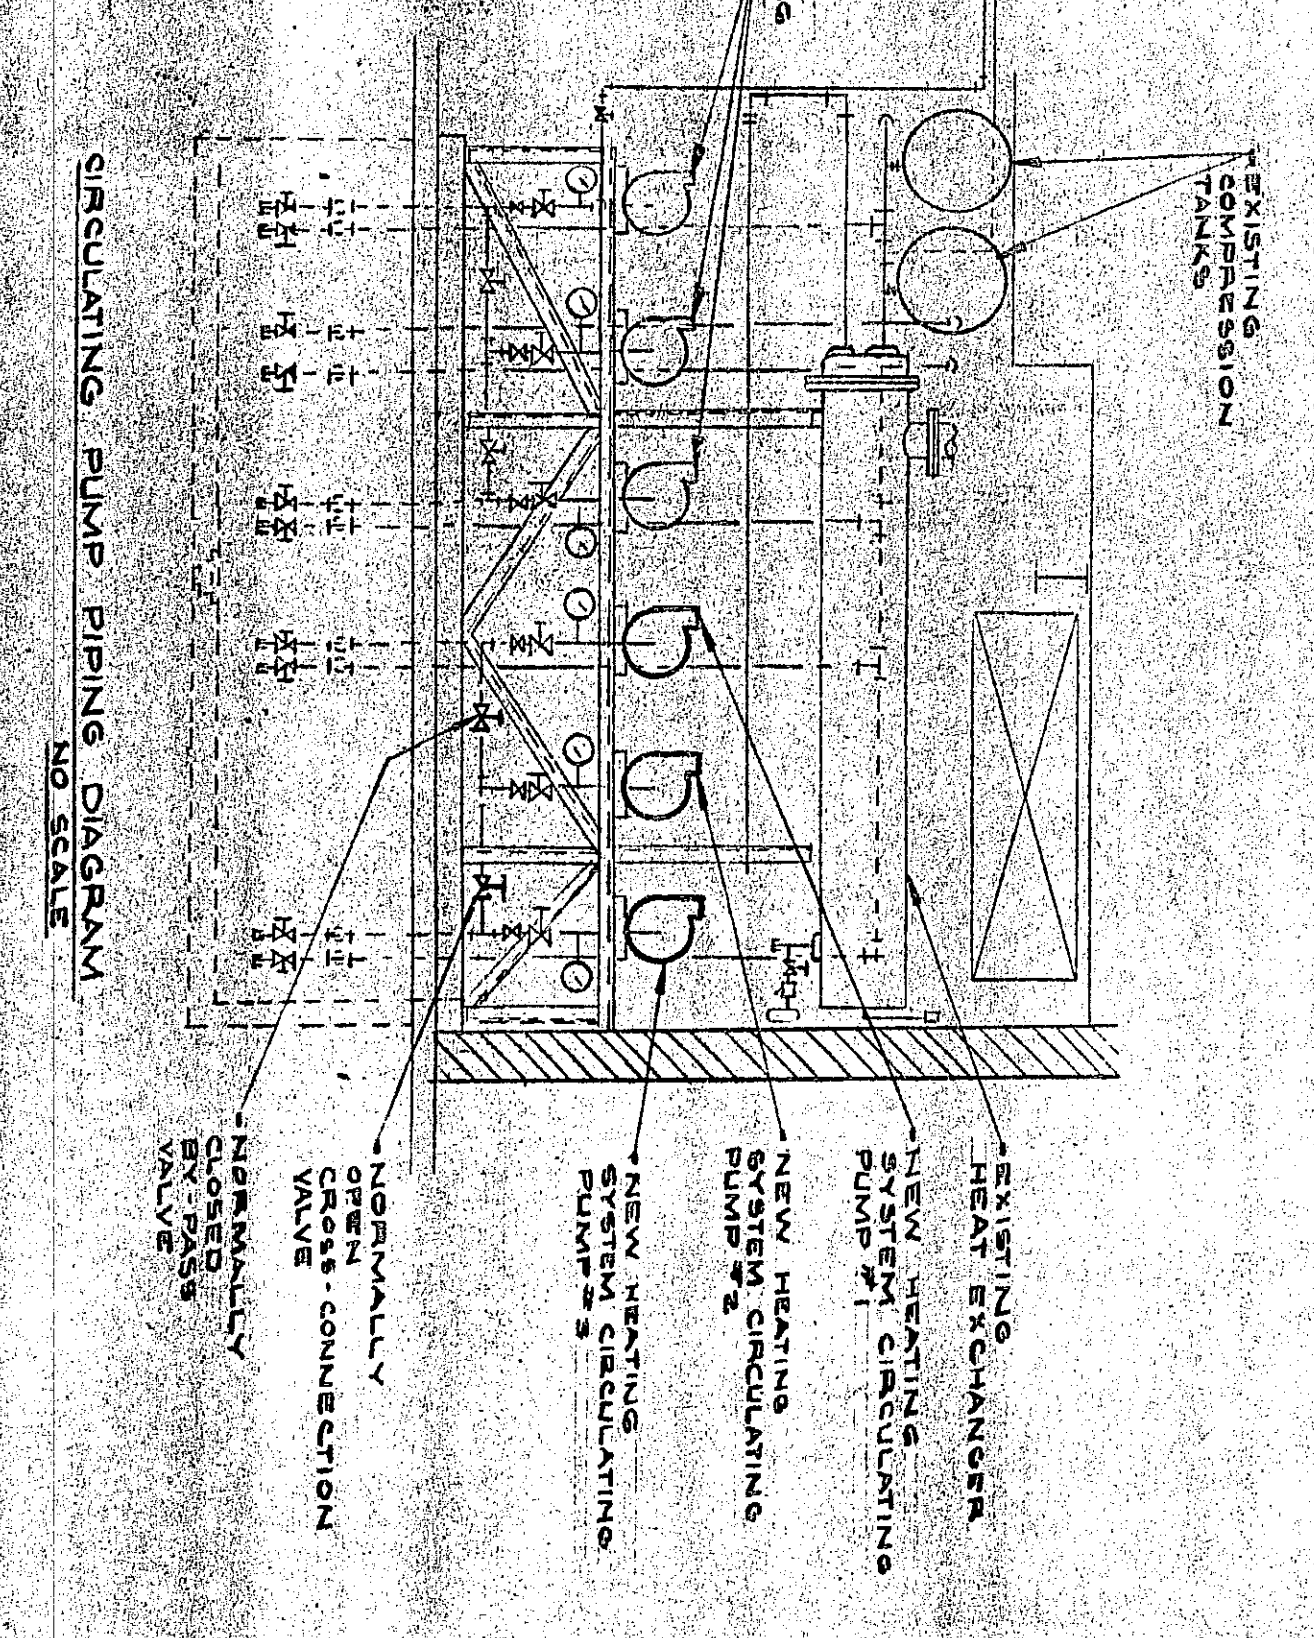

CIRCULATING PUMP PIPING DIAGRAM

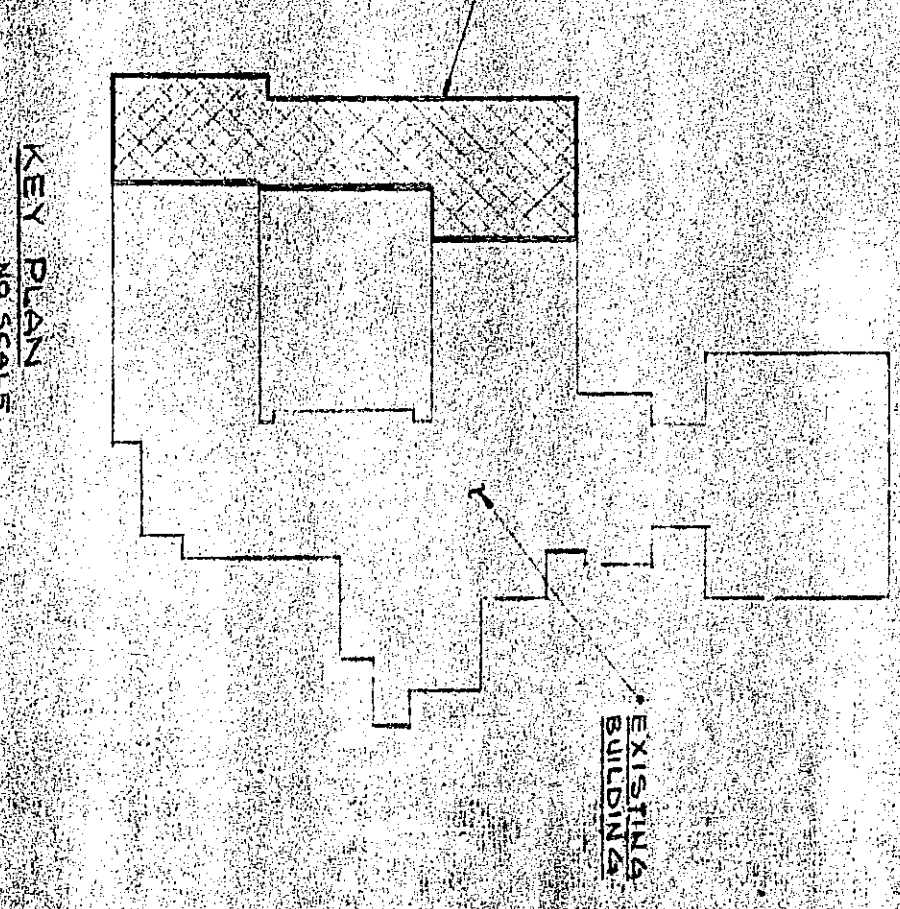

KEY PLAN