



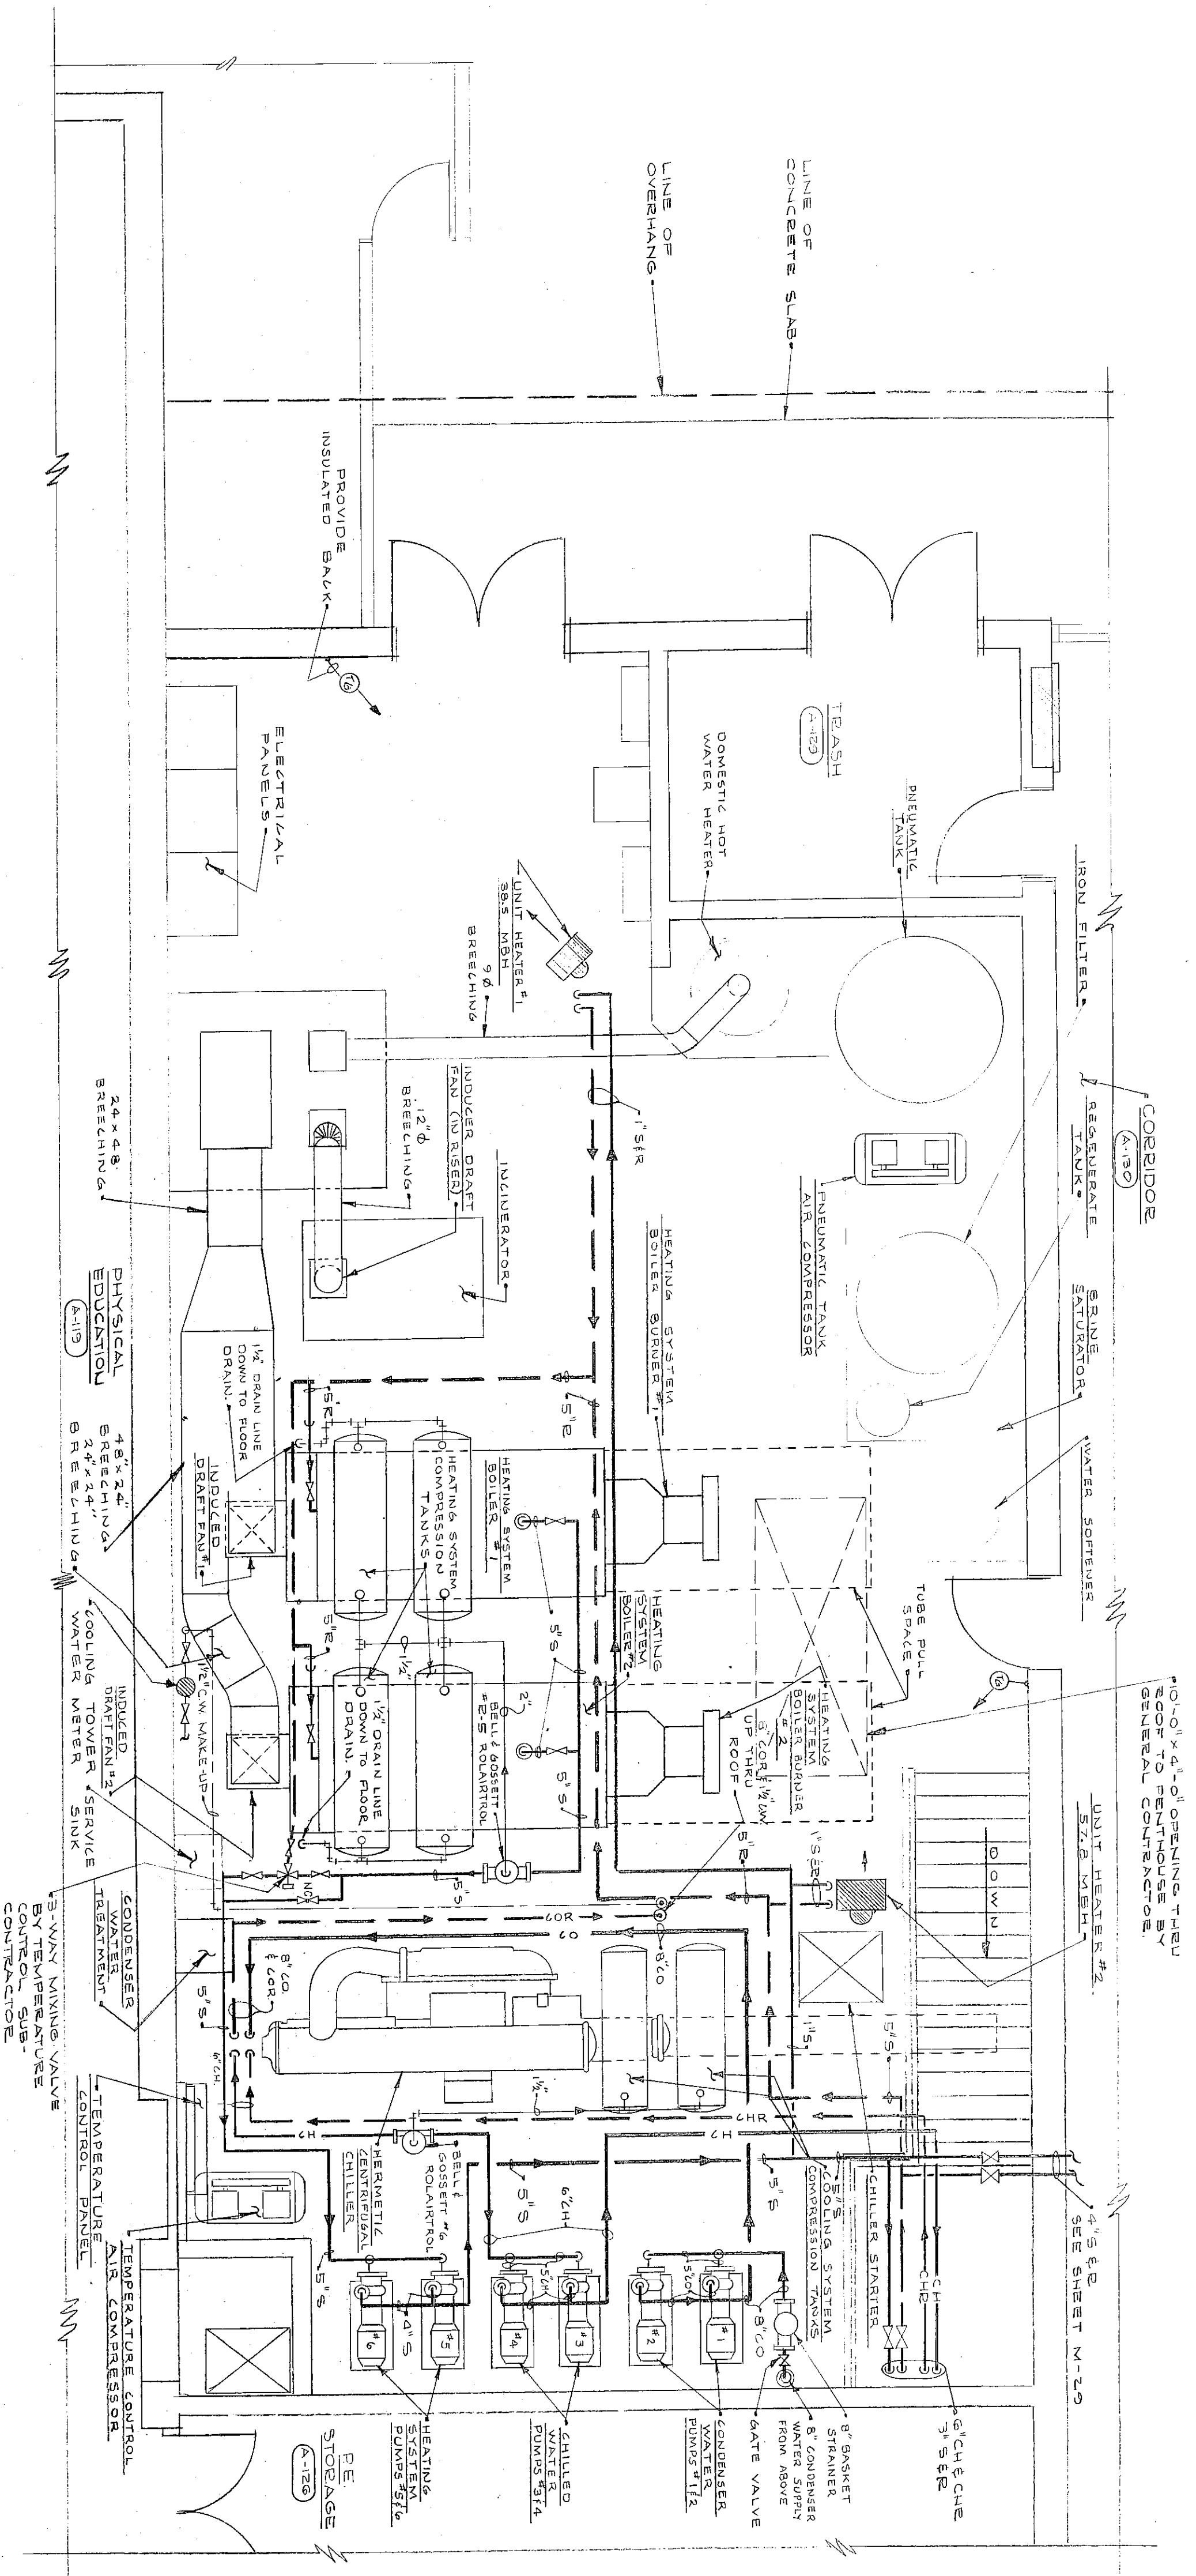

PLUMBING BOILER ROOM EQUIPMENT LAYOUT

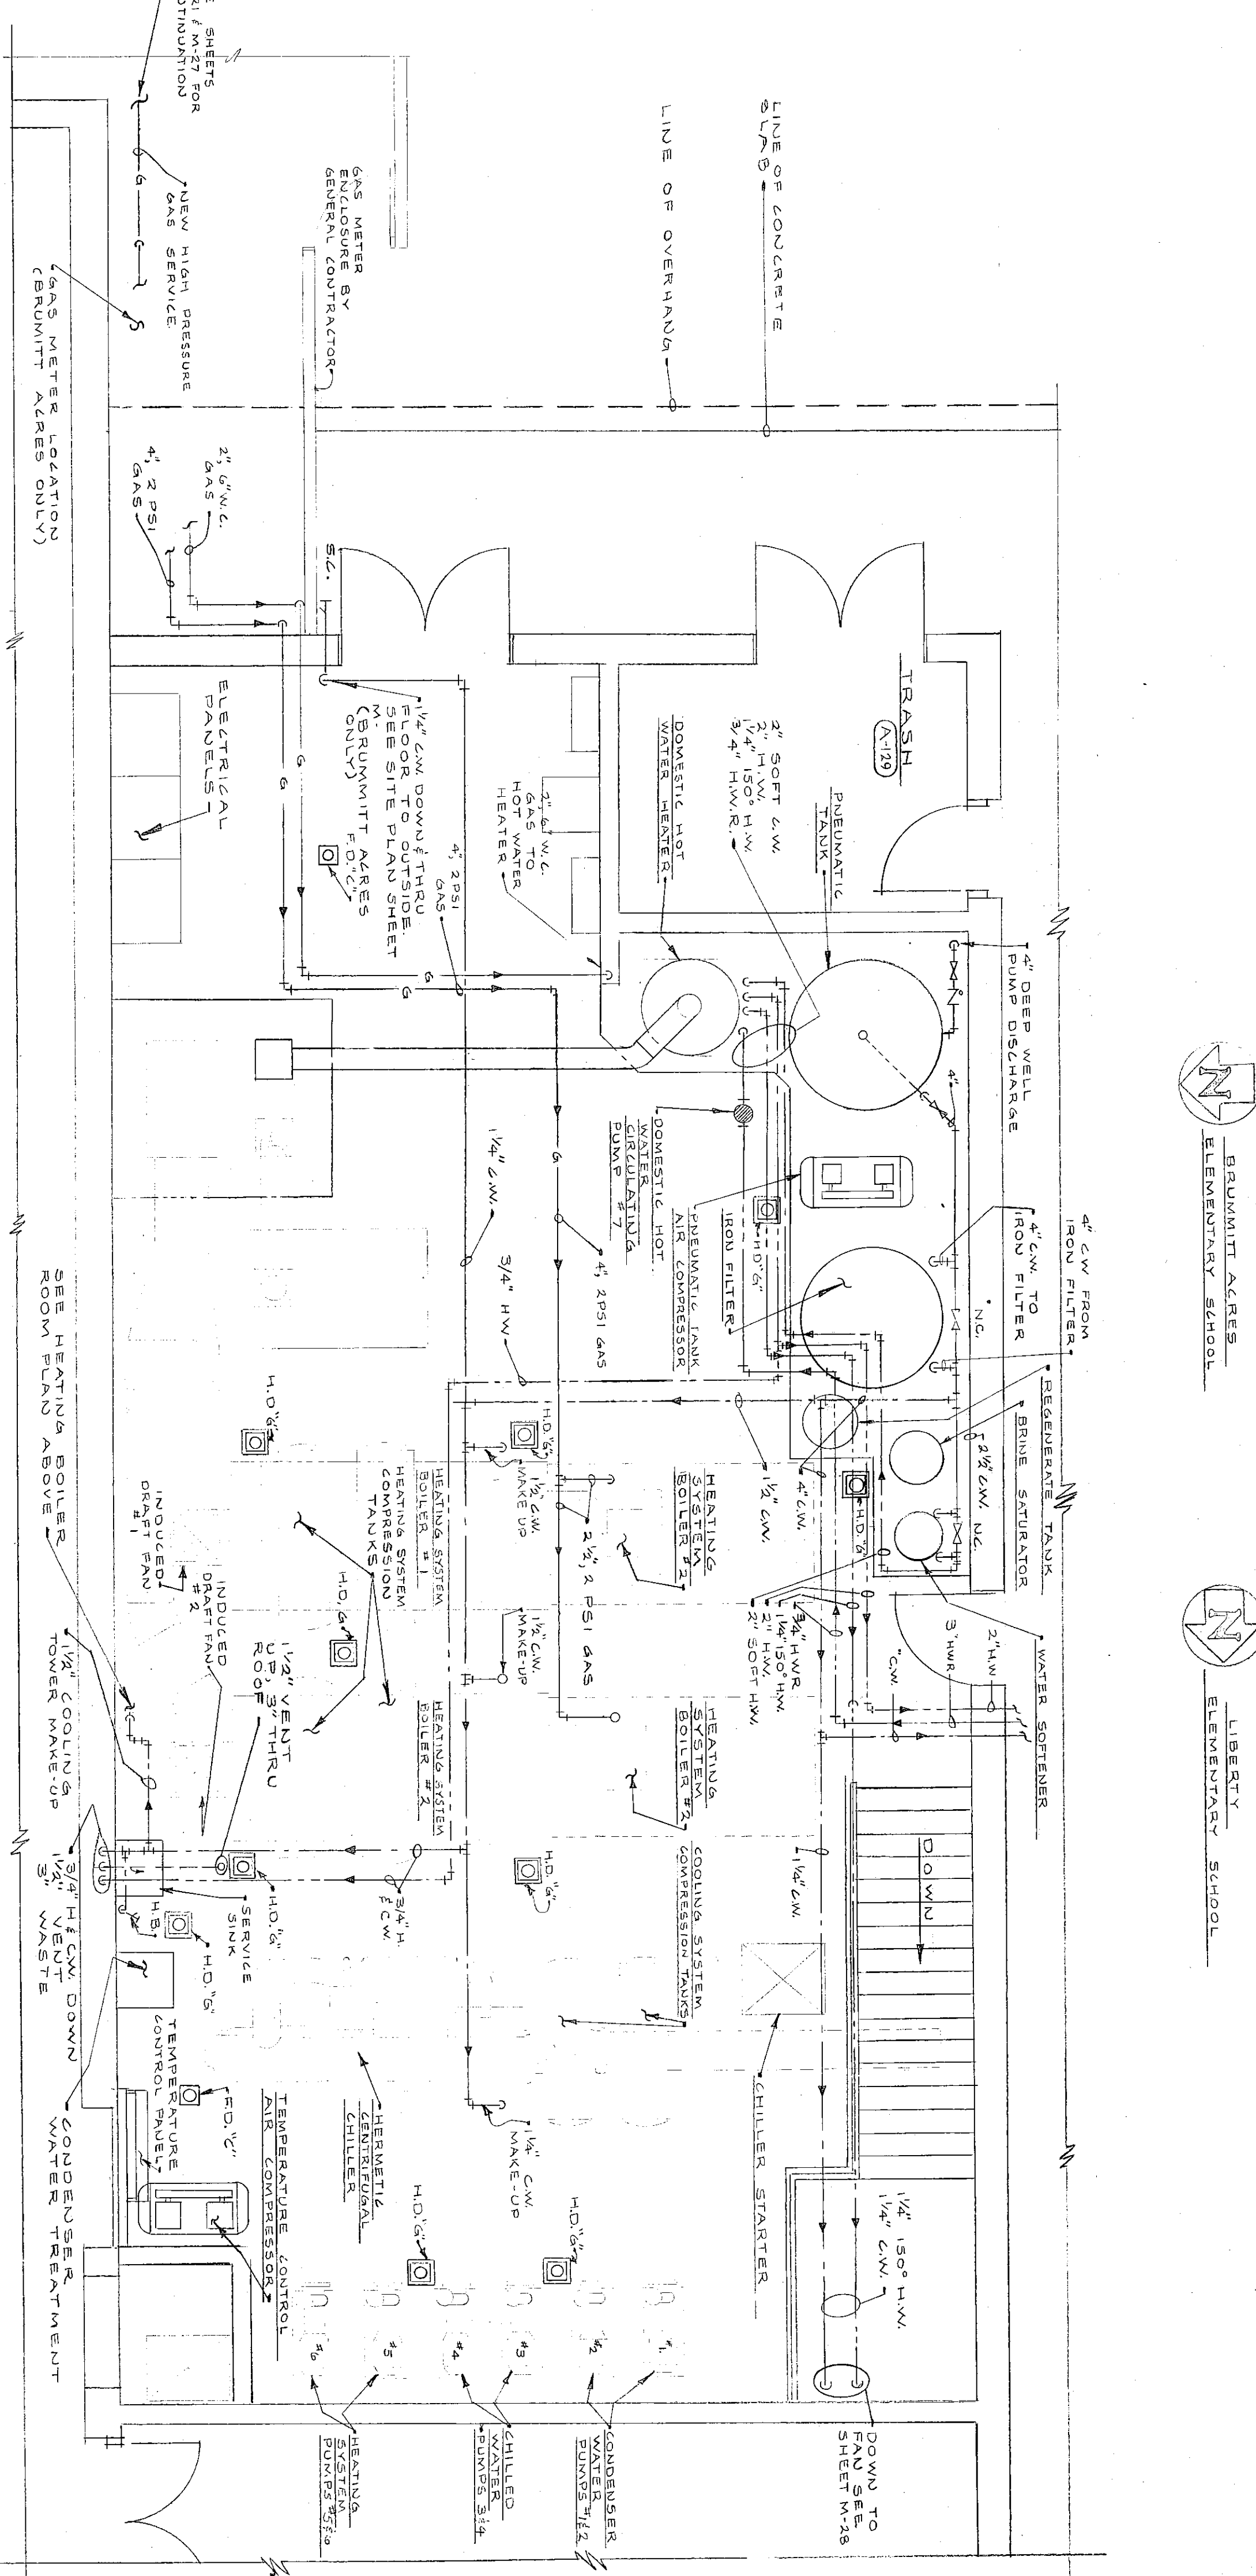


PLUMBING BOILER ROOM EQUIPMENT LAYOUT


NOTES:

1. PUMP MOTOR, 480 VOLTS, 3 PHASE, 60 CYCLES, 1750 R.P.M.
2. PUMP MOTOR, 115 VOLTS, 1 PHASE, 60 CYCLES, 1750 R.P.M.
3. PUMP SHALL START STOP ON 10° TEMPERATURE
4. WARNING IN RETURN MAINS.

CIRCULATING PUMP SCHEDULE			
NO.	SYSTEM SERVED	BELOW GROUND	SEE
1	CONDENSER WATER	151 B	4.25
2	CONDENSER WATER	151 B	4.25
3	CHILLED WATER	151 B	5.85
4	CHILLED WATER	151 B	5.85
5	HEATING WATER	151 B	2.25
6	HEATING WATER	151 B	2.25
7	CONDENSER WATER	151 B	4.25

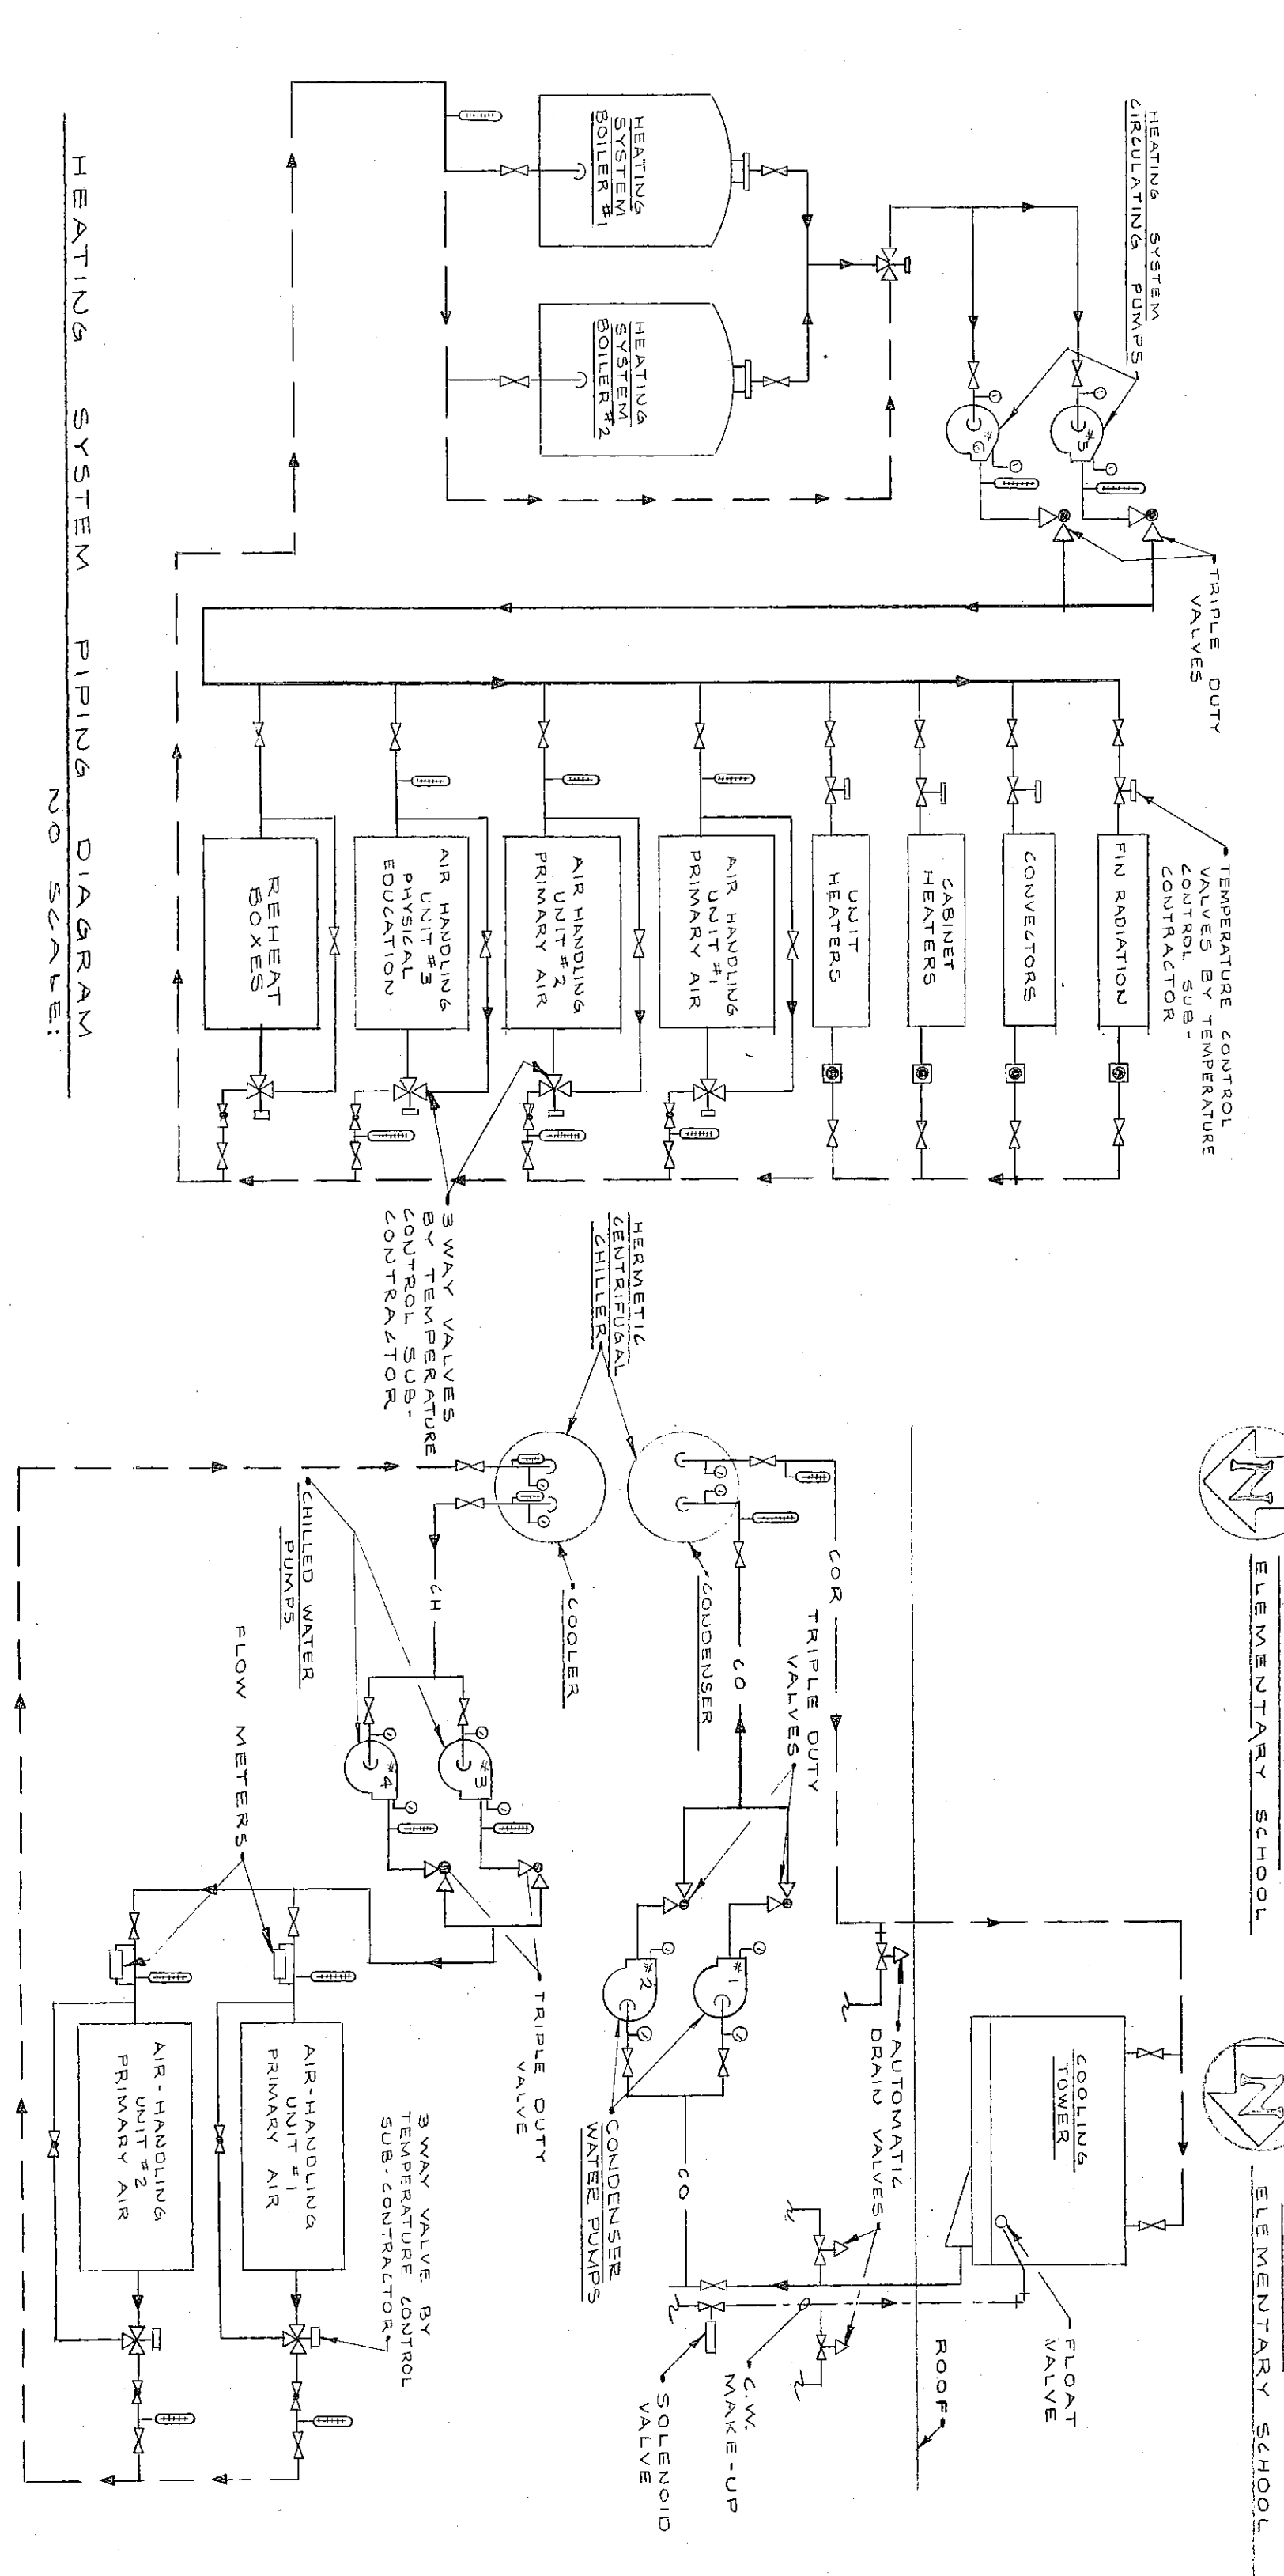


HEATING SYSTEM PIPING NO. 30

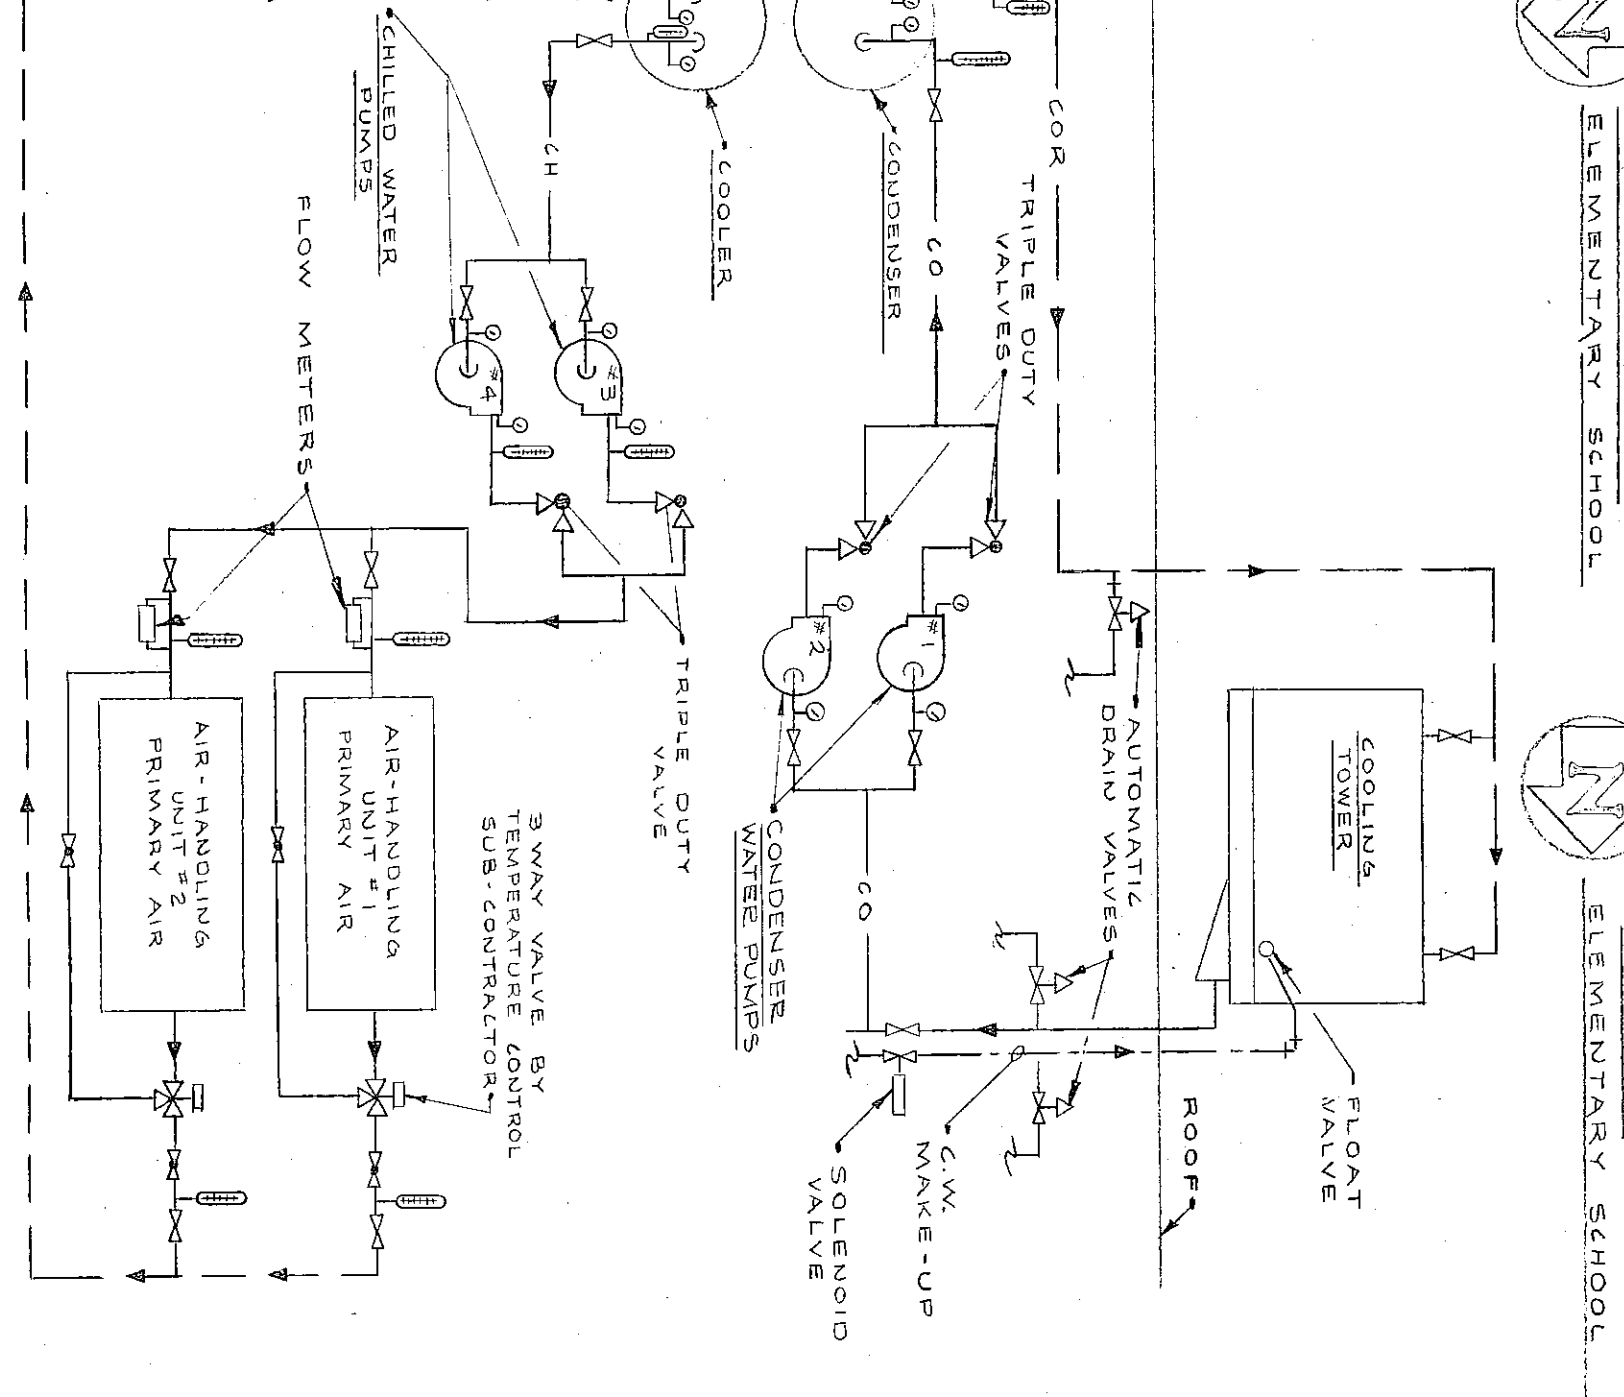


CHILLED WATER PIPING NO. 30

BOILER ROOM EQUIPMENT SCHEDULE


NO.	DESCRIPTION	MAKE	HP	WGT.	NOTE
1	CONDENSER WATER PUMP	151 B	4.25	1750 R.P.M.	SEE SCHEDULE
2	CHILLED WATER PUMP	151 B	5.85	1750 R.P.M.	SEE SCHEDULE
3	HEATING WATER PUMP	151 B	2.25	1750 R.P.M.	SEE SCHEDULE
4	CONDENSER WATER PUMP	151 B	4.25	1750 R.P.M.	SEE SCHEDULE
5	CHILLED WATER PUMP	151 B	5.85	1750 R.P.M.	SEE SCHEDULE
6	HEATING WATER PUMP	151 B	2.25	1750 R.P.M.	SEE SCHEDULE

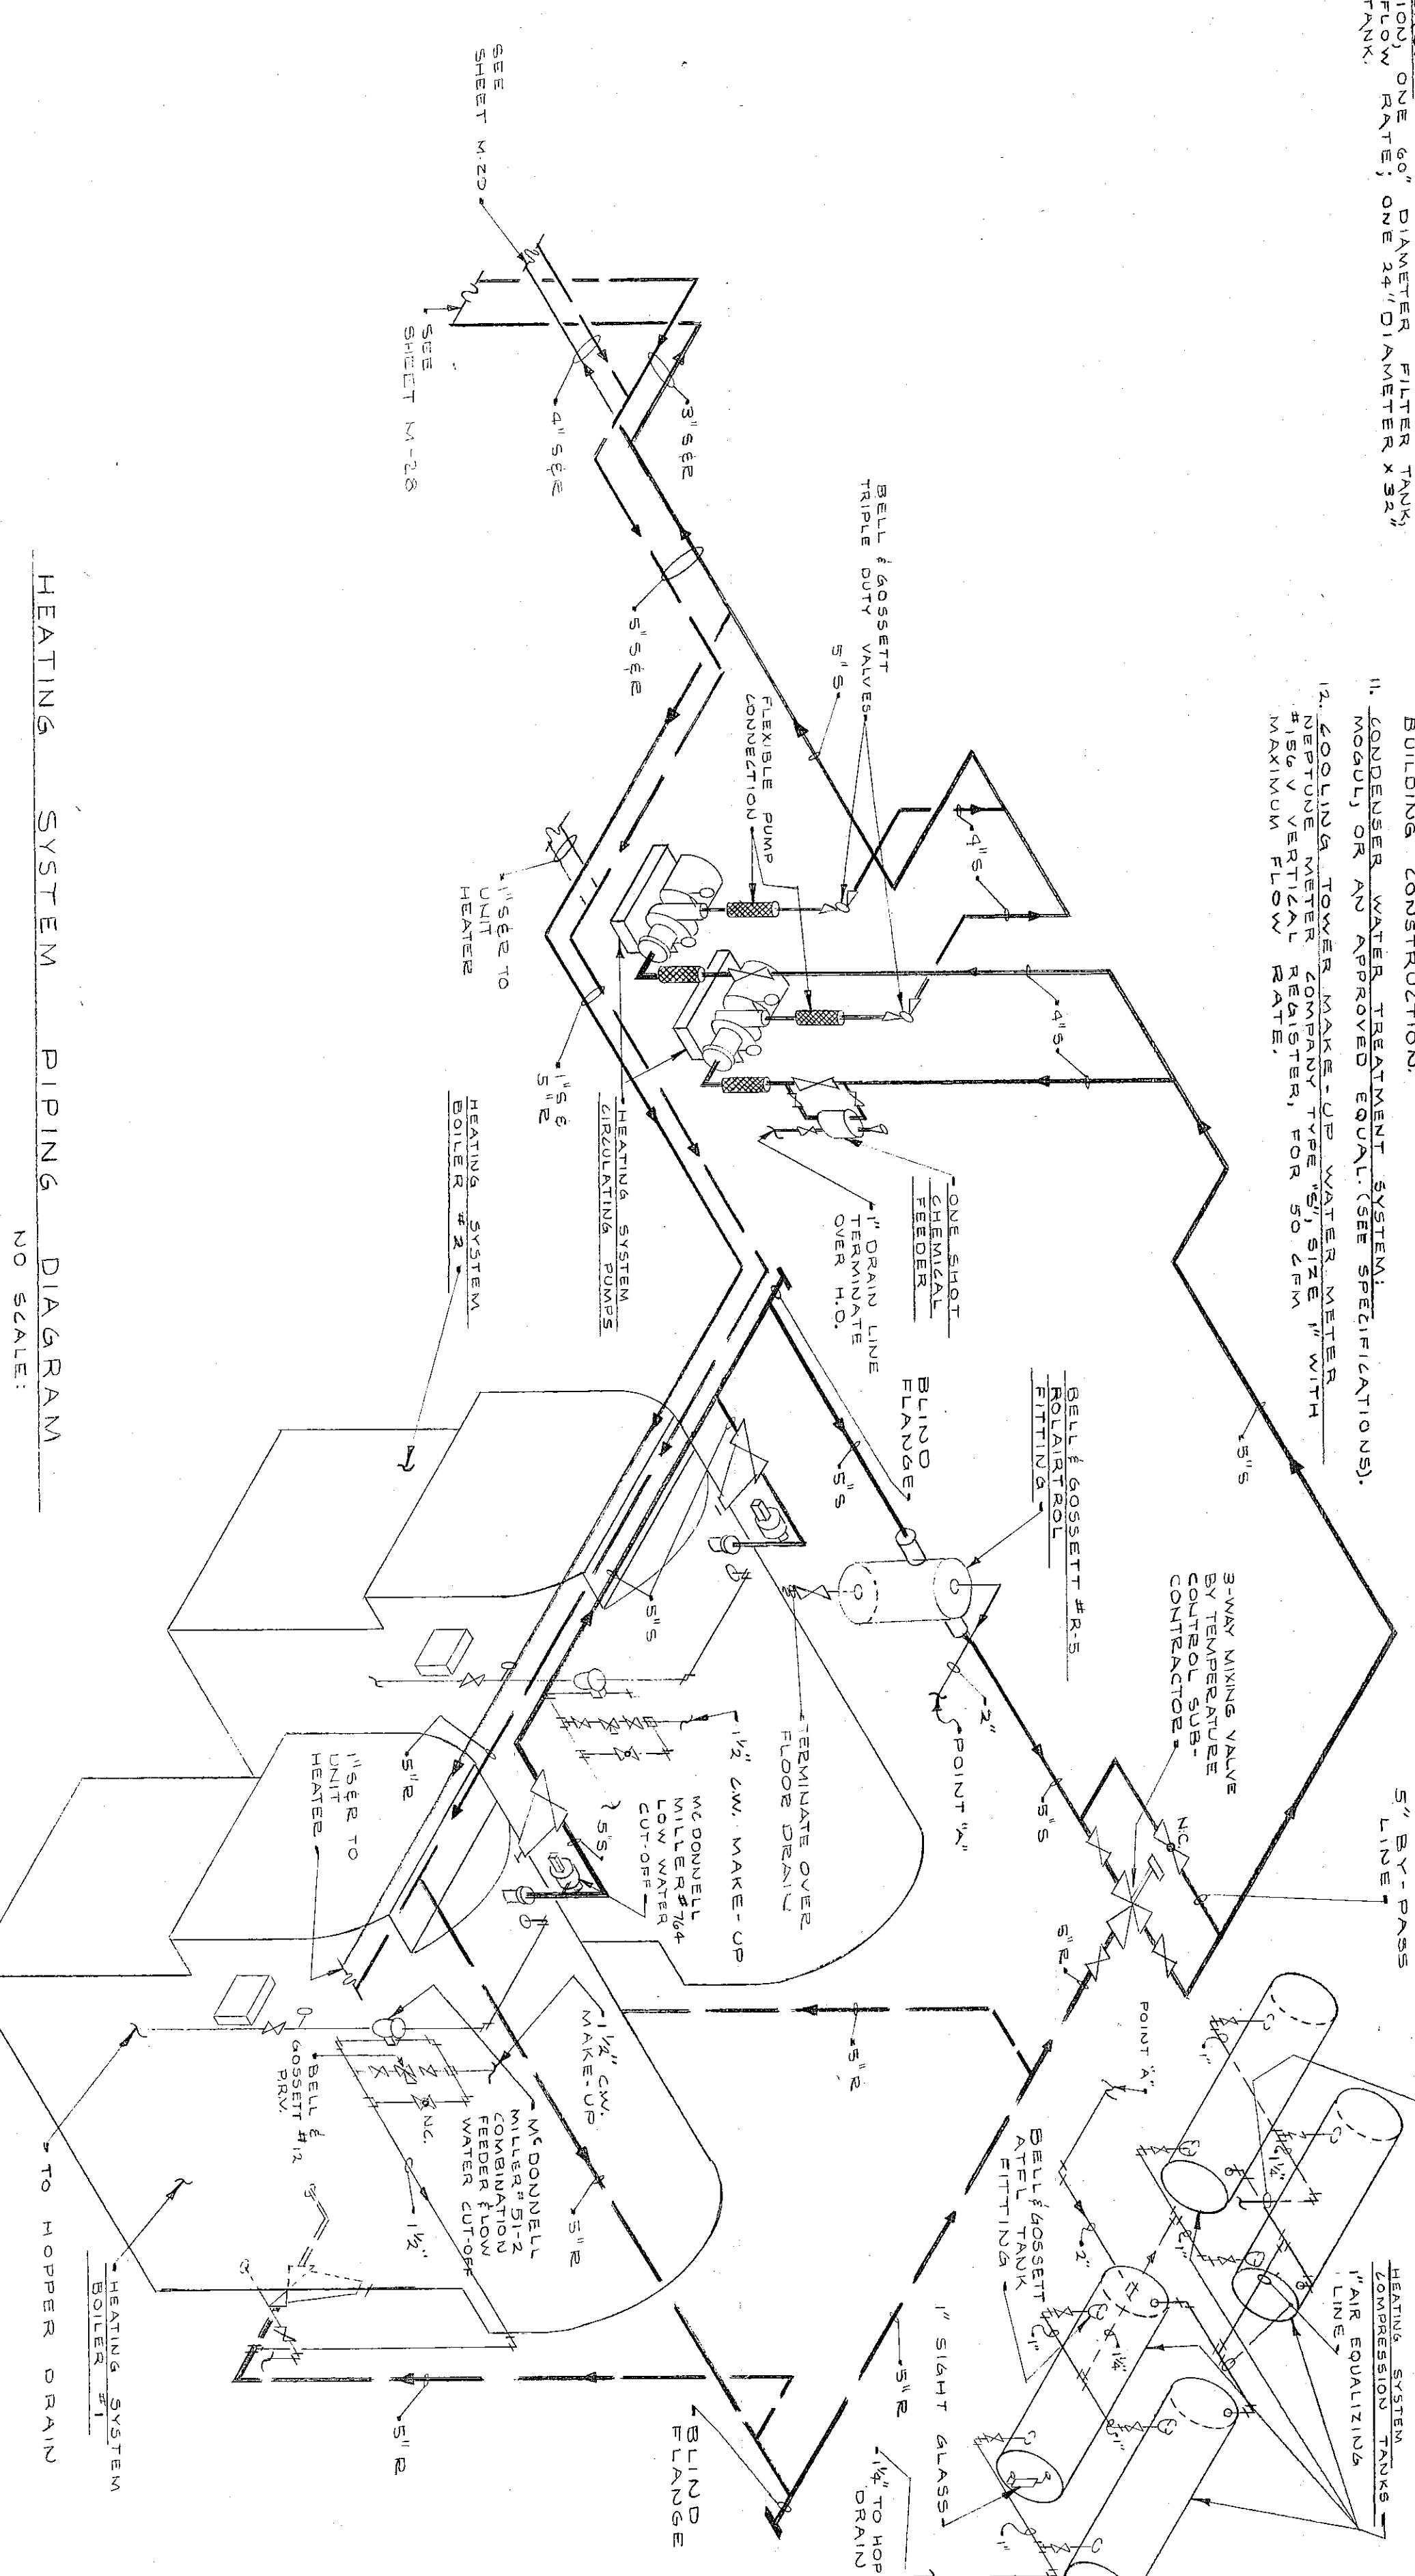

DOMESTIC WATER PIPING SCHEMATIC

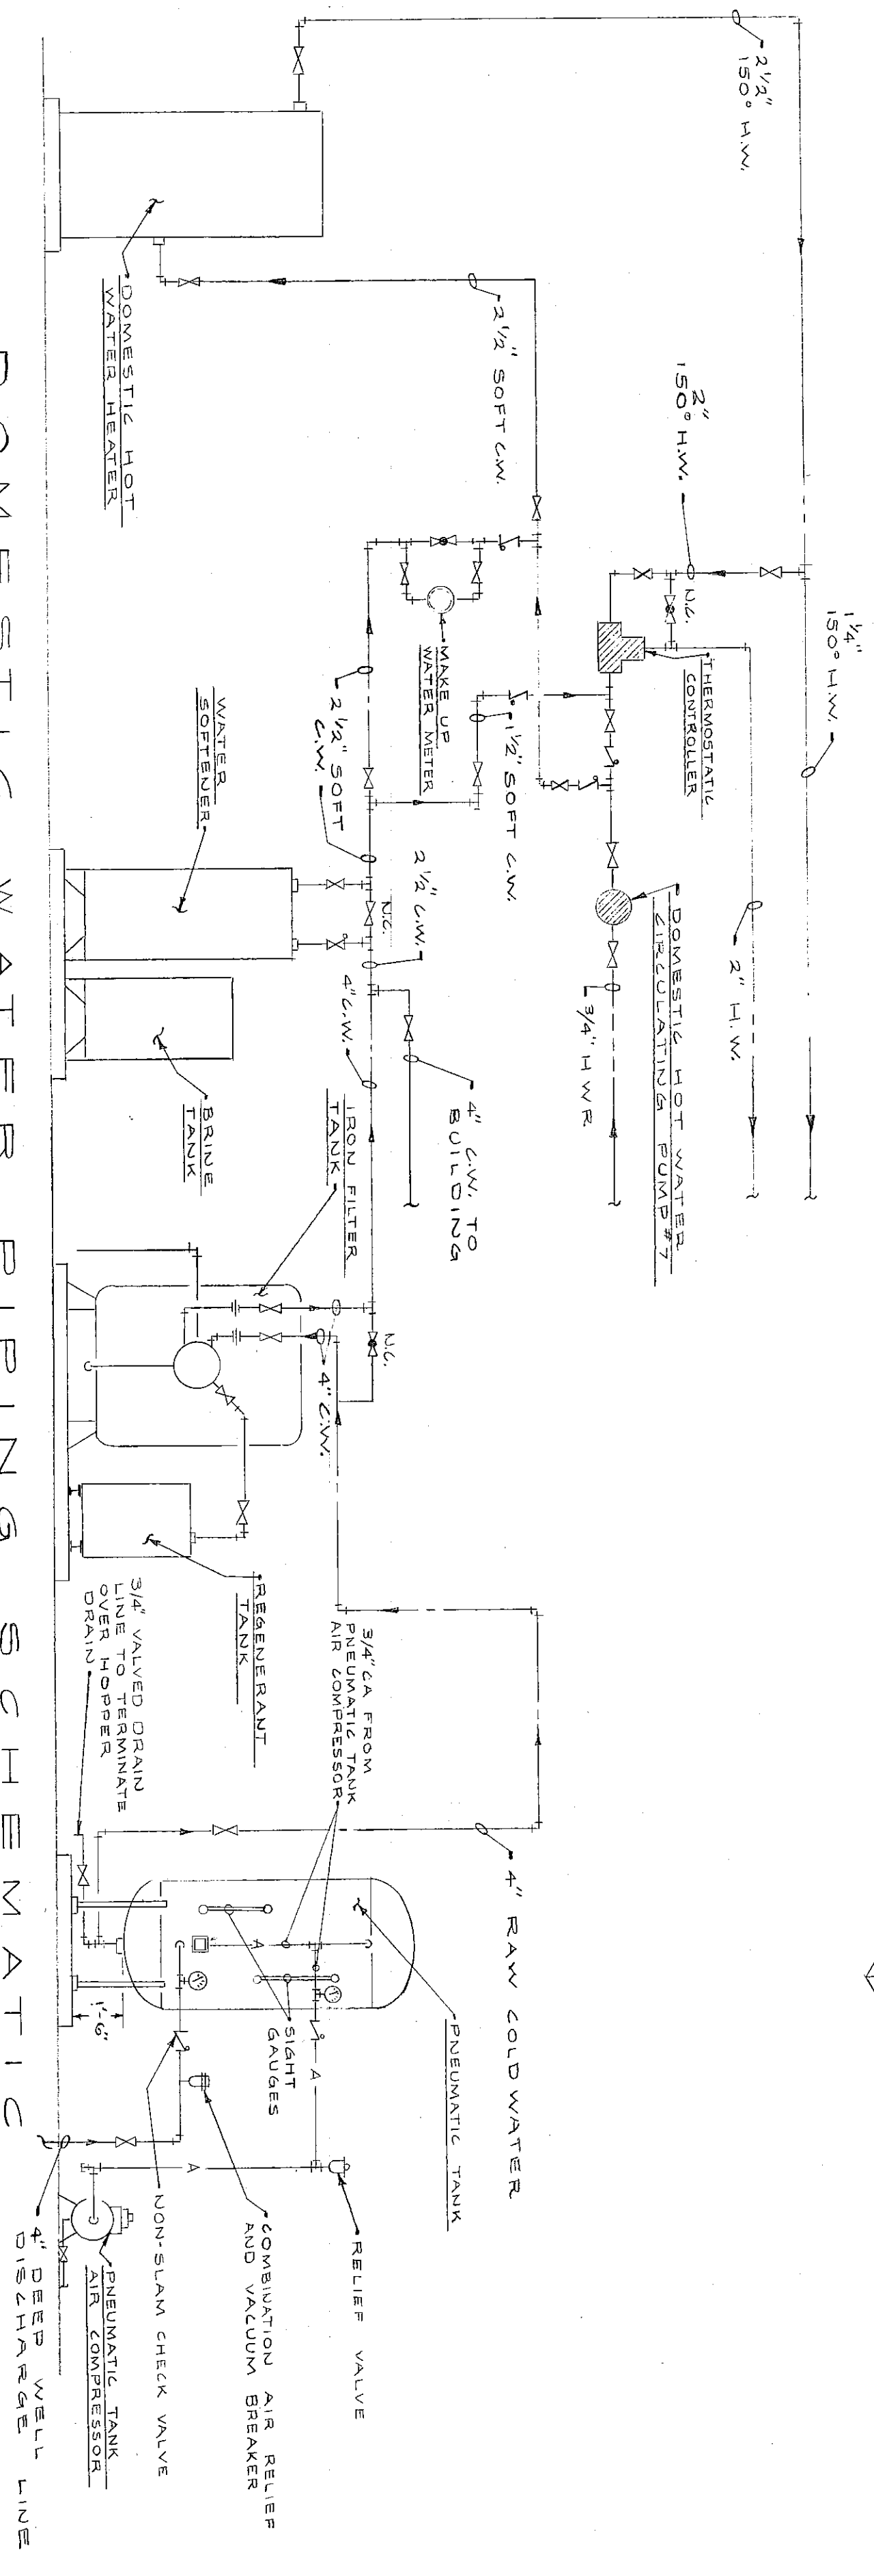

HEATING SYSTEM PIPING NO. 30

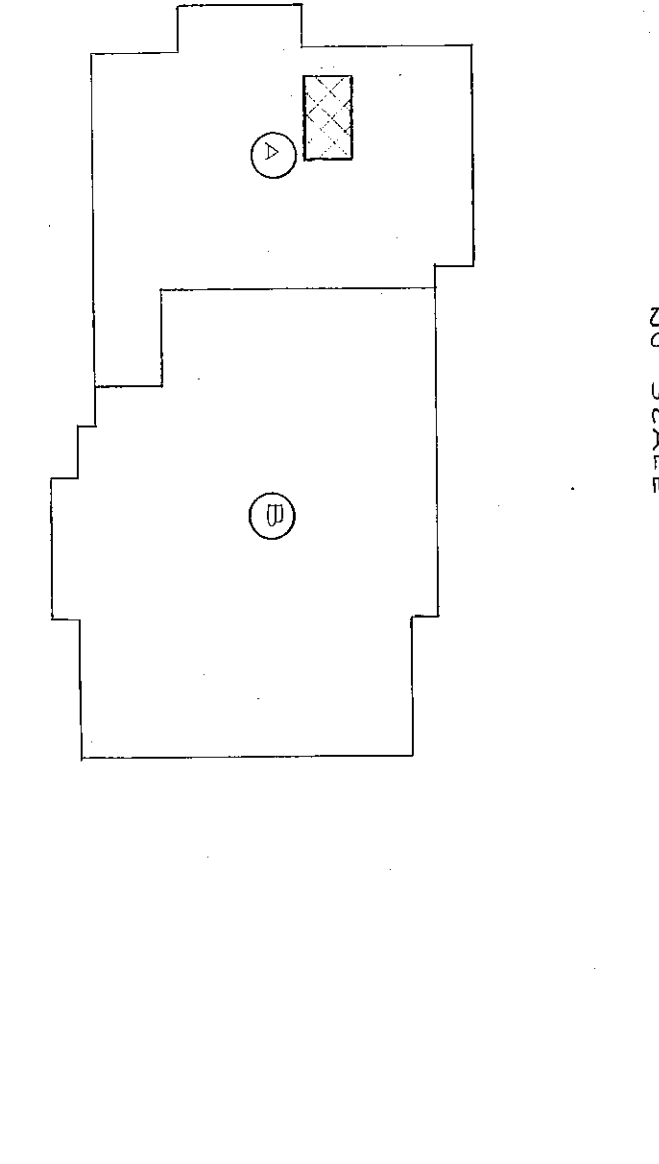

BOILER ROOM KEY PLAN