

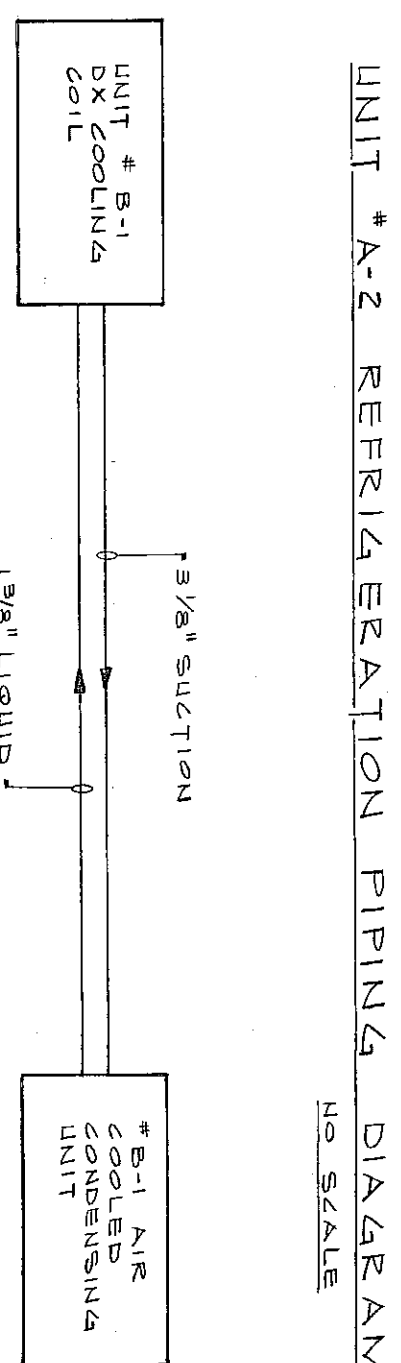
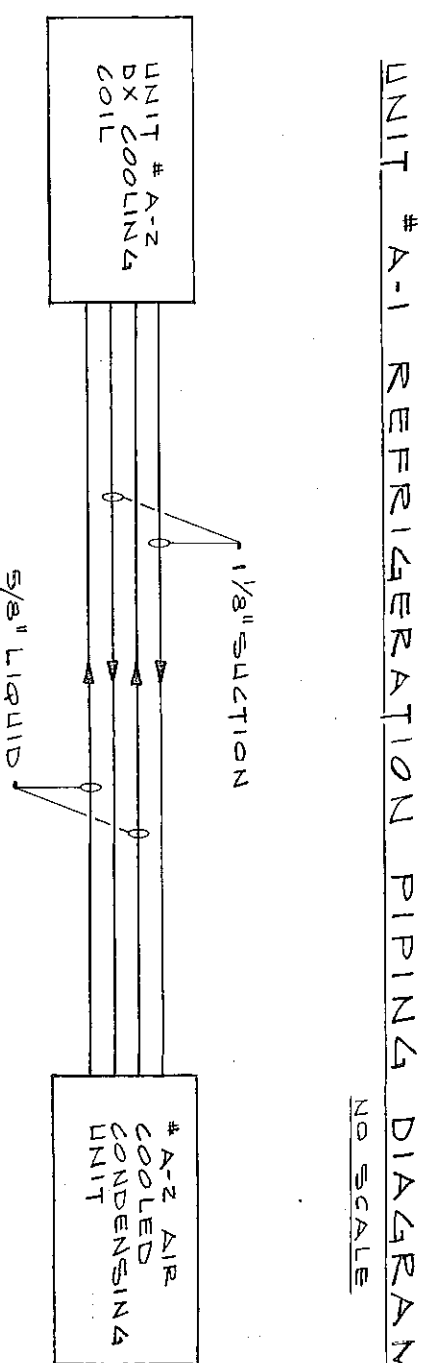


4. THE MECHANICAL CONTRACTOR SHALL VERIFY THE LOCATION OF ALL EXISTING UNDERGROUND PIPING AND ADJUST HIS WORK TO MAINTAIN THE EXISTING PIPING TO REMAIN IN PLACE AND OPERATE PROPERLY.
5. ALL NEW WASTE LINES AND CONNECTIONS TO EXISTING SEWER SHALL BE INSTALLED IN ACCORDANCE WITH THE CITY OF CHICAGO DEPARTMENT OF PUBLIC WORKS SPECIFICATIONS.
6. THE GENERAL CONTRACTOR WILL MAINTAIN ALL EXISTING OPERATION DURING THE CONSTRUCTION PERIOD.

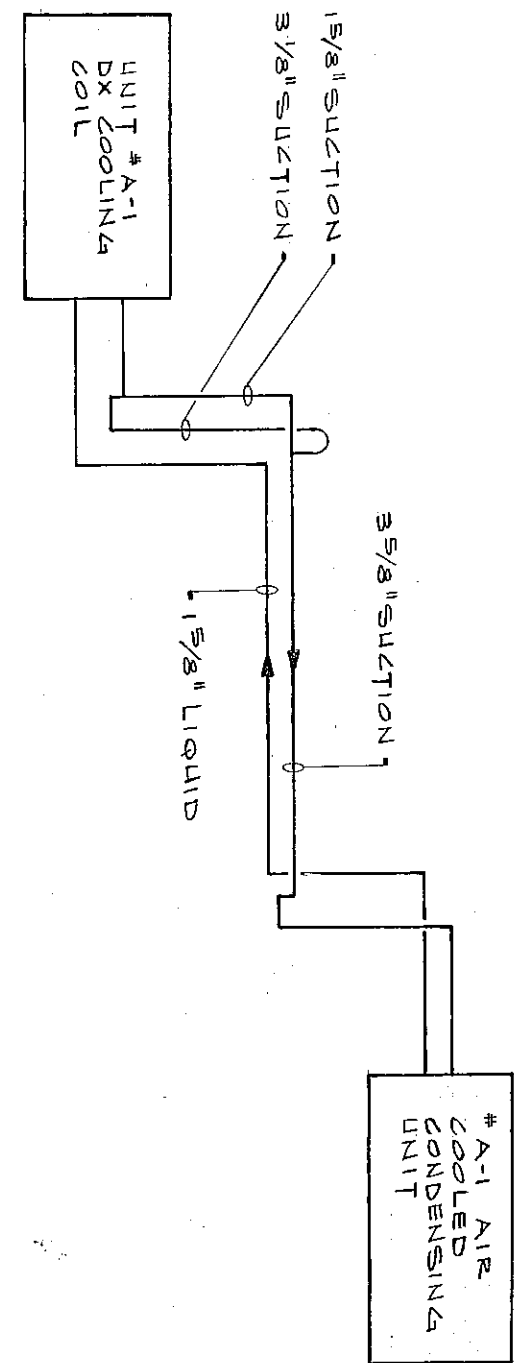

UNIT B-1 REFRIGERATION PIPING DIAGRAM
NO SCALE

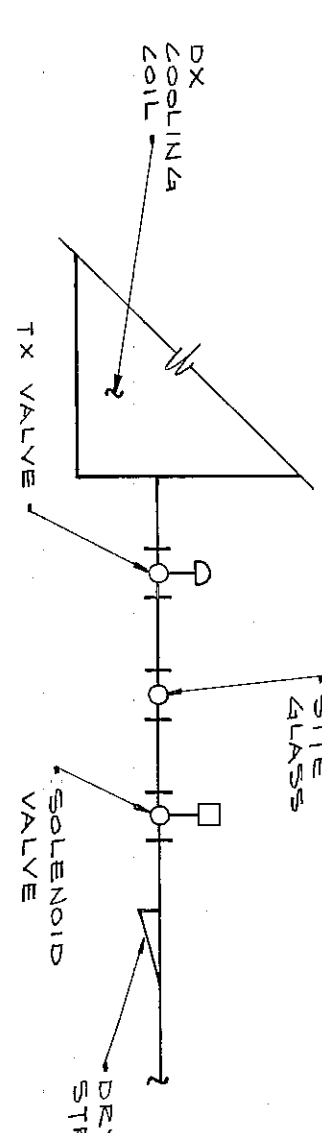

NOTES:
1. ALL REFRIGERATION LINES DOWN 1" PER 10' IN
2. DIRECTION OF FLOW

