



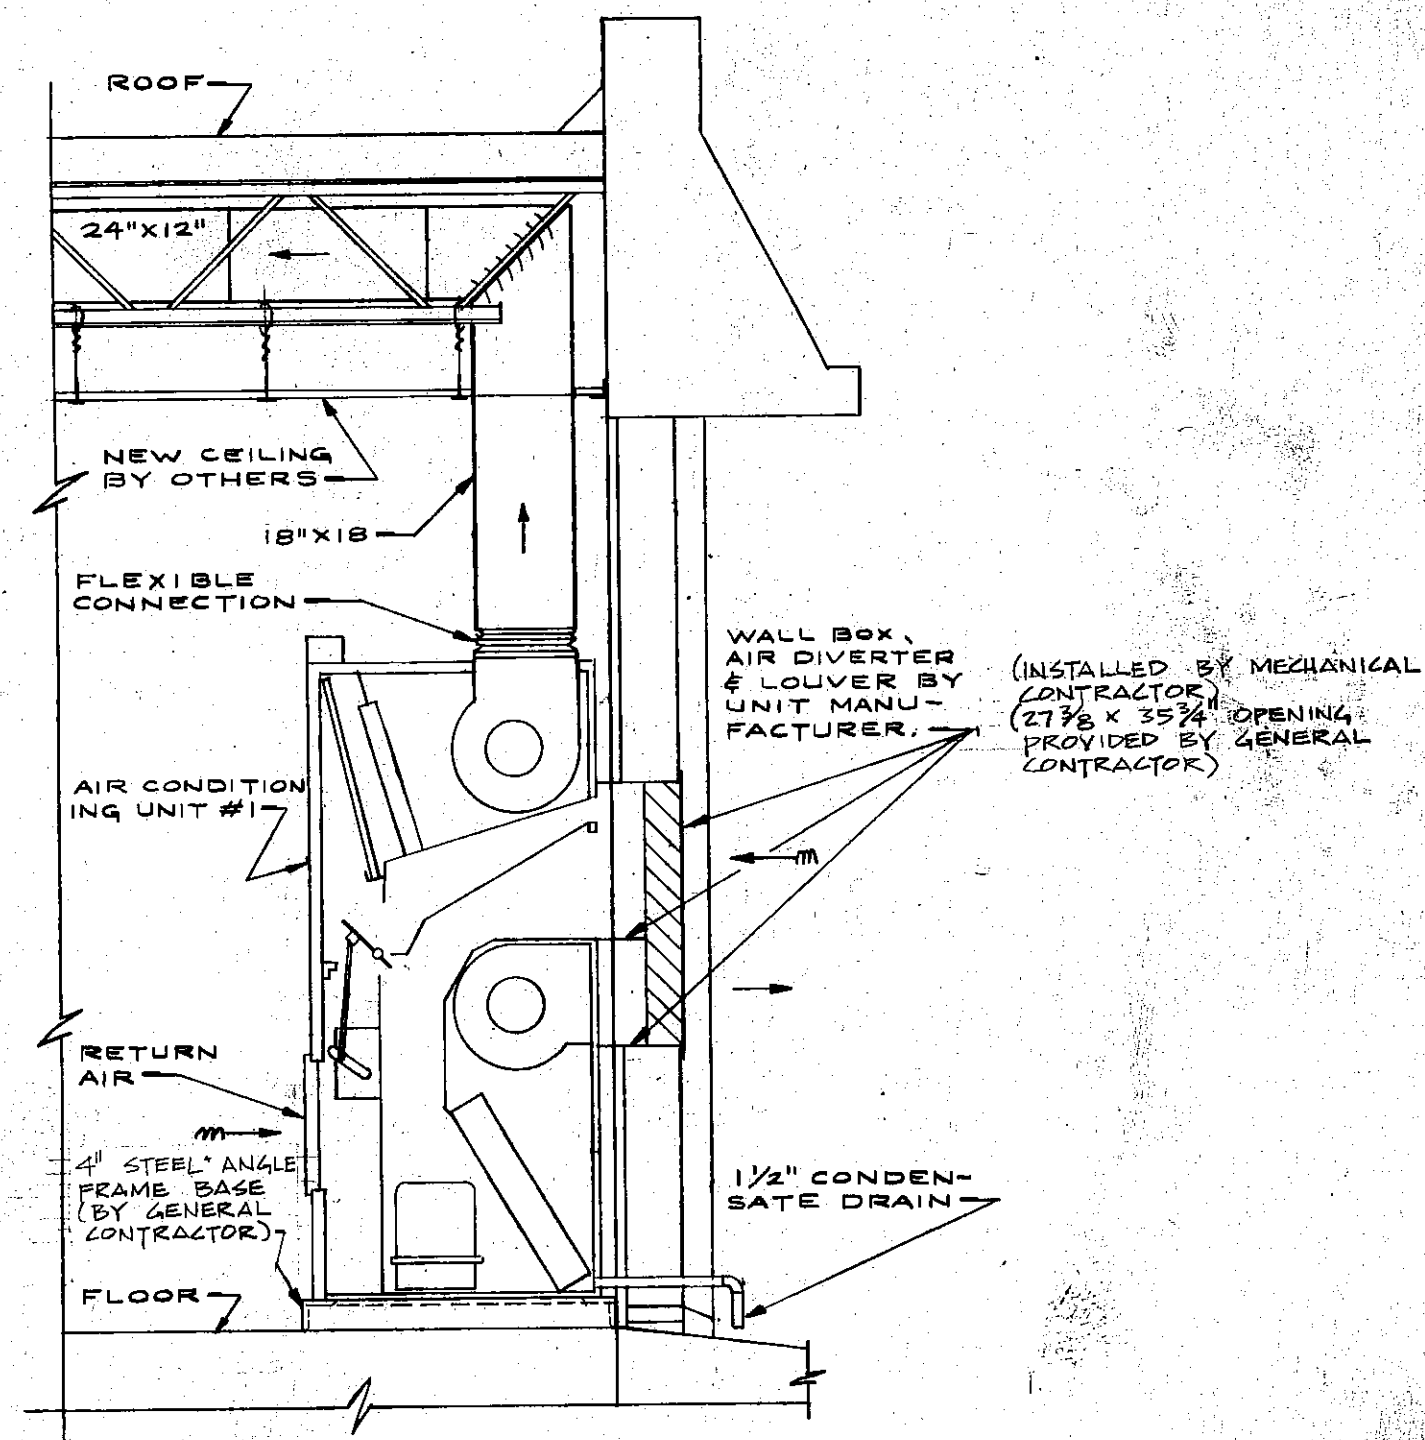


SECTION "A-A"

MECHANICAL PLAN NOTES


- M-1 See Sheet 16 for general notes and legends.
- M-2 Air Conditioning Unit #1 - EDPAC Model SA-6 vertical unit air conditioner, cooling only. 1800 cfm, 20% minimum outdoor air capacity 64.2 MBH, compressor 6 HP, blower 3/4 condenser/exhaust blower 3/4 HP. All motors shall be 200 volt, 3 phase, 60 hertz.
- M-3 All rectangular ducts shall be lined with 1" fiberglass.
- M-4 ALL MECHANICAL WORK ON THIS SHEET SHALL BE BID IN CONTRACT # 7

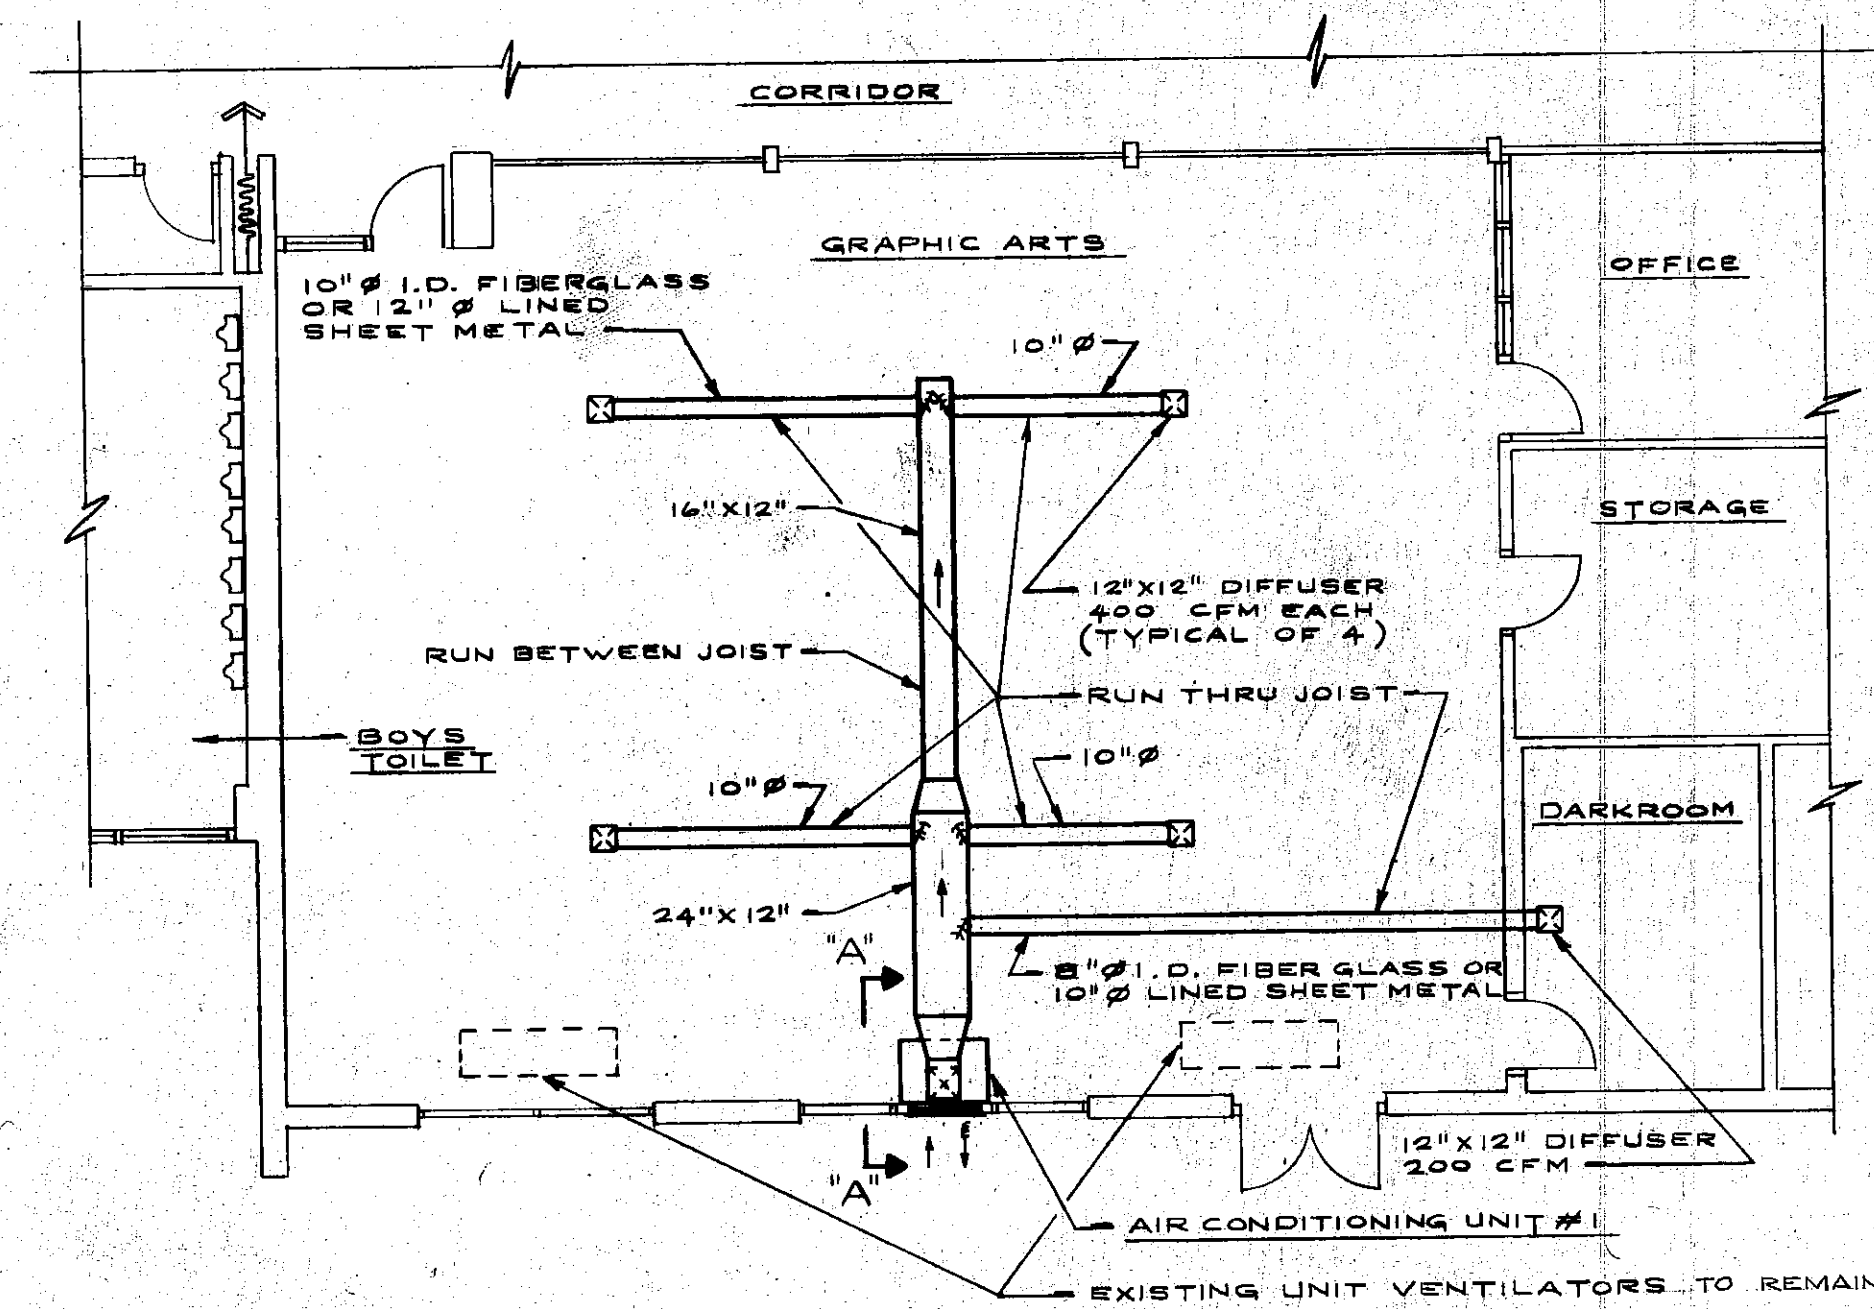


AIR CONDITIONING PLAN OF OF GRAPHIC ARTS ROOM

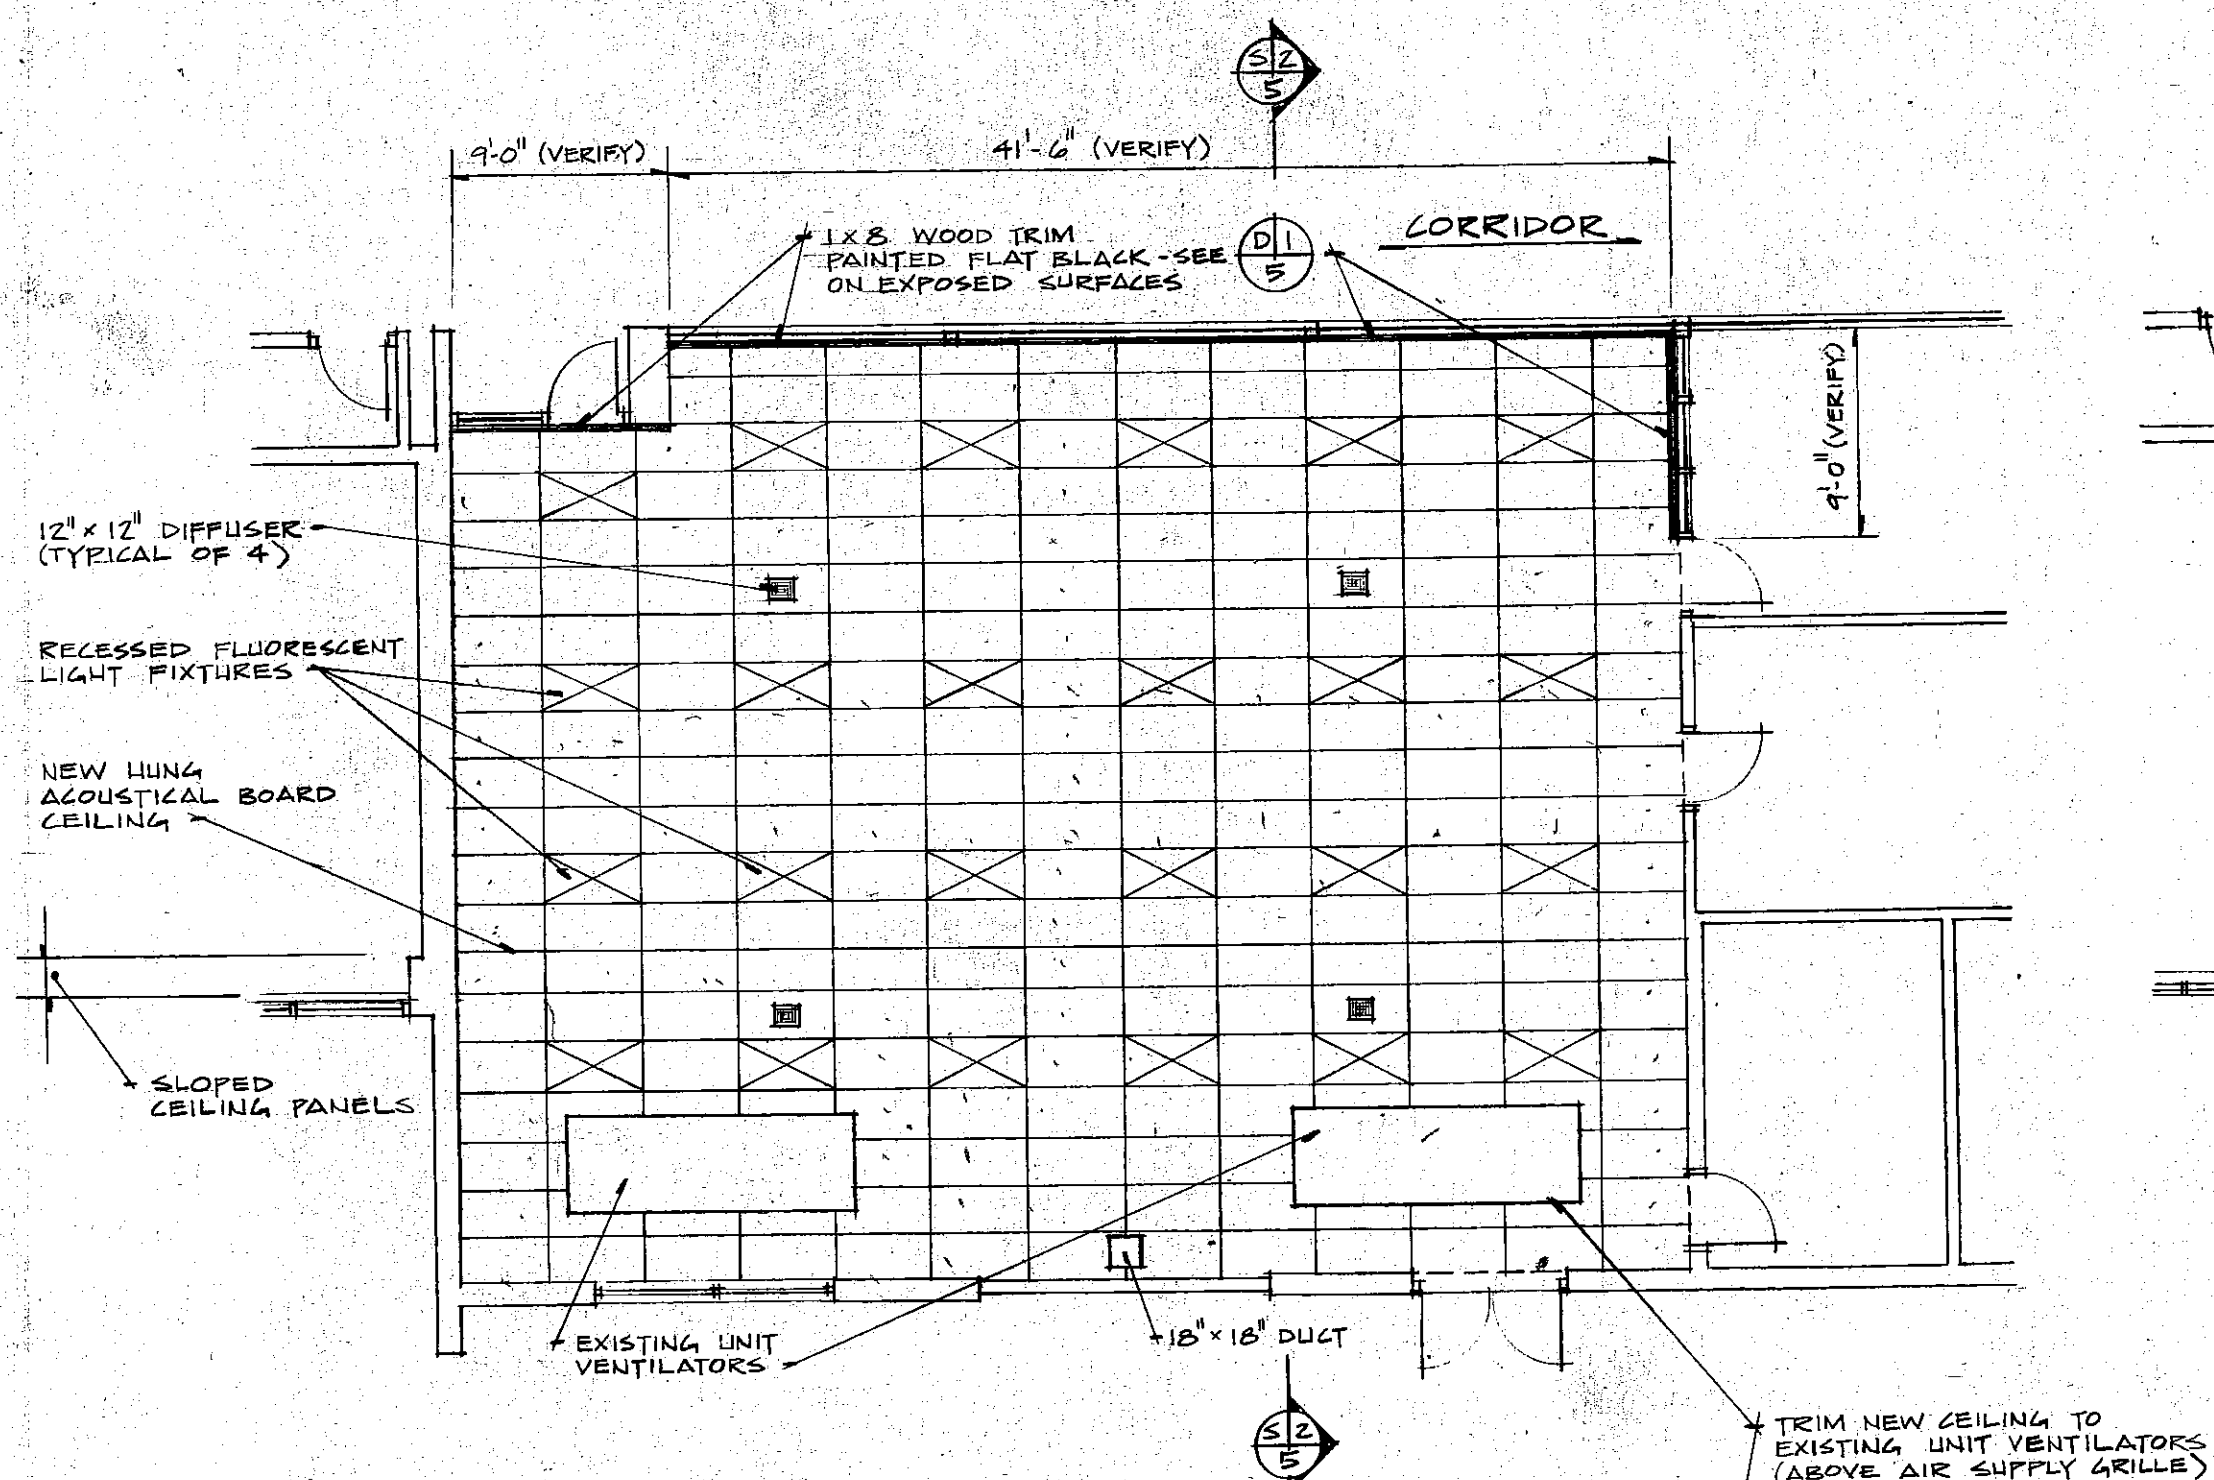


REFLECTED CEILING PLAN

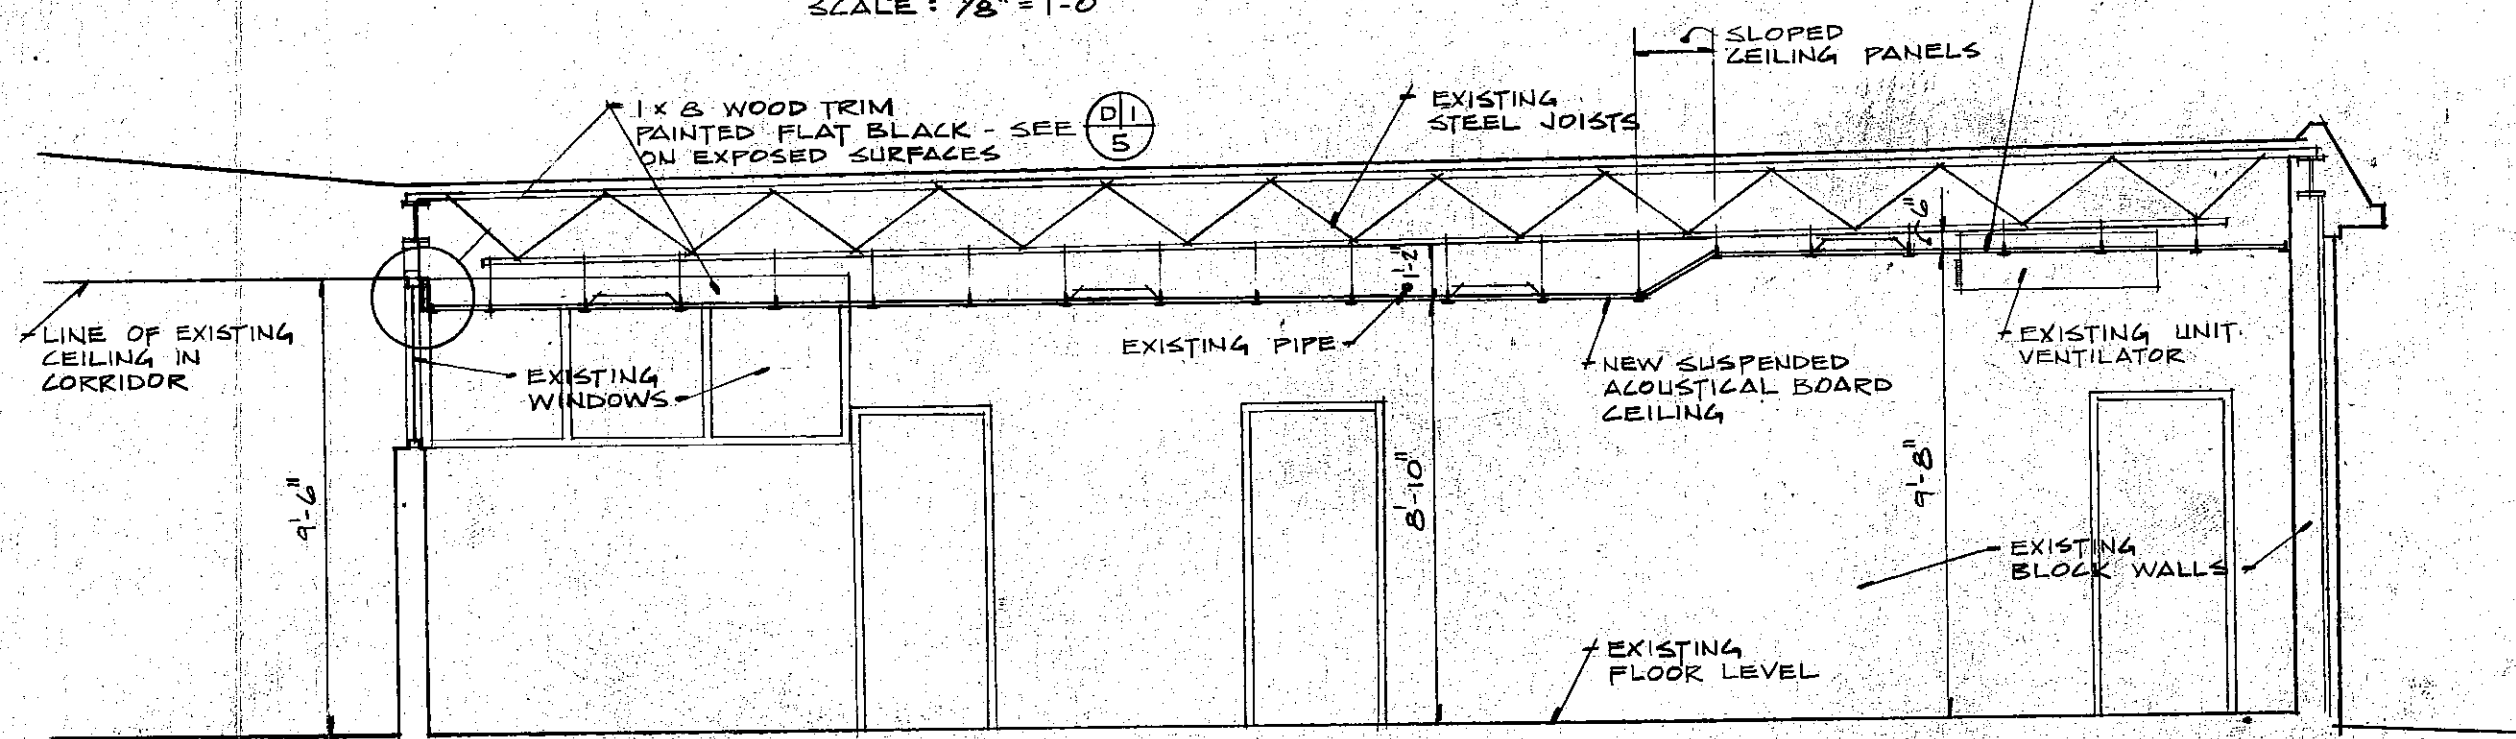


SECTION

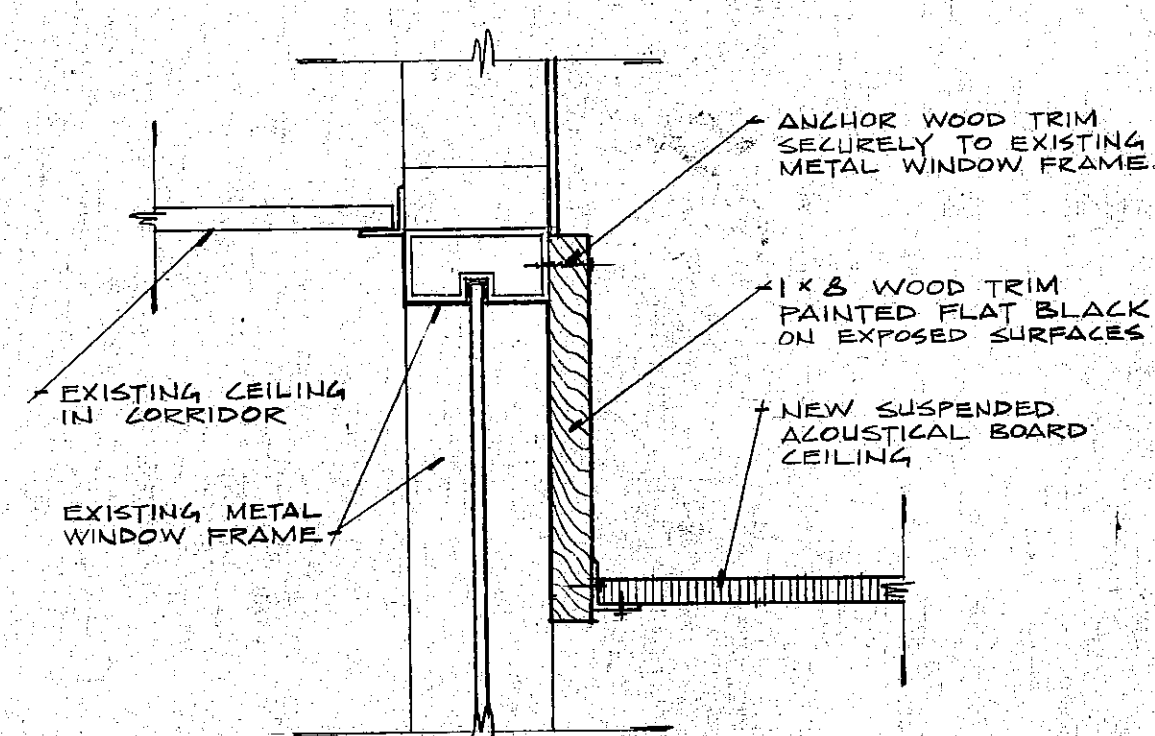


DETAIL

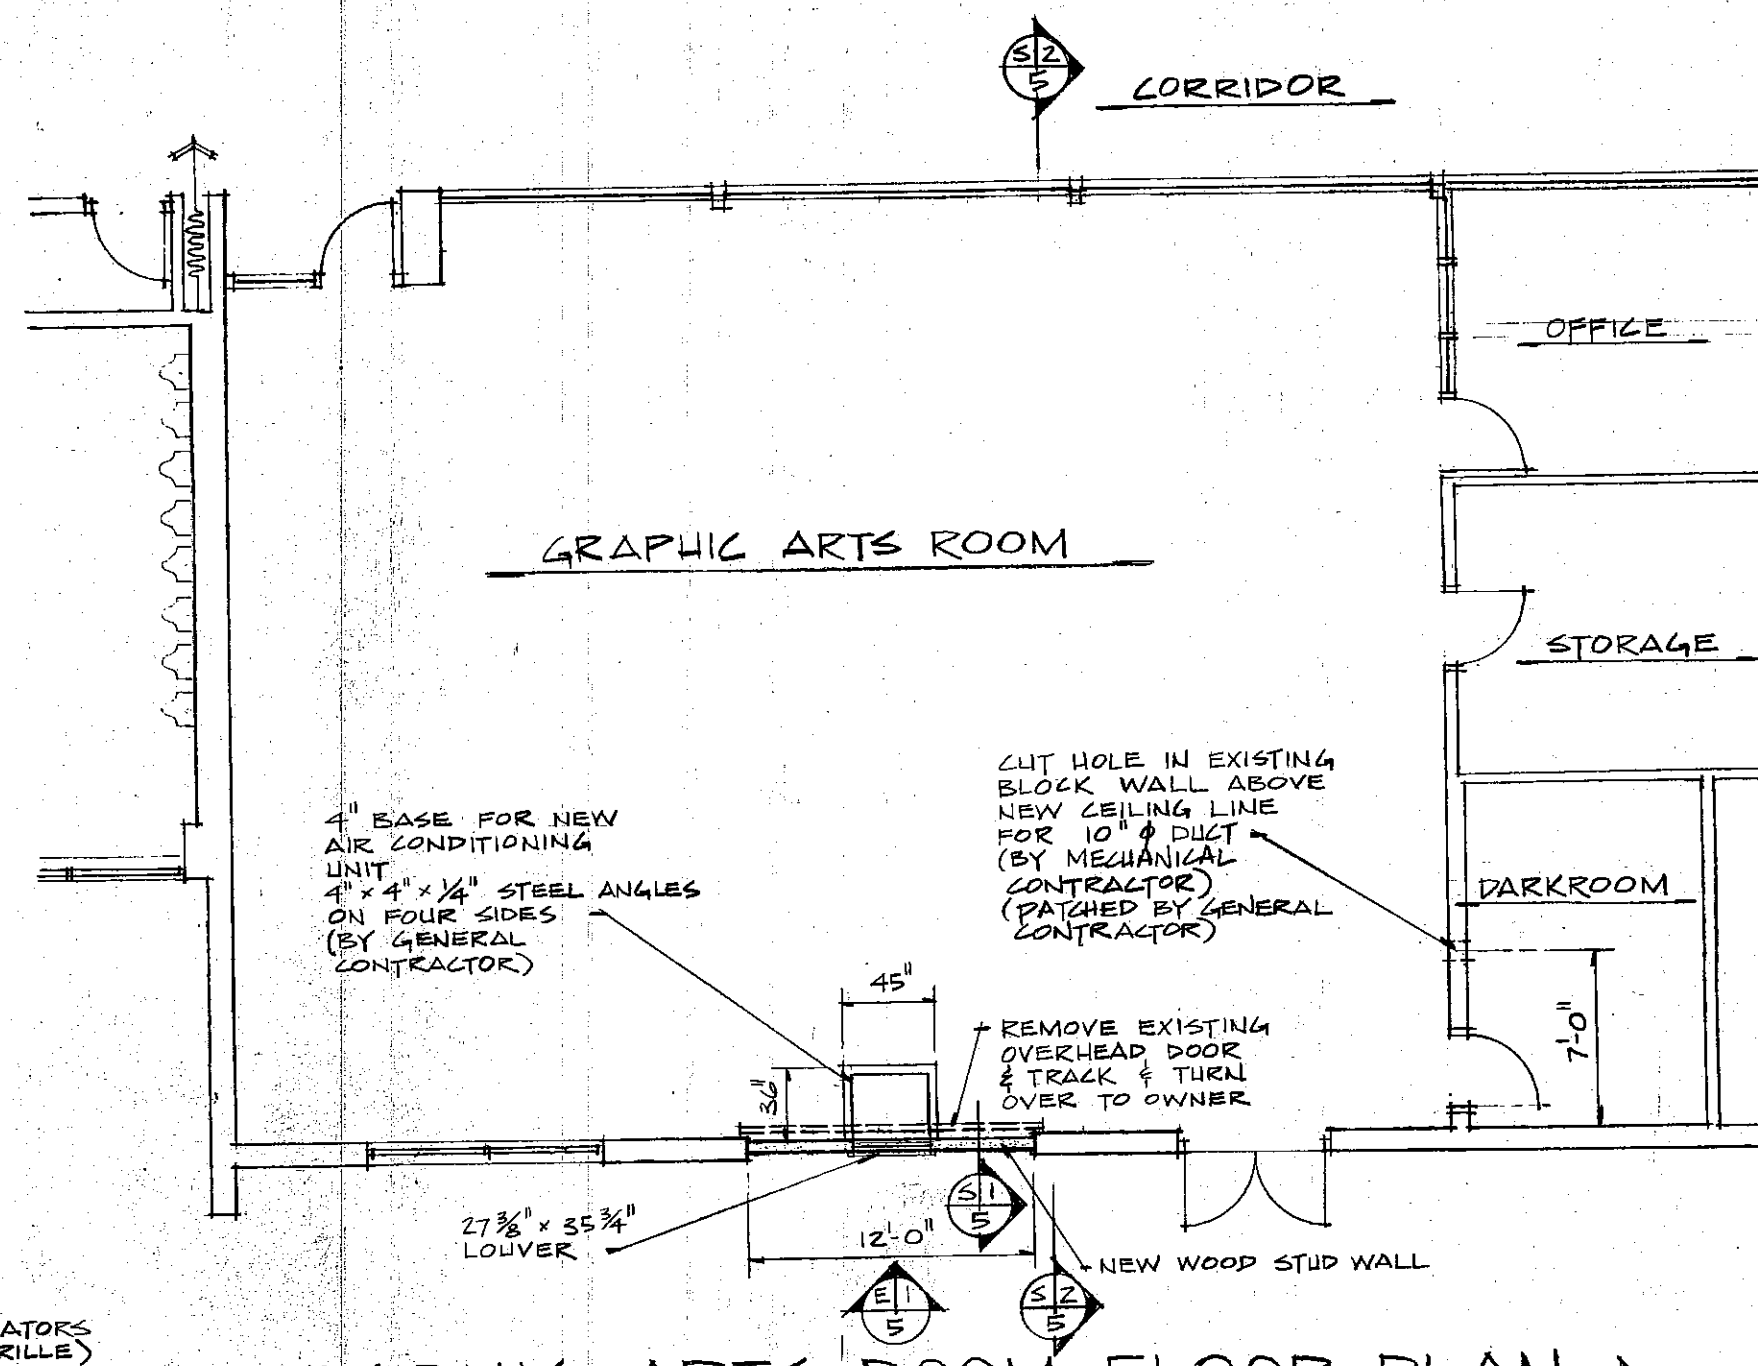

GRAPHIC ARTS ROOM FLOOR PLAN

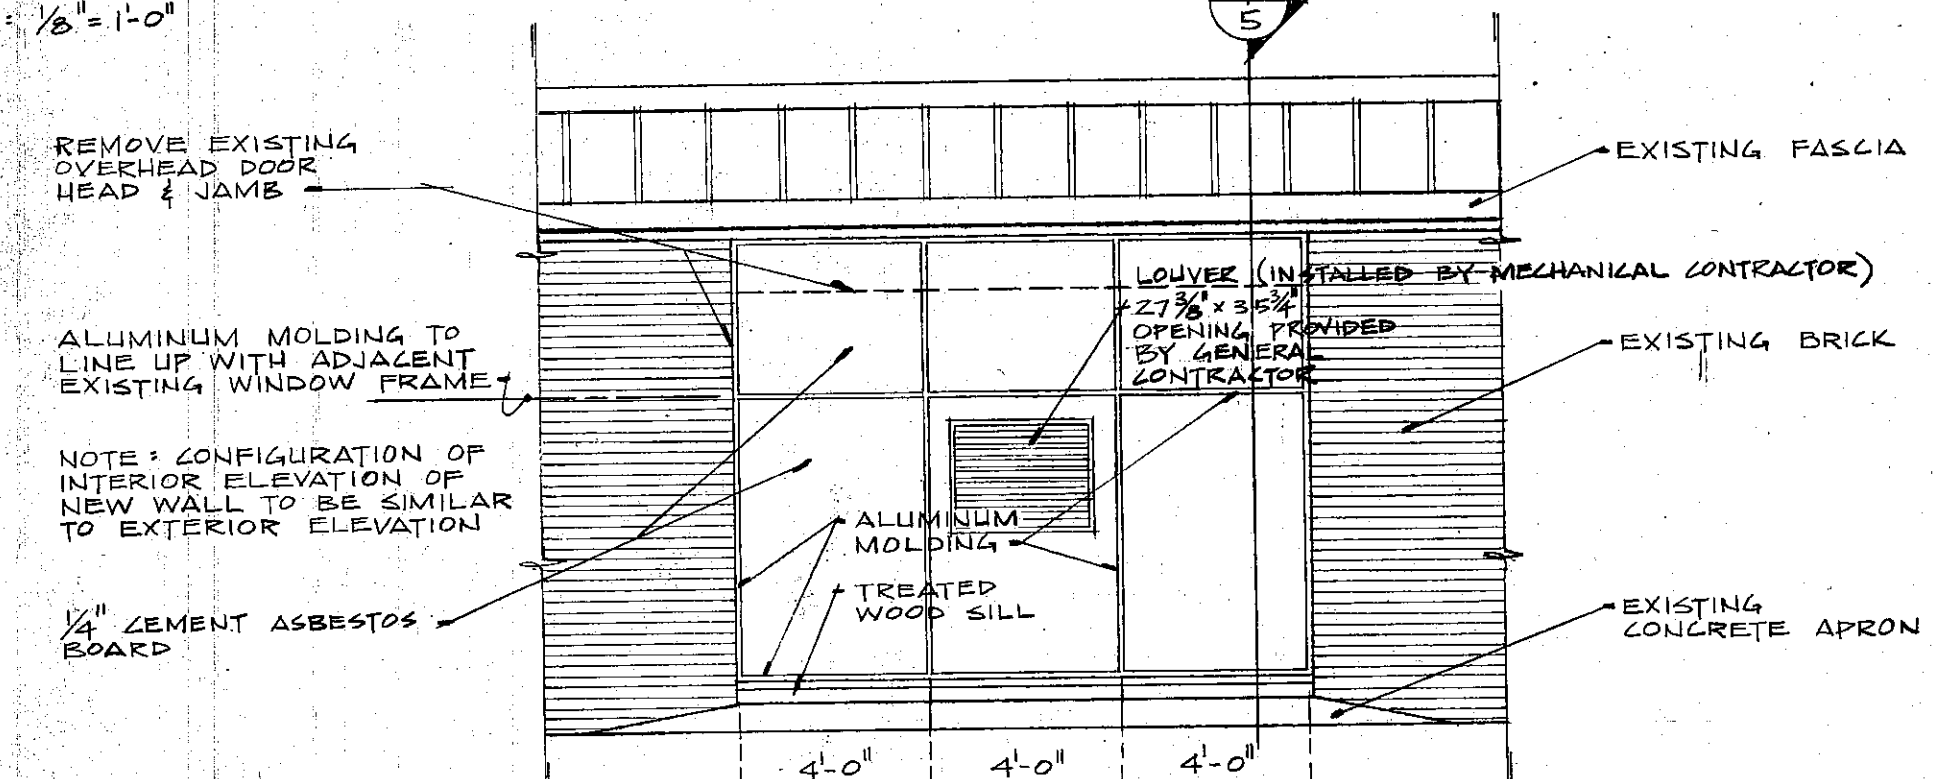

ELEVATION

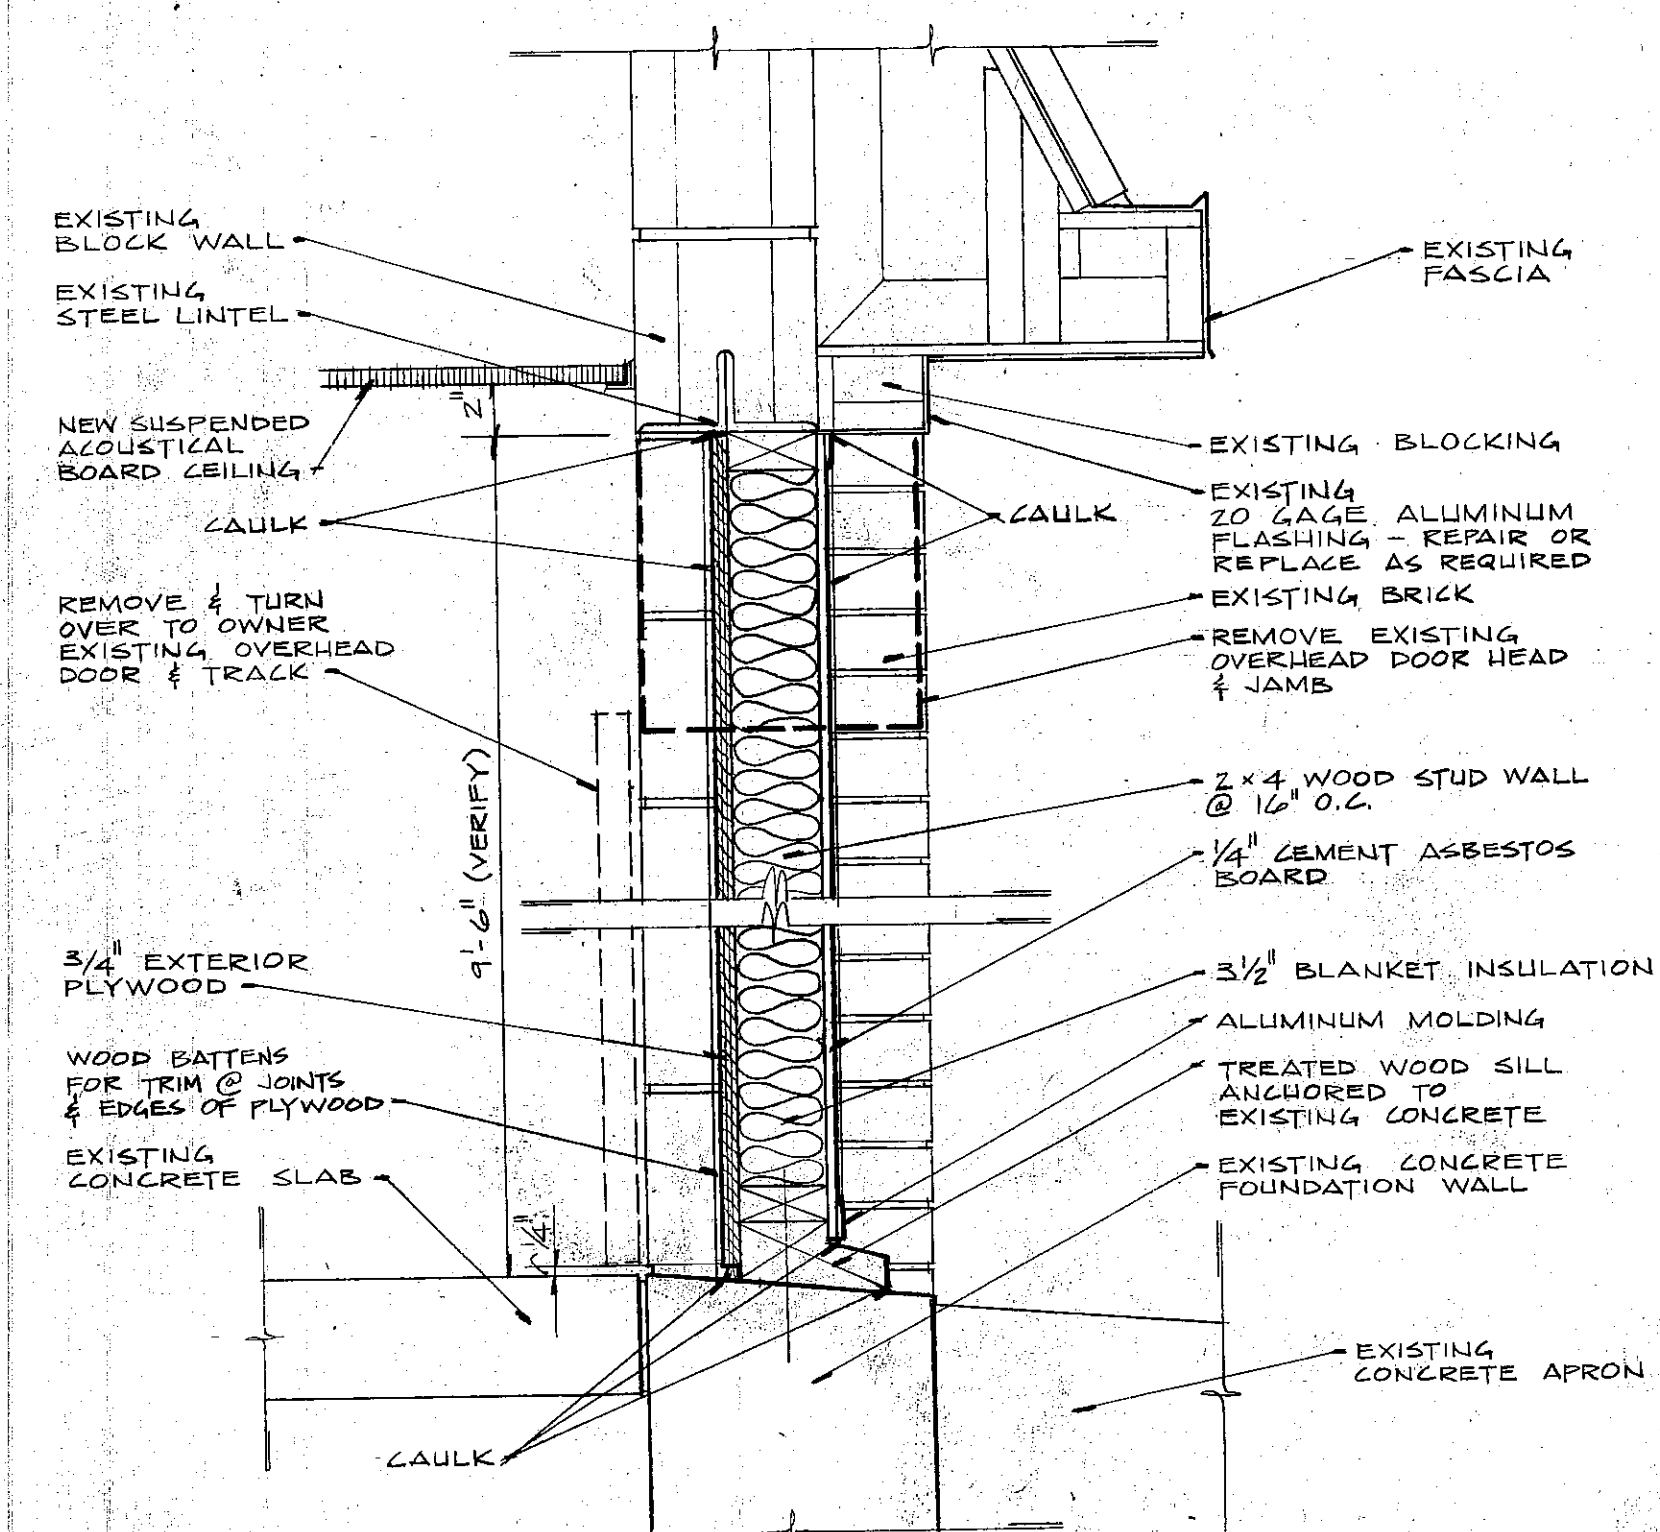

SECTION



EVERETT · I · BROWN COMPANY ARCHITECTS
ENGINEERS
· INDIANAPOLIS, INDIANA · 46241
· PARK FLETCHER ·
5500 WEST BRADBURY AVENUE ·
MISCELLANEOUS REMODELING TO THE EXISTING CHESTERTON SENIOR HIGH SCHOOL

PROJECT	2575	NO.	5
DATE	APRIL 12, 1976	OF	20
REVIS			

76-1-03