





YOST ELEMENTARY
FIRST FLOOR PLAN
NO SCALE

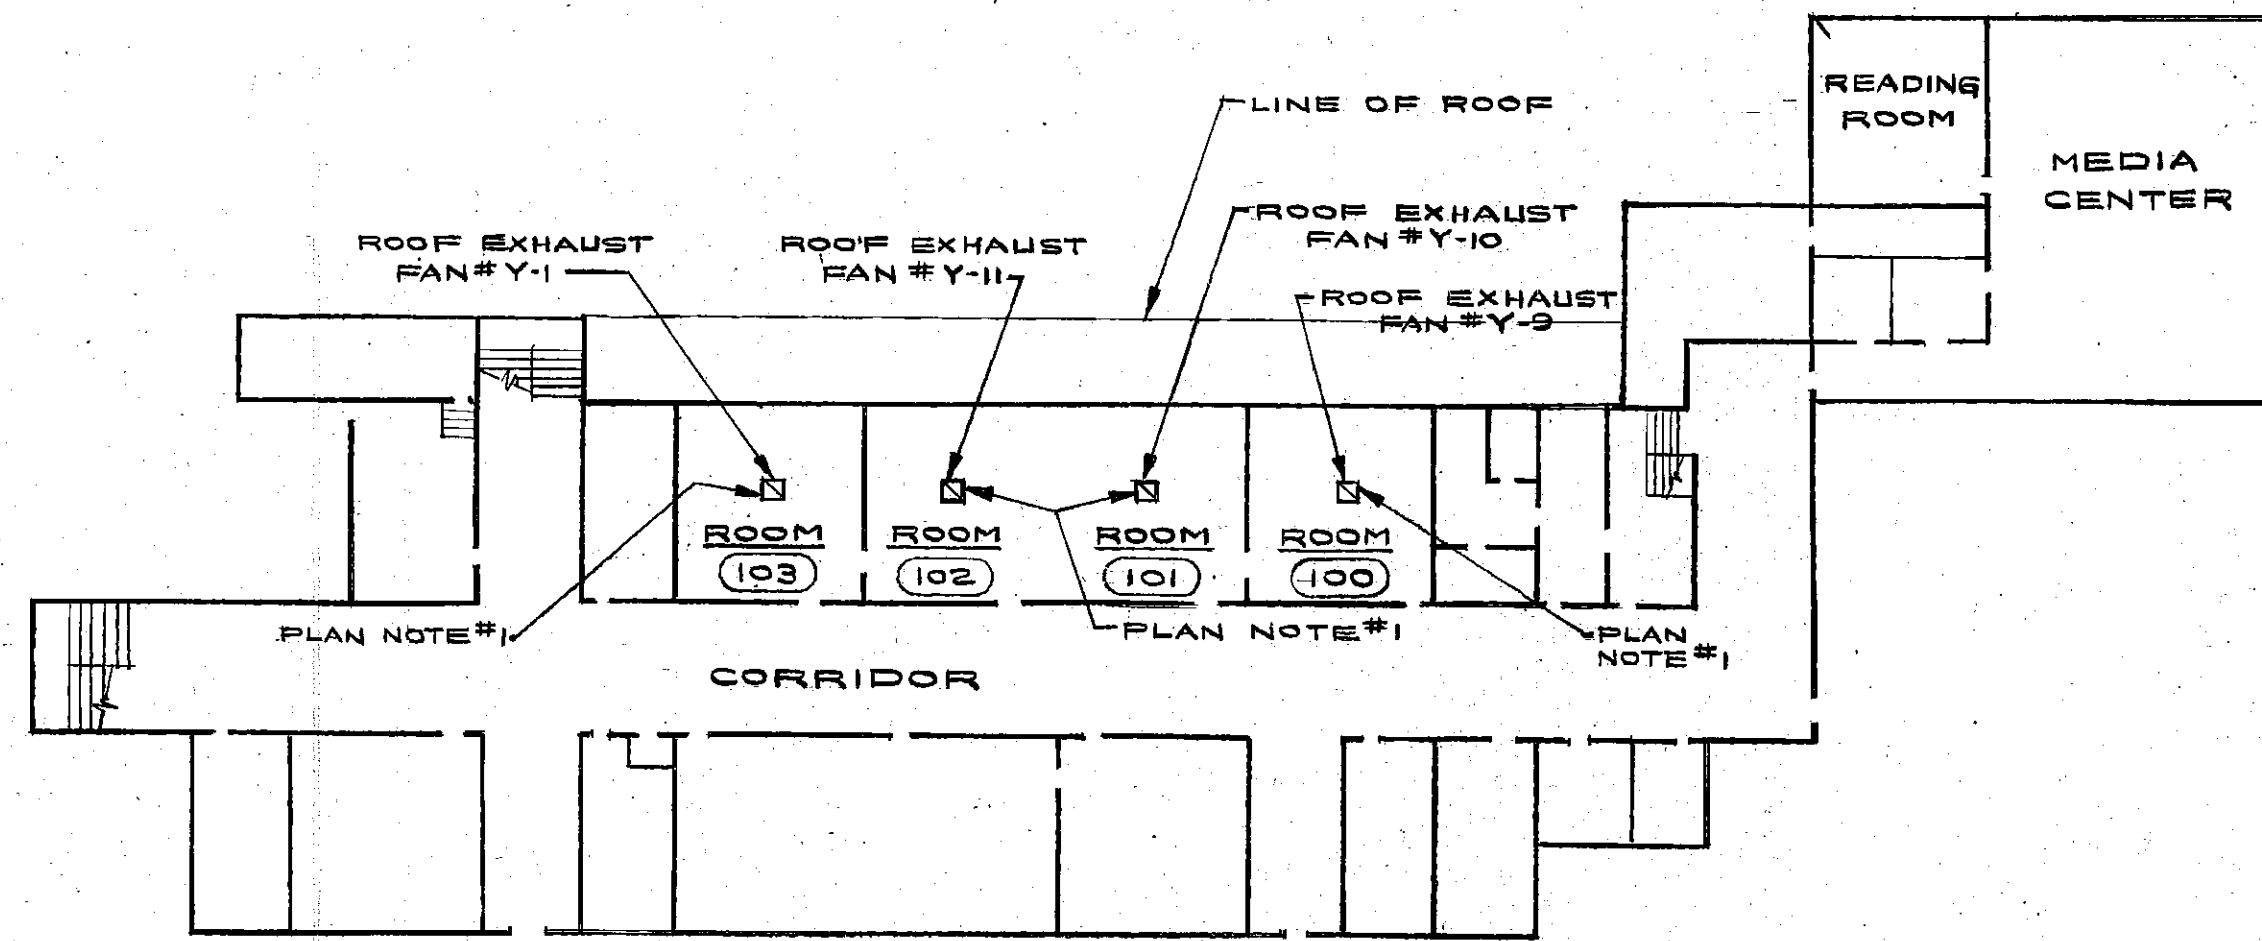

YOST ELEMENTARY
GROUND FLOOR PLAN
NO SCALE

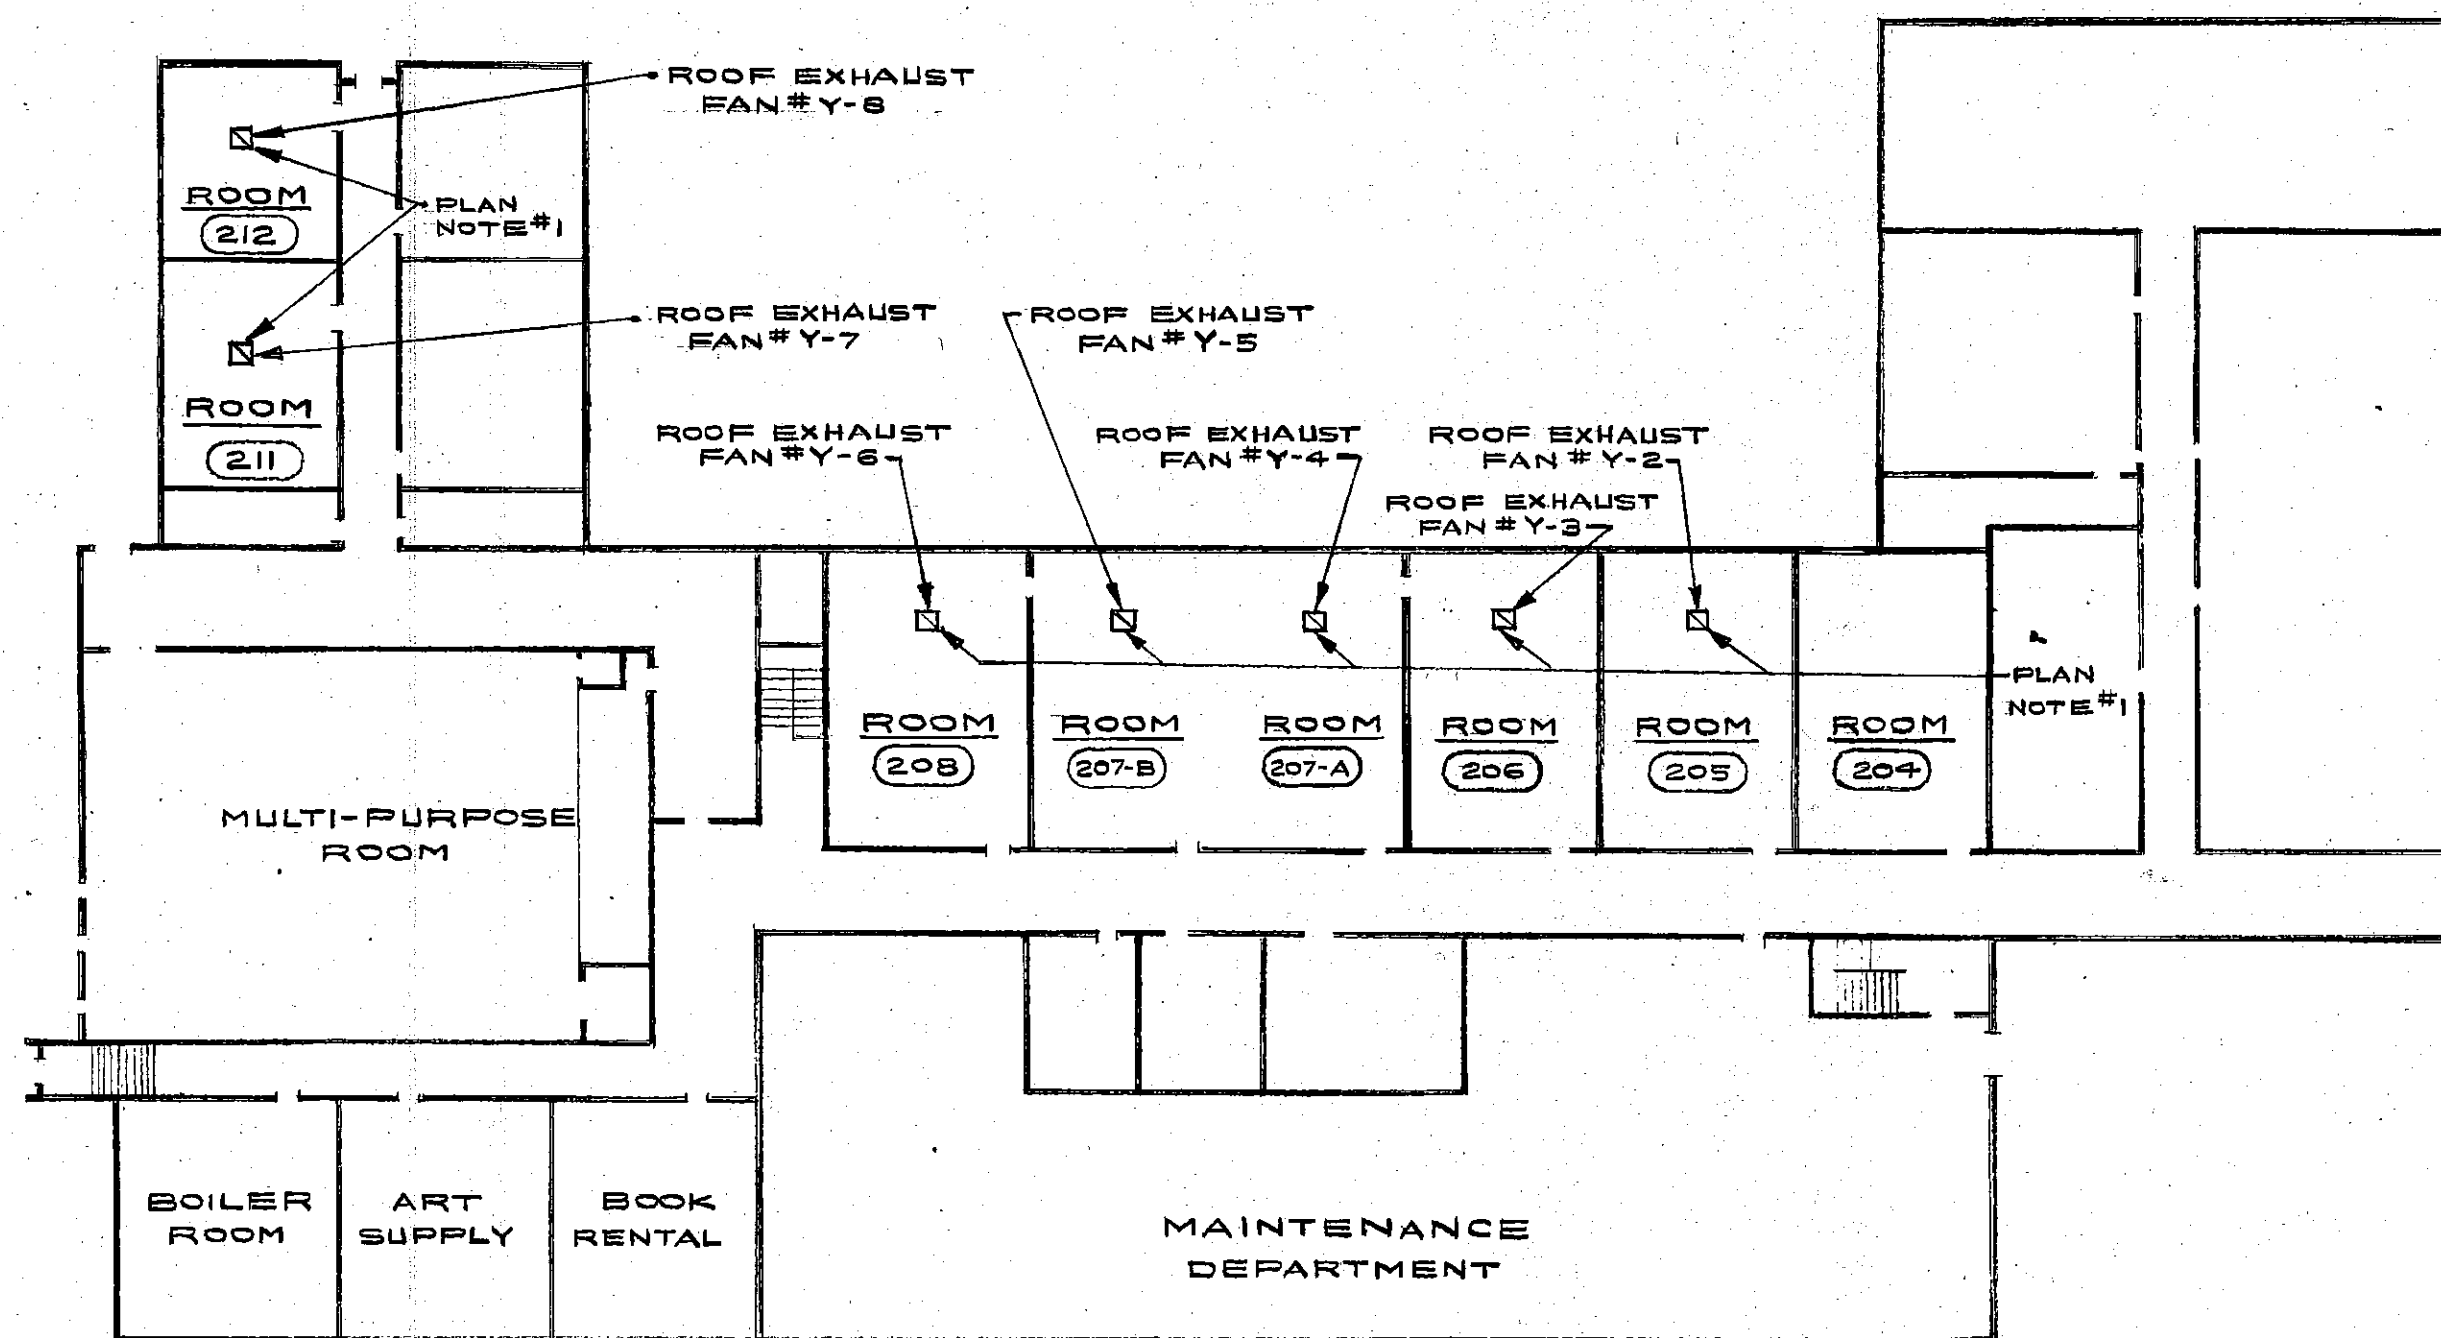

PLAN NOTES


1. 18" x 12" exhaust grille in ceiling with an 18" x 12" duct up to a 12" x 12" duct at roof. Install exhaust grille in ceiling avoiding existing lights, speakers, etc.
2. Ventilating Contractor shall cut necessary holes in the roof to accommodate the new exhaust fan curbs.

EXHAUST FAN SCHEDULE												
NO.	AREA EXHAUSTED	JENN AIR MODEL NUMBER	BACK-DRAFT DAMPER	C.F.M.	S.P. OF W.C.	MOTOR DATA				POWER CIRCUIT	CONTROL	SEE NOTE
						R.P.M.	H.P.	VOLTS	φ			
Y-1	ROOM #103	144 BCR	12" x 12"	1465	1/4	1200	1/3	115	1	EXISTING PANEL	MANUAL	1
Y-2	ROOM #205	144 BCR	12" x 12"	1465	1/4	1200	1/3	115	1	EXISTING PANEL	MANUAL	1
Y-3	ROOM #206	144 BCR	12" x 12"	1465	1/4	1200	1/3	115	1	EXISTING PANEL	MANUAL	1
Y-4	ROOM #207-A	144 BCR	12" x 12"	1465	1/4	1200	1/3	115	1	EXISTING PANEL	MANUAL	1
Y-5	ROOM #207-B	144 BCR	12" x 12"	1465	1/4	1200	1/3	115	1	EXISTING PANEL	MANUAL	1
Y-6	ROOM #208	144 BCR	12" x 12"	1465	1/4	1200	1/3	115	1	EXISTING PANEL	MANUAL	1
Y-7	ROOM #211	144 BCR	12" x 12"	1465	1/4	1200	1/3	115	1	EXISTING PANEL	MANUAL	1
Y-8	ROOM #212	144 BCR	12" x 12"	1465	1/4	1200	1/3	115	1	EXISTING PANEL	MANUAL	1
Y-9	ROOM #100	144 BCR	12" x 12"	1465	1/4	1200	1/3	115	1	EXISTING PANEL	MANUAL	1
Y-10	ROOM #101	144 BCR	12" x 12"	1465	1/4	1200	1/3	115	1	EXISTING PANEL	MANUAL	1
Y-11	ROOM #102	144 BCR	12" x 12"	1465	1/4	1200	1/3	115	1	EXISTING PANEL	MANUAL	1

NOTE:

1. PROVIDE AND INSTALL MODEL #CQT SOUND ATTENUATING CURBS.

JAMES W. ROBERTS

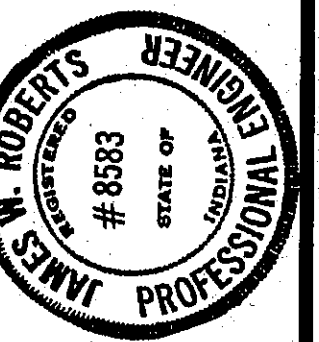

EVERETT · I · BROWN COMPANY
ARCHITECTS
ENGINEERS
· INDIANAPOLIS, INDIANA · 46241
DUNELAND SCHOOLS

EVERETT · I · BROWN COMPANY
5500 WEST BRADBURY AVENUE ·
YOST SCHOOL EXHAUST FANS

PROJECT 2777
DATE 6-25-77
REVISED
NO. 5
OF 8

77-HV-01

14