



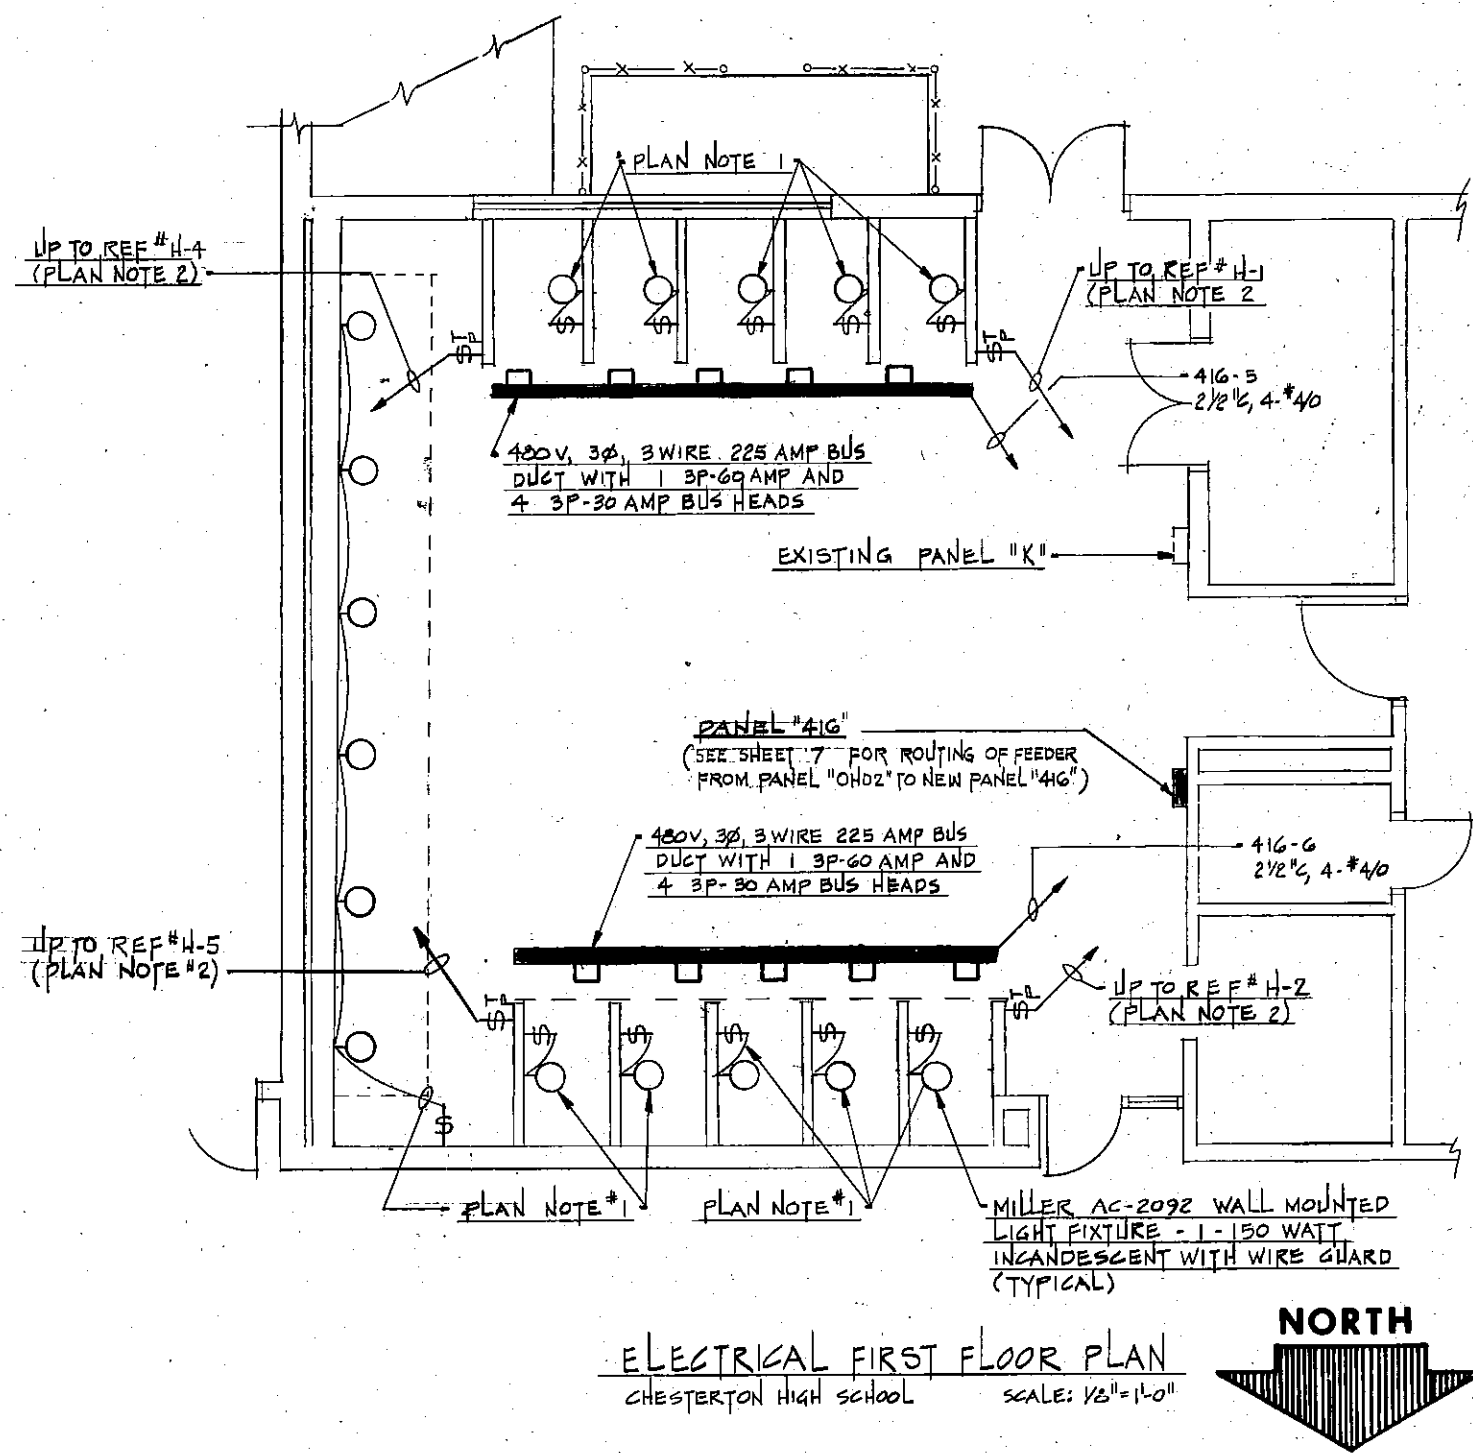


- NOTES:
1. INSTALL NEW LIGHT FIXTURES AND SWITCHES AND CONNECT TO EXISTING SPARE BREAKERS IN EXISTING PANEL "X" (DO NOT CONNECT MORE THAN 1500 WATTS PER CIRCUIT).
 2. INSTALL NEW MANUAL STARTERS WITH THERMAL OVERLOADS AND PILOT LIGHT AND CONNECT TO ROOF EXHAUST FAN INDICATED UTILIZING EXISTING SPARE BREAKERS IN EXISTING PANEL "X" (DO NOT CONNECT LIGHTS AND SMALL MOTORS ON SAME CIRCUIT).

PANEL SCHEDULE				
MARK & TYPE	CIRCUITS	BREAKER OR SWITCH	FRAME OR FUSE	REMARKS
416 CDB-4 480 VOLT, 3Ø, 3 W 400 AMP MAIN BUS SURFACE MOUNTED	1-4 5-6	3P-30 3P-225	EH FJ	

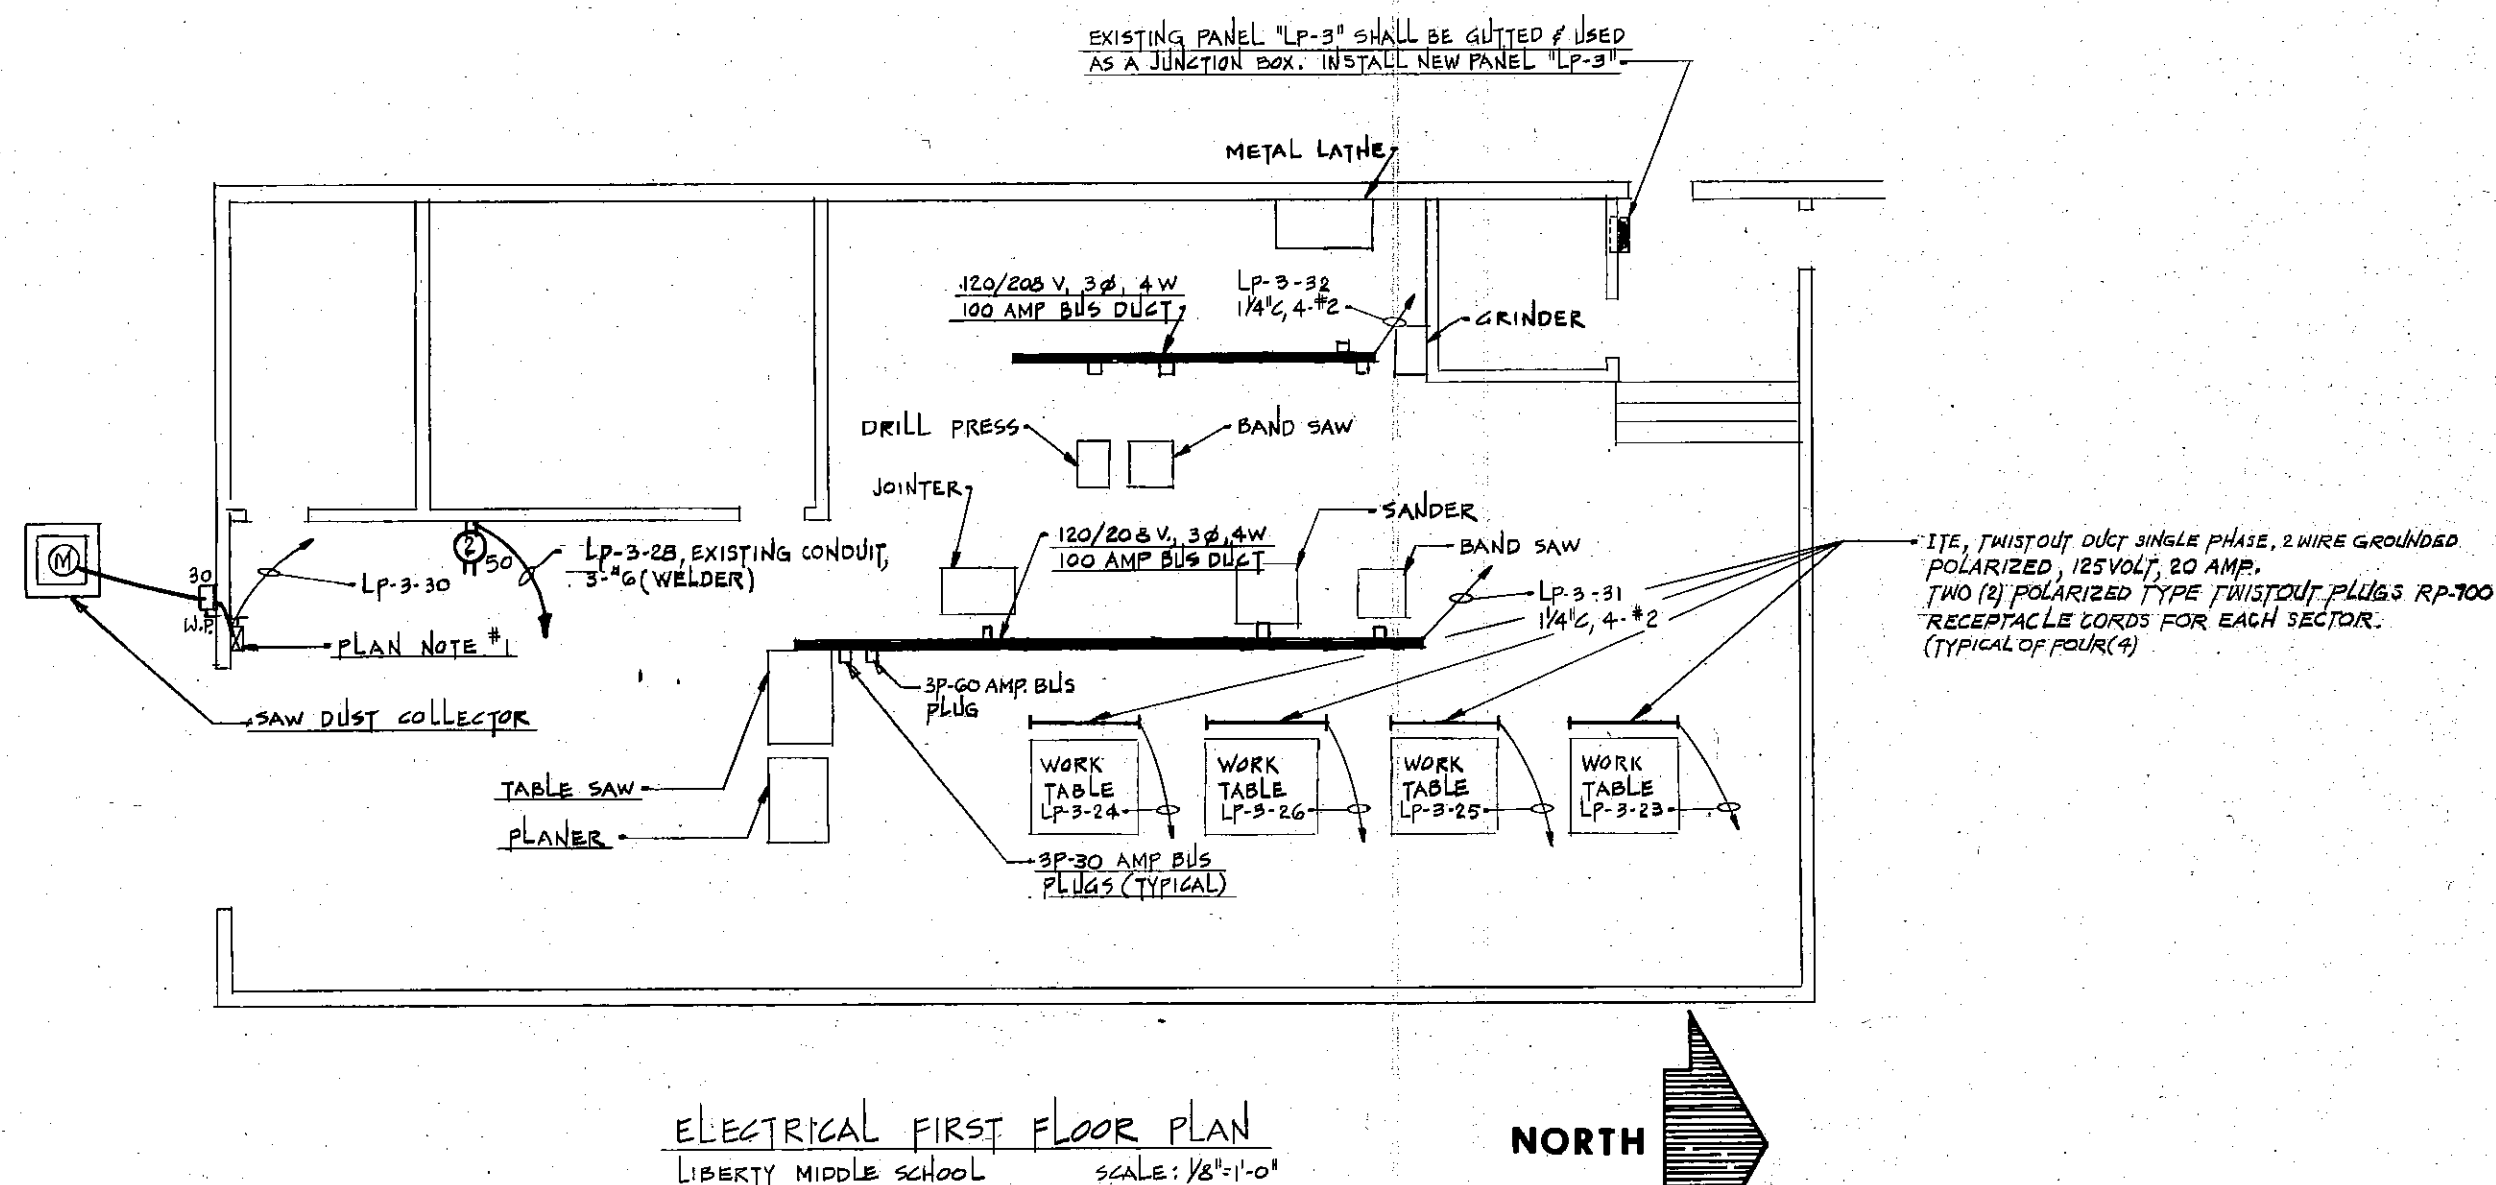


- NOTES:
1. INSTALL NEW NON FUSED COMBINATION MOTOR STARTER (3P) WITH NEMA 1 ENCLOSURE 208/120 VOLT CONTROL CIRCUIT TRANSFORMER AND FUSES, 120 VOLT COIL AND 208 VOLT CONTACTS, AND 120 VOLT MAINTAINED ON-OFF SELECTOR SWITCH. STARTER SHALL BE NEMA SIZE 0 WITH 1/2" CONTACT.

PANEL SCHEDULE				
MARK & TYPE	CIRCUITS	BREAKER OR SWITCH	FRAME OR FUSE	REMARKS
LP-3 NLAB-4 120/208 VOLT, 3Ø, 4 W 225 AMP MAIN BUS SURFACE MOUNTED	1-26 27-28 29 30 31-32	1P-20 2P-50 3P-SPACE 3P-20 3P-100	BOB BOB BOB BOB BOB	

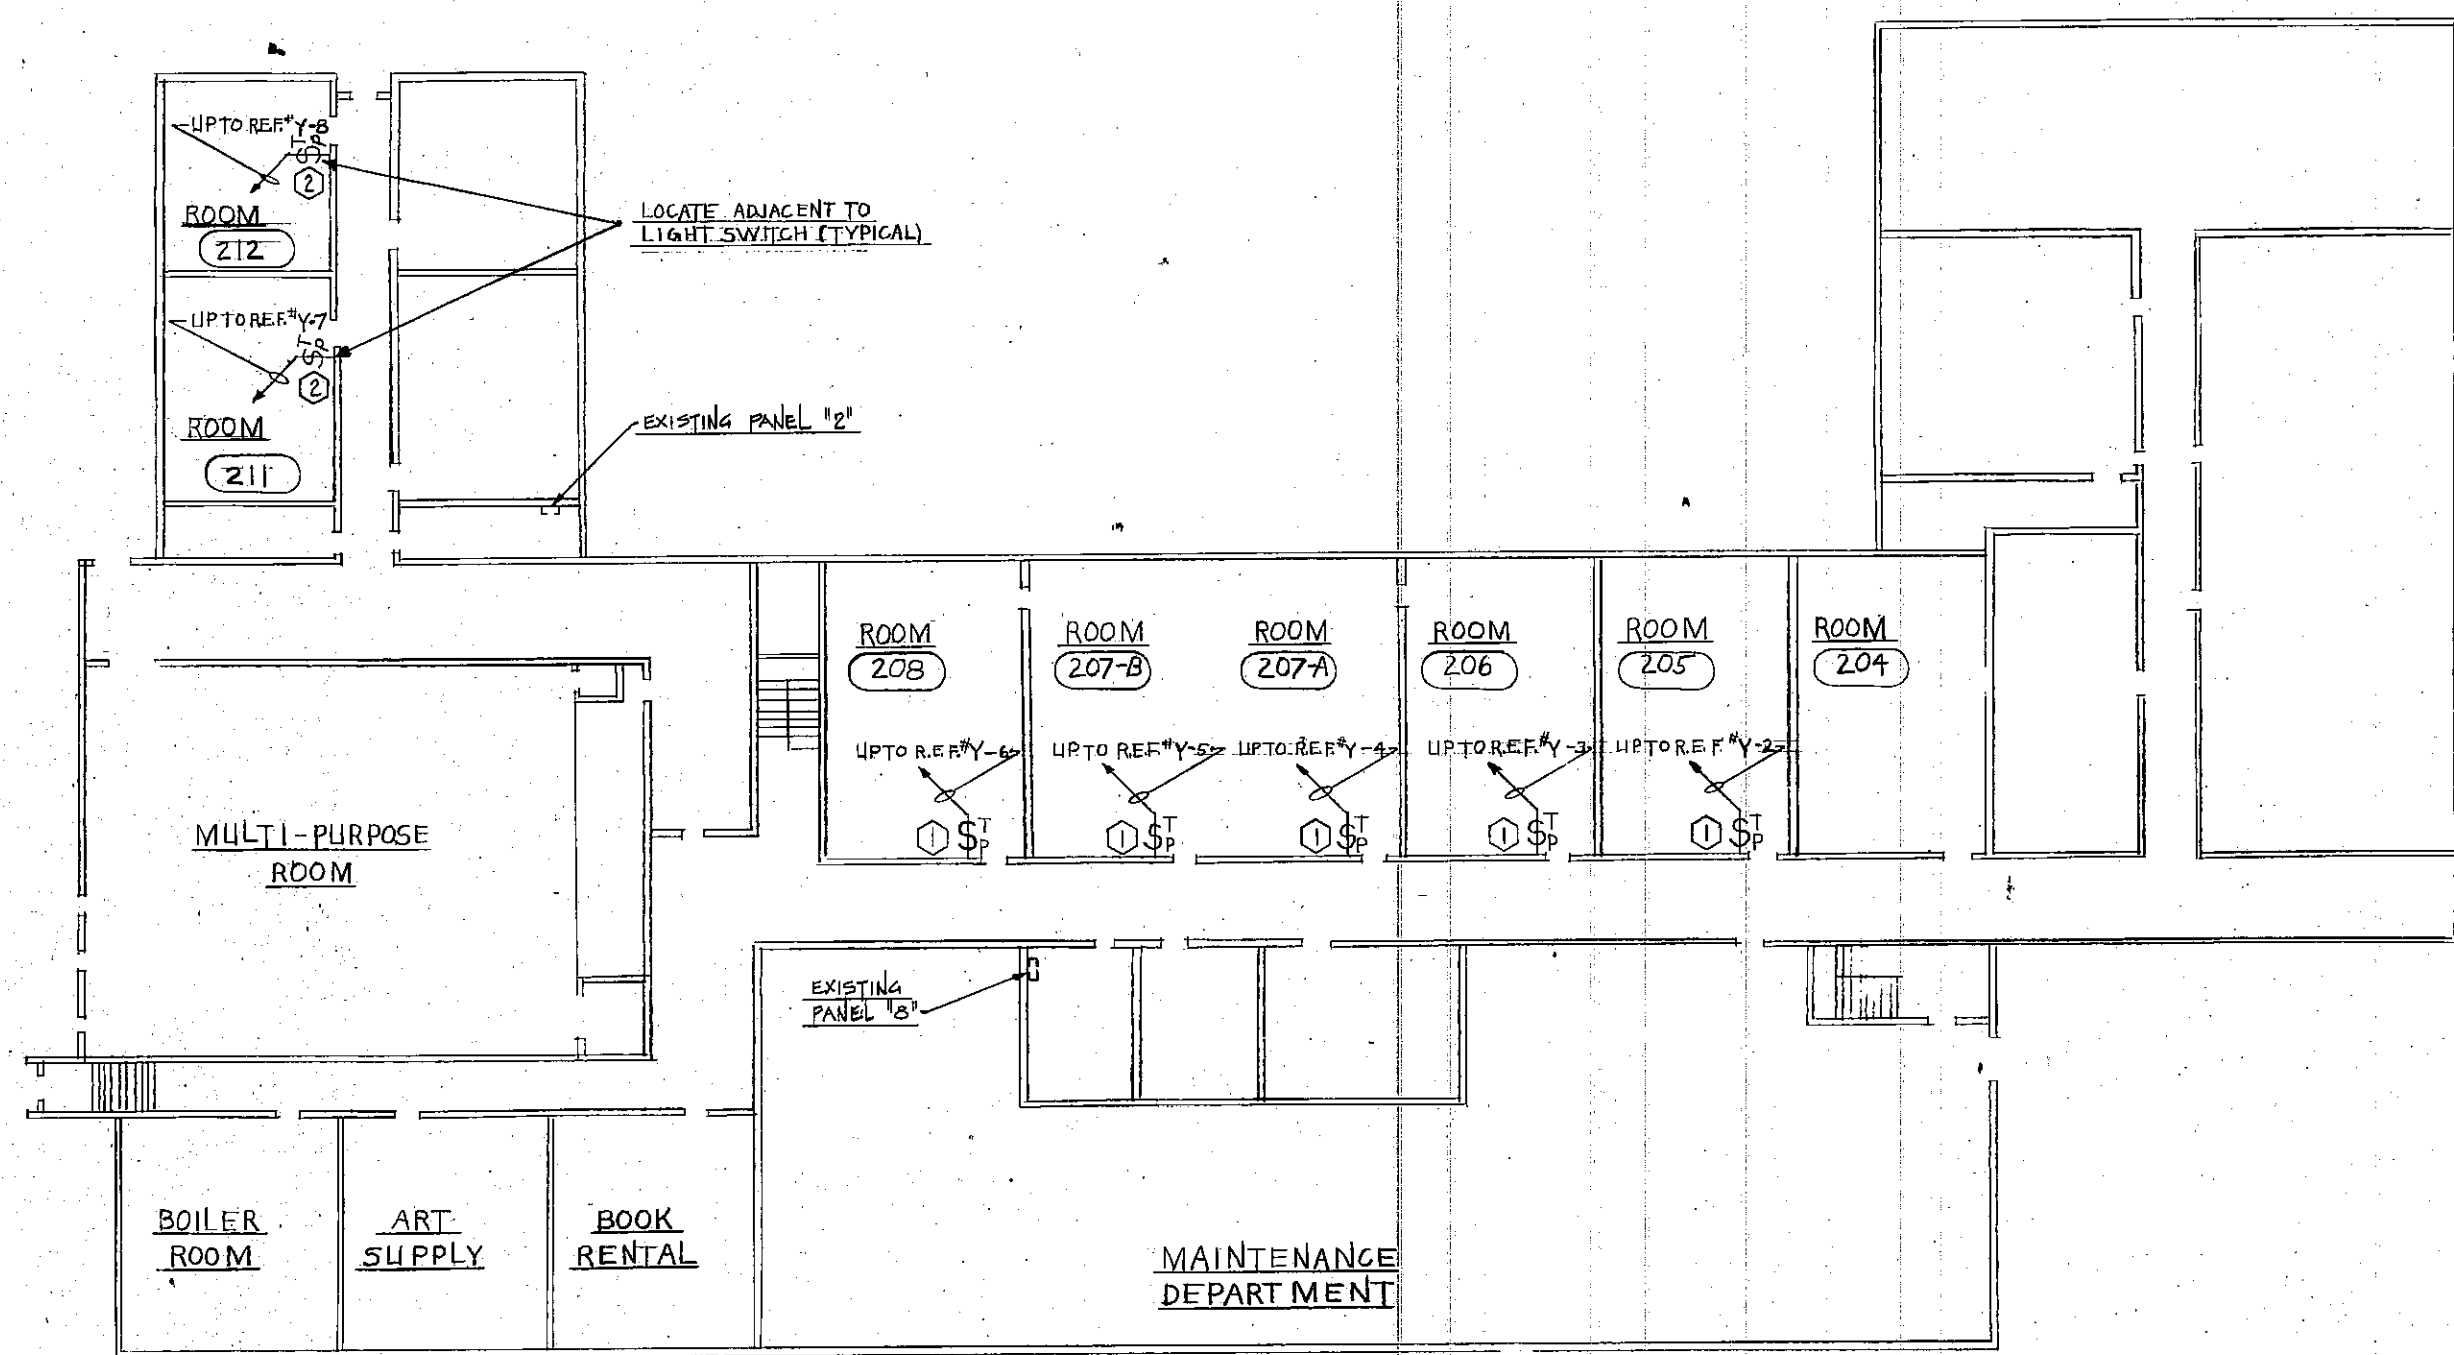

- NOTES:
1. CONNECT TO AN AVAILABLE 1P-20 AMP 120 VOLT CIRCUIT IN PANEL "10"
 2. CONNECT TO AN AVAILABLE 1P-20 AMP 120 VOLT CIRCUIT IN PANEL "10"

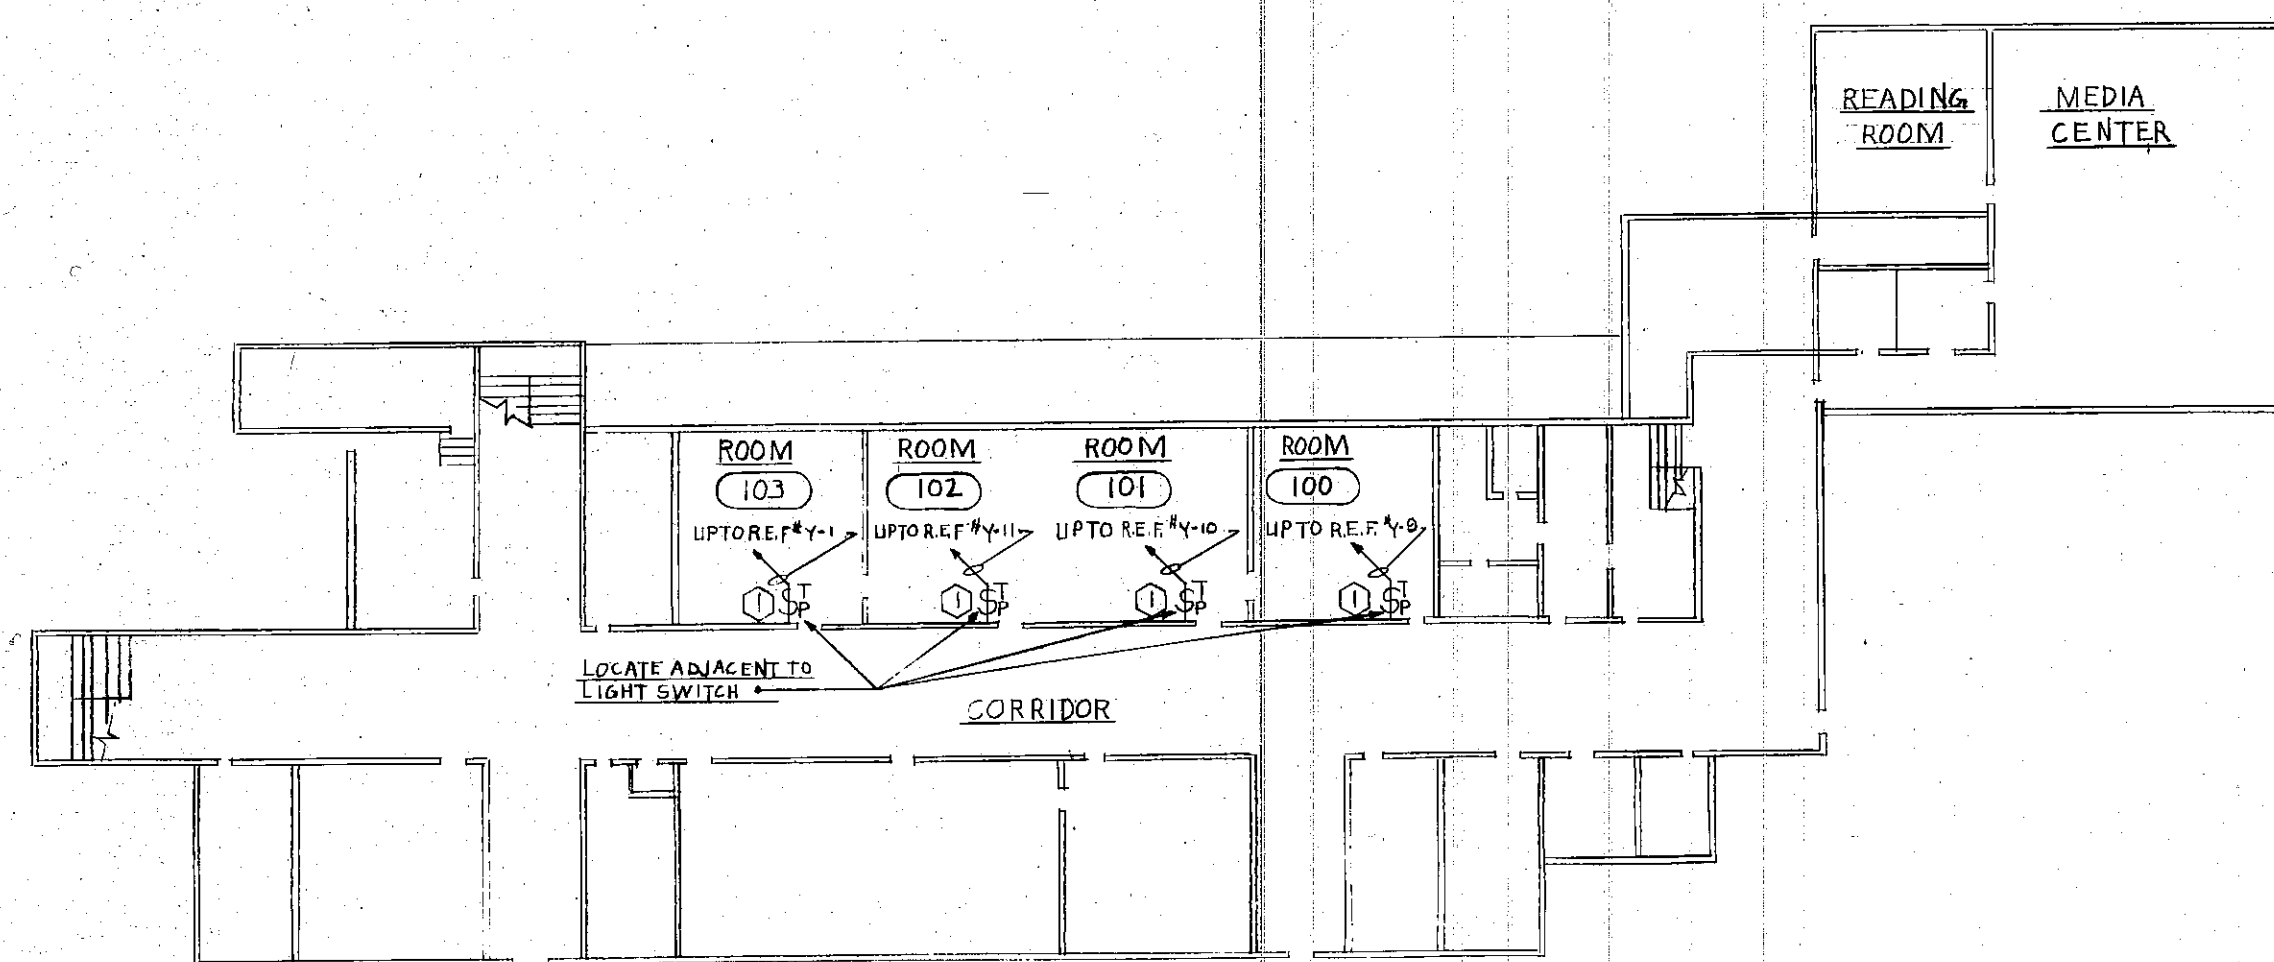


- NOTES:
1. CONNECT TO AN AVAILABLE 1P-20 AMP 120 VOLT CIRCUIT IN PANEL "10"

77-MR-02

PROJECT 2777	NO. 0
DATE 6-23-77	OF 0
REVISED	

EVERETT · I · BROWN · COMPANY
ARCHITECTS
ENGINEERS
5500 WEST BRADBURY AVENUE
INDIANAPOLIS, INDIANA 46241
· PARK FLETCHER ·

LIBERTY, YOST & CHESTERTON HIGH SCHOOLS · DUNELAND SCHOOLS

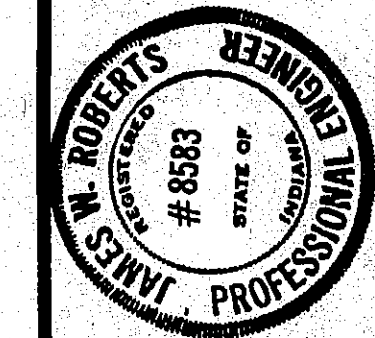

James W. Roberts