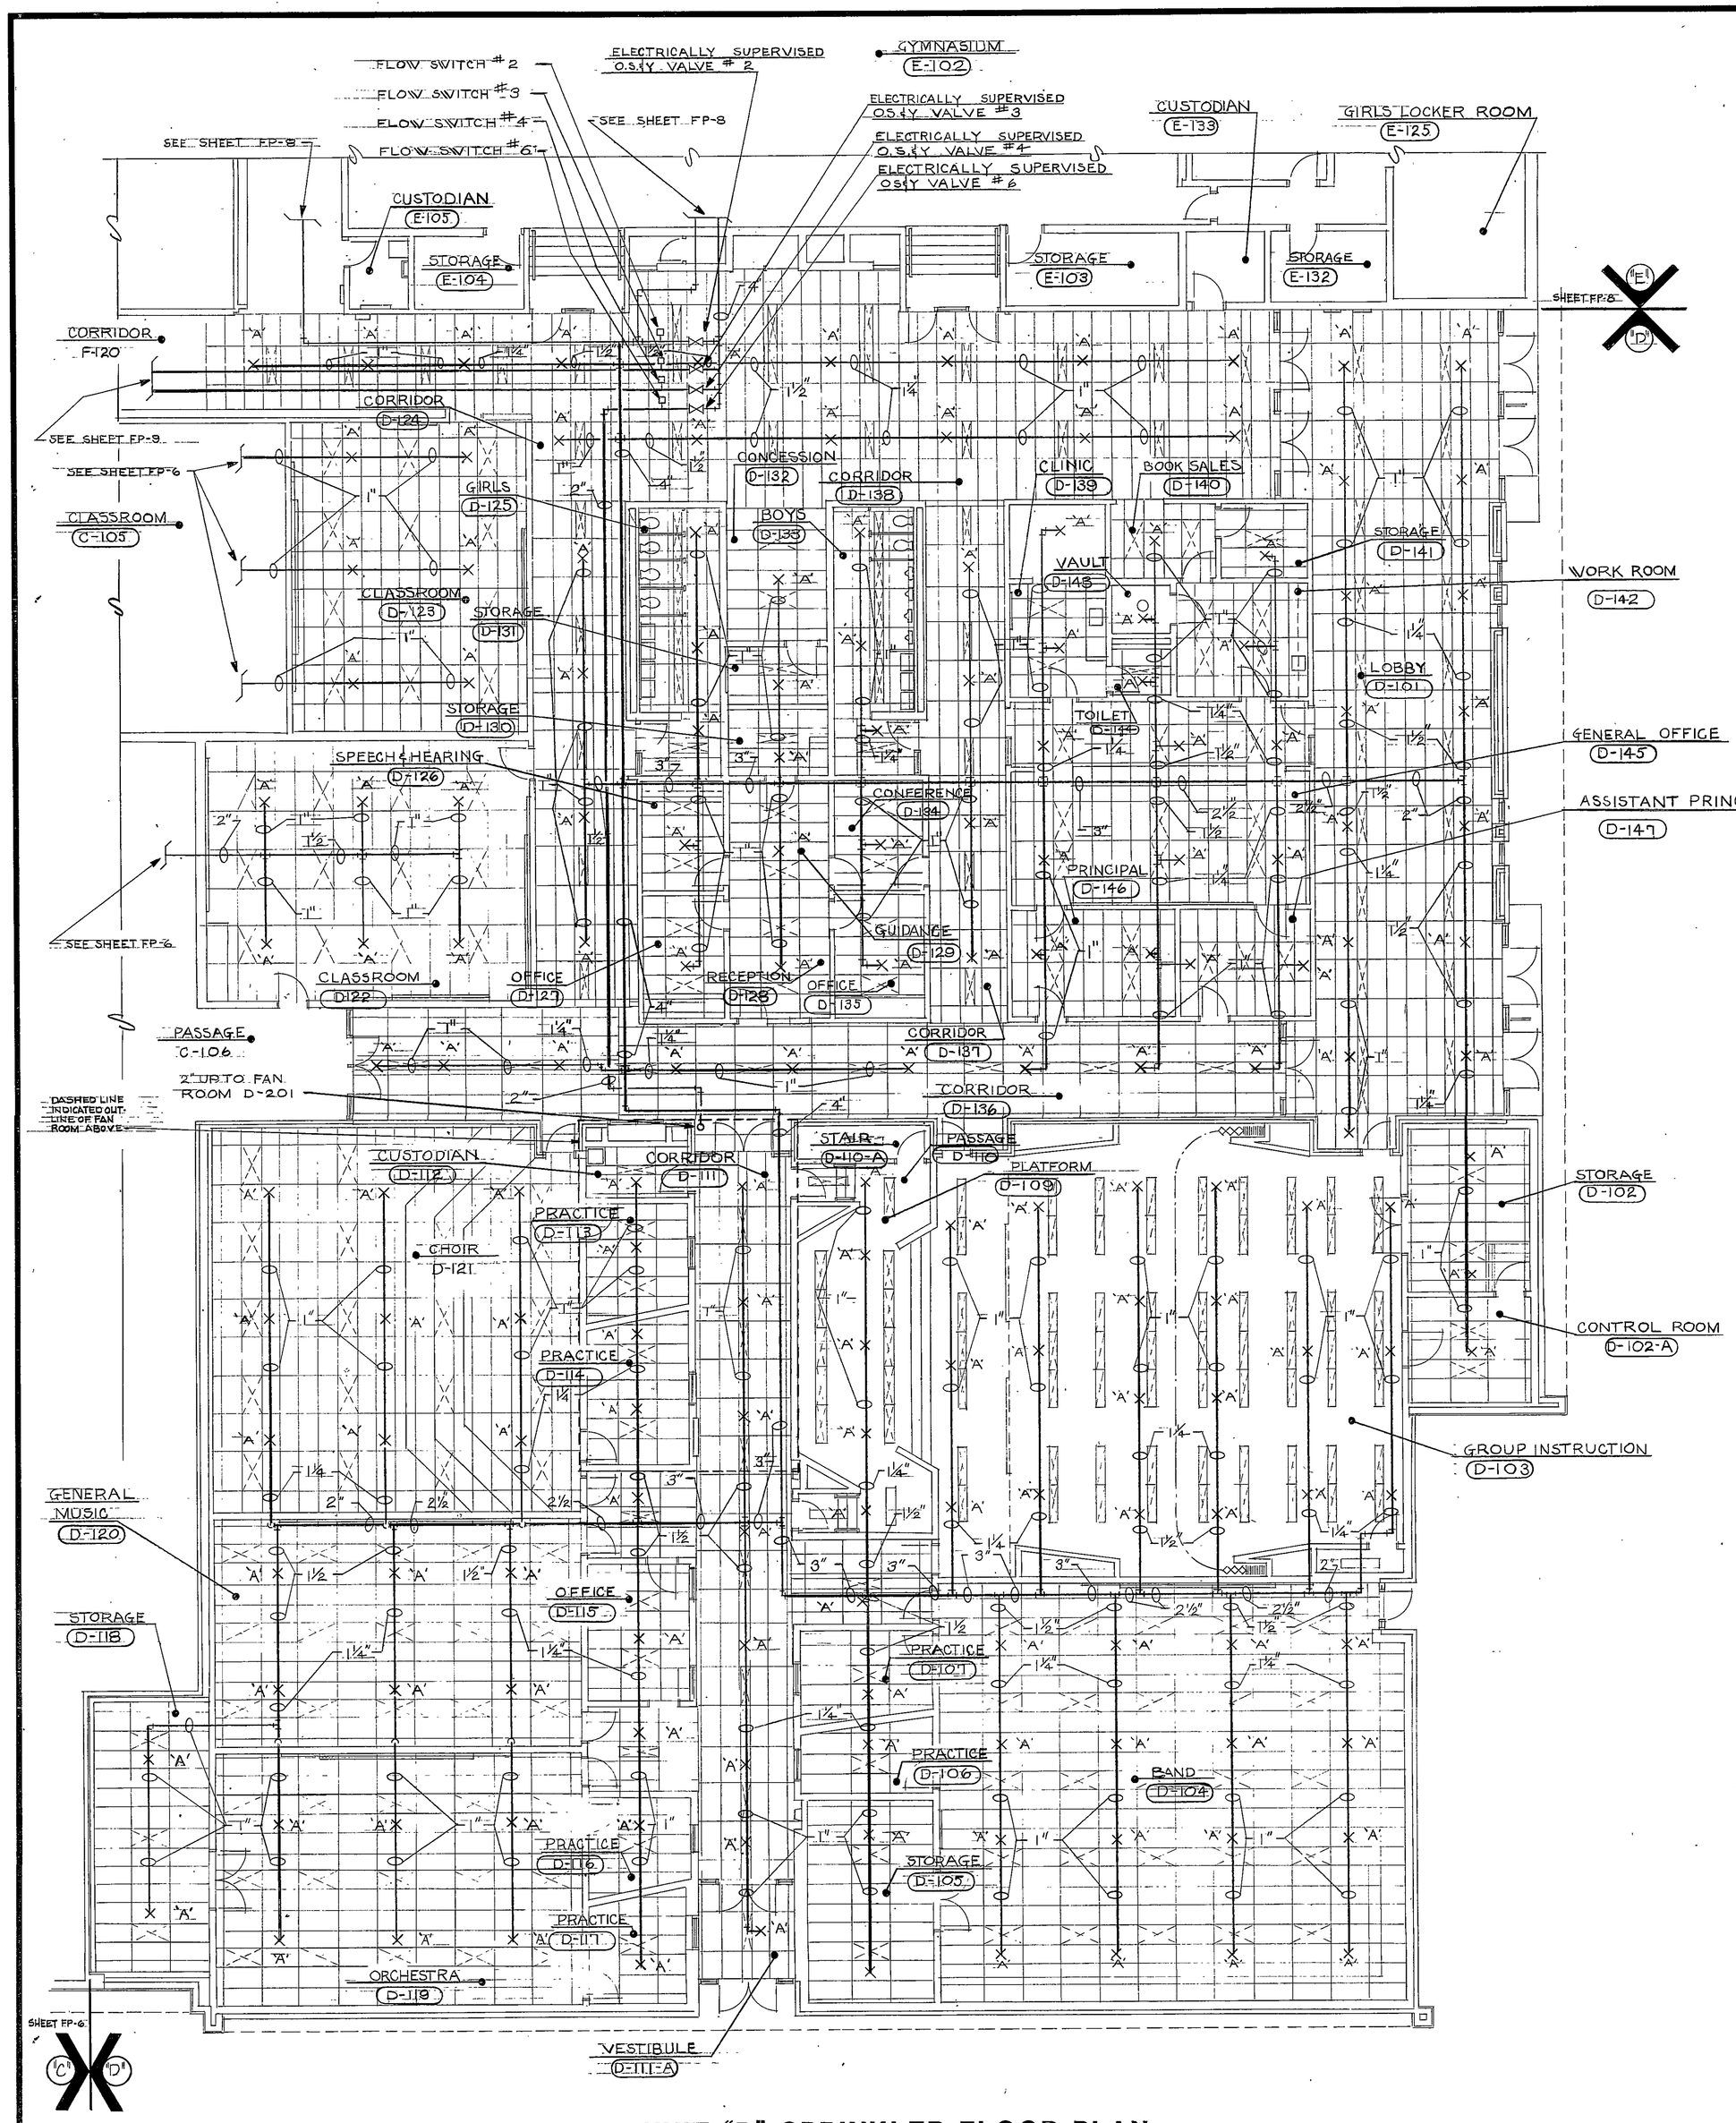

UNIT "D" SPRINKLER FLOOR PLAN

SCALE: 1/8" = 1'-0"

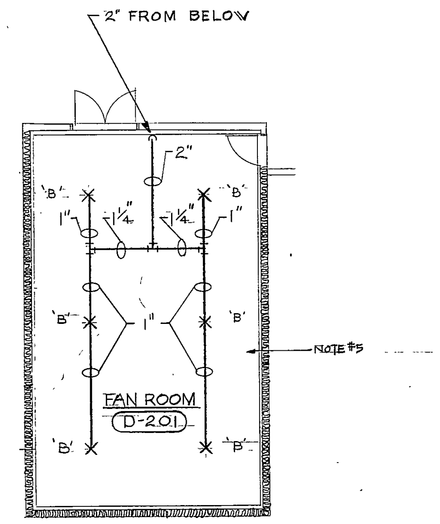

UNIT "D" FAN ROOM SPRINKLER PLAN

SCALE: 1/8" = 1'-0"

PLAN NOTES

1. SEE SHEET M-3 FOR GENERAL NOTES, LEGEND AND SCHEDULES. SEE SHEET FP-3 FOR SPRINKLER SCHEDULE.
2. THE SPRINKLER CONTRACTOR SHALL COORDINATE HIS WORK WITH THE VENTILATING CONTRACTOR, THE MECHANICAL CONTRACTOR AND THE ARCHITECTS REPRESENTATIVE BEFORE INSTALLING ANY SPRINKLER PIPING.
3. SPRINKLER HEADS SHALL BE LOCATED AT CENTER OR QUARTER POINTS OF CEILING TILE. RANDOM LOCATIONS WILL NOT BE PERMITTED.
4. THE SPRINKLER CONTRACTOR SHALL VERIFY THE CEILING GRID LOCATION WITH THE ARCHITECTS REPRESENTATIVE BEFORE INSTALLING ANY SPRINKLER PIPING.
5. SPRINKLER HEADS SHALL BE LOCATED AS REQUIRED TO MISS MECHANICAL EQUIPMENT. ADDITIONAL HEADS SHALL BE PROVIDED IF REQUIRED TO GIVE COVERAGE.

NORTH

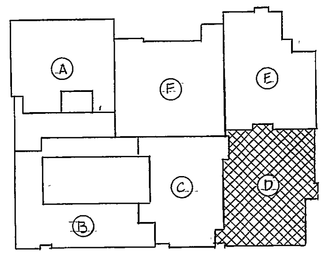

KEY PLAN
NO SCALE

EVERETT · BROWN COMPANY
ARCHITECTS ENGINEERS
• PARK FLETCHER •
• INDIANAPOLIS, INDIANA • 46241

© EVERETT / BROWN COMPANY

ADDITION TO AND RENOVATION OF LIBERTY MIDDLE SCHOOL

5500 WEST BRADBURY AVENUE •

James A. Fletcher

JAMES ALLEN FLETCHER REGISTERED 12545 STATE OF INDIANA PROFESSIONAL ENGINEER

PROJECT	DATE	REVISED
12579.00	MAY 3, 1982	

NO. FP-7
OF 10

82-FP-04