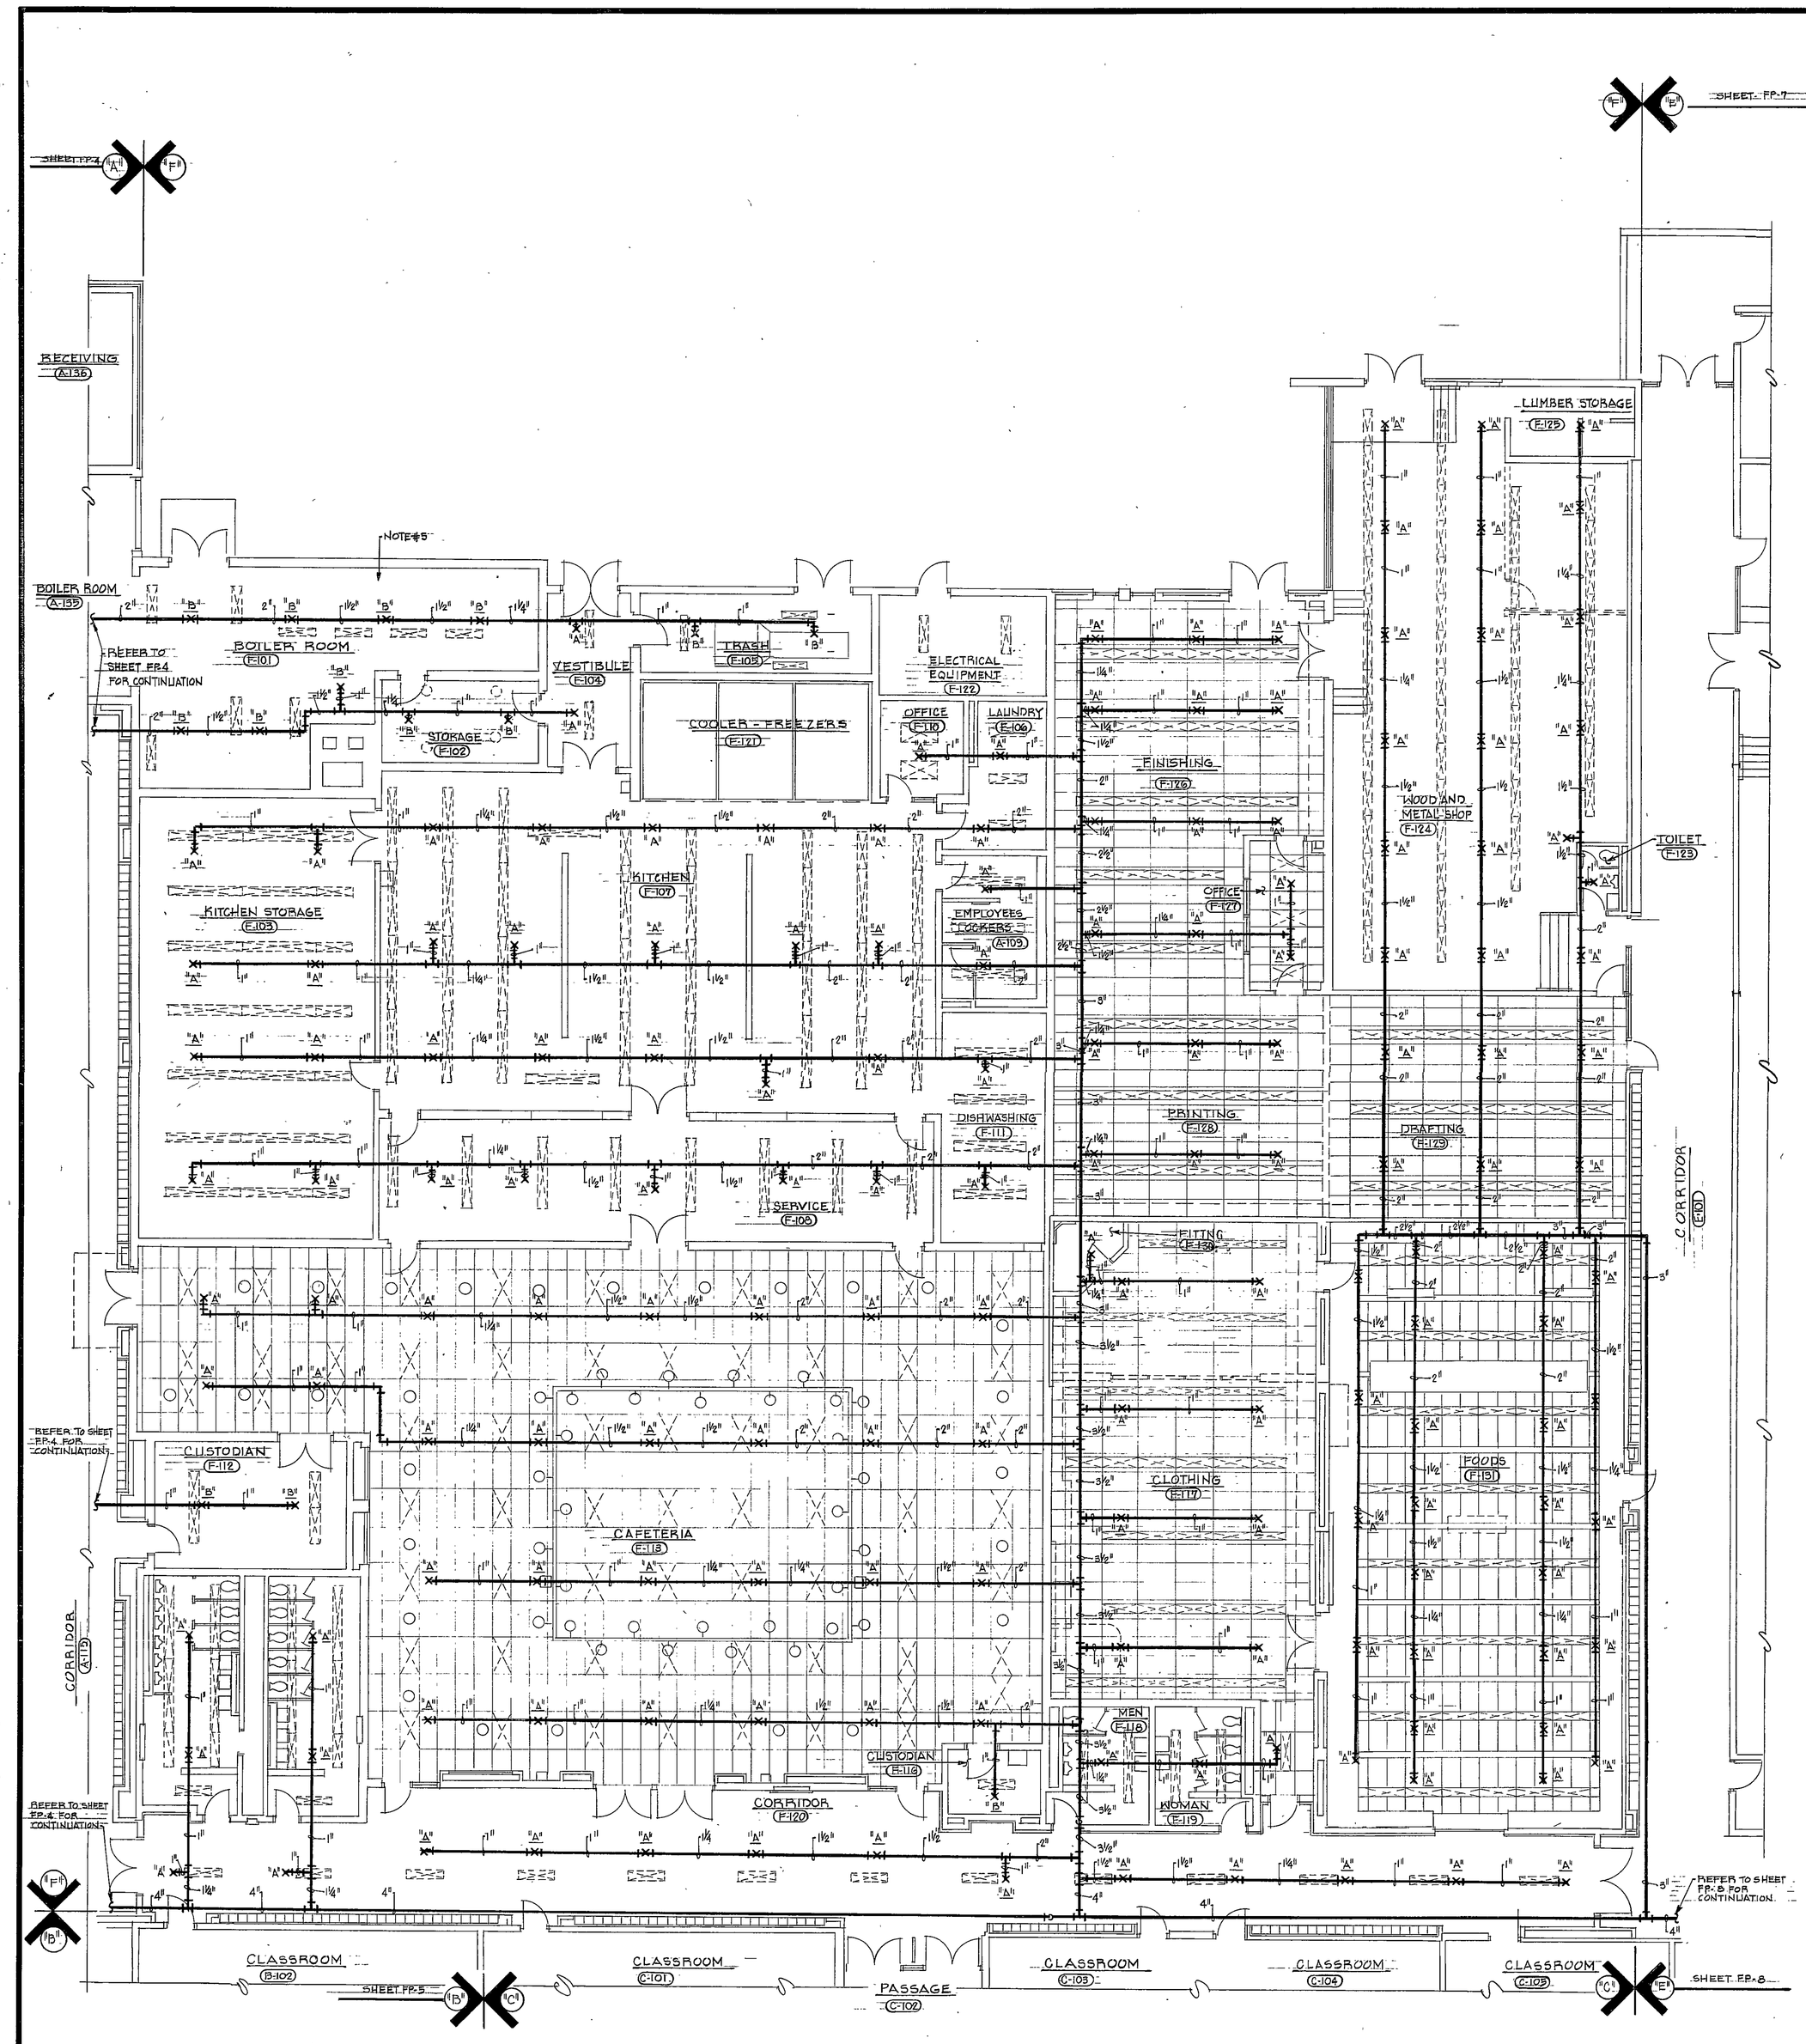

UNIT "F" SPRINKLER FLOOR PLAN

SCALE: 1/8" = 1'-0"

PLAN NOTES

1. SEE SHEET M-3 FOR GENERAL NOTES, LEGEND AND SCHEDULES. SEE SHEET FP-3 FOR SPRINKLER SCHEDULE.
2. THE SPRINKLER CONTRACTOR SHALL COORDINATE HIS WORK WITH THE VENTILATING CONTRACTOR, THE MECHANICAL CONTRACTOR AND THE ARCHITECTS REPRESENTATIVE BEFORE INSTALLING ANY SPRINKLER PIPING.
3. SPRINKLER HEADS SHALL BE LOCATED AT CENTER OR QUARTER POINTS OF CEILING TILE. RANDOM LOCATIONS WILL NOT BE PERMITTED.
4. THE SPRINKLER CONTRACTOR SHALL VERIFY THE CEILING GRID LOCATION WITH THE ARCHITECTS REPRESENTATIVE BEFORE INSTALLING ANY SPRINKLER PIPING.
5. SPRINKLER HEADS SHALL BE LOCATED AS REQUIRED TO MISS MECHANICAL EQUIPMENT. ADDITIONAL HEADS SHALL BE PROVIDED IF REQUIRED TO GIVE COVERAGE.

NORTH

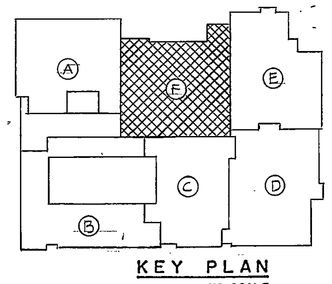

KEY PLAN
NO SCALE

EVERETT · I · BROWN COMPANY ARCHITECTS ENGINEERS
• INDIANAPOLIS, INDIANA • 46241
5500 WEST BRADBURY AVENUE •
• PARK FLETCHER •
ADDITION TO AND RENOVATION OF LIBERTY MIDDLE SCHOOL

©EVERETT I. BROWN COMPANY

James A. Partridge

JAMES ALLEN PARTRIDGE REGISTERED PROFESSIONAL ENGINEER 12545 STATE OF INDIANA

PROJECT	DATE	REVISED
12579.00	MAY 3, 1982	

NO. FP-9
OF 10

82-FP-06