

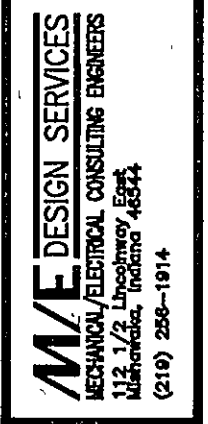
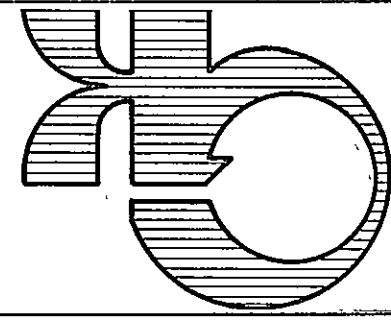
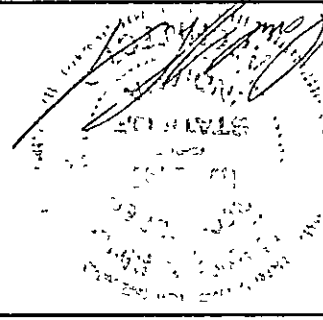
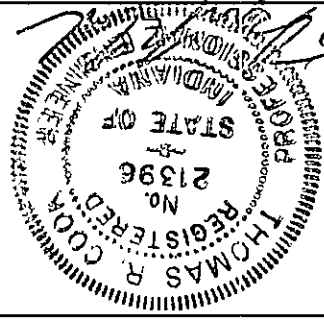


REVISIONS	BY



FIRE ALARM SYSTEM
NEW FLOOR PLAN -
LIBERTY MIDDLE SCHOOL
1/8" = 1'-0" (SECTION-A)



- LEGEND**
- EC ELECTRICAL CONTRACTOR / TRADE
 - FCP FIRE ALARM CONTROL PANEL
 - GC GENERAL CONTRACTOR / TRADE
 - ⑤ SMOKE DETECTOR
 - ⑤ DUCT SMOKE DETECTOR WITH TEST/CONTROL PANEL (INSTALL IN EXIST. AIR HANDLING UNIT IN SUPPLY & RETURN AIR DUCTS)
 - ⑤ FIRE ALARM AUDIO / VISUAL UNIT
 - ⑤ FIRE ALARM FULL STATION (MANUAL)
 - ⑤ FIRE ALARM LAMP STATION - WALL MTD.
 - ⑤ FIRE ALARM ANNUNCIATOR PANEL
 - ⑤ FIRE ALARM CONTROL PANEL
 - ⑤ AUTO-DIALER
 - ⑤ TAMPER SWITCH
 - ⑤ FLOW SWITCH
 - ⑤ INDICATES A NEW FIRE ALARM CONTROL DEVICE INSTALLED AT NEW LOCATION W/ NEW BACK BOX EXISTING DEPENDENT TO REMAIN
 - ⑤ CONNECTION TO EXISTING CIRCUIT
 - ⑤ HEAT DETECTOR
 - ⑤ EXTERIOR BELL

