

[illegible][illegible]


ELECTRICAL DEMOLITION NOTES

1. RELOCATE LIGHT POLE AND POLE MOUNTED LIGHT FIXTURE TO NEW LOCATION AS INDICATED ON NEW CONSTRUCTION DRAWINGS. PROVIDE NEW CONCRETE POLE BASE INCLUDING, ETC. TO MATCH EXISTING.
2. LIGHT FIXTURES WITHIN NEW CLASSROOM MEANS TO REMAIN FOR REUSE. RELOCATE EXISTING LIGHT FIXTURES TO NEW LOCATION. DISCONNECT EXISTING LIGHTS FROM SERVICE ELECTRICAL SYSTEM (SEE NEW CONSTRUCTION DRAWINGS).
3. EXISTING 800 AMP BUILDING MAIN DISTRIBUTION PANELBOARD TO REMAIN. PROVIDE NEW FEEDER (TWO SETS OF 4-600MM IN 3-1/2" C) FROM 800 AMP/3 BREAKER IN NEW BUILDING SERVICE TRANSFORMER TO ONE LINE (DIAGRAM).
4. REMOVE ELECTRIC UTILITY METER/CURRENT TRANSFORMER/ENCLOSURE. COORDINATE WITH MISO AND INCLUDE ALL COST AND BASE BID. RELOCATE ALL OTHER NEW SWITCHBOARDS.
5. REMOVE EXISTING 800 AMP FEED SWITCH AND ASSOCIATED BUILDING ELECTRICAL SYSTEM. COORDINATE WITH MISO AND INCLUDE ALL COSTS AND BASE BID. DISCONNECT SWITCHES, STARTERS, AND MISC. ELECTRICAL ITEMS OUT OF WAY OF NEW SWITCHBOARD.
6. REMOVE POLE MOUNTED UTILITY TRANSFORMER AND ASSOCIATED ELECTRICAL SERVICE. COORDINATE WITH MISO AND INCLUDE ALL COSTS AND BASE BID. REMOVE EXISTING POLE MOUNTED UTILITY TRANSFORMER AND ASSOCIATED ELECTRICAL SERVICE. NEW ELECTRICAL SERVICE. THIS CONTRACTOR SHALL PROVIDE UTILITY TRANSFORMER PAD, METERING ENCLOSURE, UNDERGROUND RACEWAY, ETC. AND ALL NECESSARY WIRING AND DEVICES NECESSARY TO UPGRADE ELECTRICAL SERVICE AS REQUIRED BY MISO.
7. CIRCULATION PUMP BRANCH CIRCUIT TO REMAIN FOR REUSE. RECONNECT TO NEW CIRCULATION PUMP.
8. REMOVE LIGHT FIXTURES OUTSIDE OF NEW CLASSROOM AREAS ONLY. REPLACE EXISTING LIGHT FIXTURES WITH NEW LIGHT FIXTURES. DISCONNECT EXISTING DIRECTION OF ENGINEER. DISPOSE OF LIGHT FIXTURES NOT SELECTED FOR REUSE.
9. RECONNECT EMERGENCY LIGHTING PANELBOARD FEEDER TO NEW 1600A SWITCHBOARD (CONNECT TO SWITCHBOARD MAINS-LINE SIDE OF MAIN DISCONNECT SWITCH).
10. RELOCATE ITEM IF REQUIRED.
11. REMOVE CEILING FAN AND TURN OVER TO OWNER. RECONNECT FAN BRANCH CIRCUIT TO NEW SWITCHBOARD.
12. REMOVE LIGHT FIXTURE AND ASSOCIATED CONDUIT AND WIRE.
13. REMOVE ROUGH-IN AND ASSOCIATED CONDUIT AND WIRE.
14. DISCONNECT MECHANICAL UNIT. UNIT BRANCH CIRCUIT MAY REMAIN FOR REUSE WHEN APPLICABLE (REFER TO POWER PLANS). REMOVE ALL CIRCUITS NOT REMAINING FOR REUSE. BACK TO EXISTING BRANCH PANELBOARD.
15. SPEAKER TO REMAIN. RECONNECT TO NEW "PUSH-TO-CALL" BUTTON (REFER TO NEW CONSTRUCTION DRAWINGS) AND CIRCUIT BACK TO EXISTING BLDG. P.A. SYSTEM CONTROL.
16. REMOVE SPEAKER AND REINSTATE ON NEW CEILING.
17. REMOVE FIRE ALARM DETECTOR AND ASSOCIATED CABLE. CONDUIT MAY REMAIN FOR REUSE WHEN APPLICABLE. REMOVE ALL CONDUIT NOT REUSED FOR NEW F.A. SYSTEM CABLE.
18. RELOCATE SCORE BOARD, SCORE BOARD CONTROL UNIT, CONTROL UNIT OUTLET AND ALL ASSOCIATED EQUIPMENT TO NEW GYMNASIUM.

MECHANICAL DEMOLITION NOTES

- 1 DISCONNECT AND REMOVE EXISTING INCINERATOR AND ALL RELATED APPURTENANCES. CAP CHIMNEY STACK WHERE INCINERATOR STACK IS REMOVED.
- 2 DISCONNECT AND REMOVE EXISTING STEAM LINE AND ALL RELATED APPURTENANCES.
- 3 DISCONNECT AND REMOVE EXISTING HYDRONIC HOT WATER HEAT EXCHANGER AND ALL RELATED APPURTENANCES. (HEAT EXCHANGER SERVING DOMESTIC HOT WATER SHALL REMAIN).
- 4 DISCONNECT AND REMOVE EXISTING HYDRONIC HOT WATER CIRCULATION PUMP AND RELATED PIPING AND APPURTENANCES AS SHOWN ON DRAININGS.
- 5 DISCONNECT AND REMOVE EXISTING UNIT VENTILATION AND ALL RELATED APPURTENANCES.
- 6 DISCONNECT AND REMOVE EXISTING FIN RADIATION AND ALL RELATED APPURTENANCES.
- 7 DISCONNECT AND REMOVE EXISTING AIR CONDITIONING UNIT AND ALL RELATED APPURTENANCES.
- 8 DISCONNECT AND REMOVE EXISTING CABINET HEATER AND ALL RELATED APPURTENANCES.
- 9 DISCONNECT AND REMOVE EXISTING CONDENSATE PIPING AND ALL RELATED APPURTENANCES.
- 10 EXISTING TO REMAIN.
- 11 DISCONNECT AND REMOVE EXISTING HWS AND HWR PIPING. CAP EXISTING THAT IS TO REMAIN.
- 12 DISCONNECT AND REMOVE EXISTING AIR HANDLING UNIT.
- 13 DISCONNECT AND REMOVE EXISTING DUCTWORK AND ALL RELATED APPURTENANCES.
- 14 DISCONNECT AND REMOVE EXISTING THERMISTE AND ALL RELATED APPURTENANCES.
- 15 EXISTING FAN AND CONTROL TO REMAIN.
- 16 EXISTING DUCTWORK TO REMAIN.
- 17 DISCONNECT AND REMOVE EXISTING WATER HEATER AND RELATED APPURTENANCES.
- 18 DISCONNECT AND REMOVE EXISTING PUMP. SHUT PIT SHALL REMAIN FOR REUSE.
- 19 DISCONNECT AND REMOVE EXISTING HOT WATER RETICULATING PUMP.
- 20 EXISTING HOT WATER STORAGE PUMP TO REMAIN.
- 21 EXISTING HEAT EXCHANGER CIRCULATION PUMP FOR DOMESTIC HOT WATER TO REMAIN.
- 22 EXISTING DOMESTIC HOT WATER STORAGE TANK TO REMAIN.
- 23 DISCONNECT AND REMOVE EXISTING PLUMBING FIXTURES. CAP ALL PIPING BELOW FLOOR AND ABOVE CEILING.
- 24 DISCONNECT AND REMOVE EXISTING SINK.
- 25 DISCONNECT AND REMOVE EXISTING NOSE BIBB AND ALL RELATED PIPING AND APPURTENANCES TO ABOVE CEILING. CAP EXISTING PIPING THAT REMAINS.

BOILER ROOM DEMOLITION PLAN

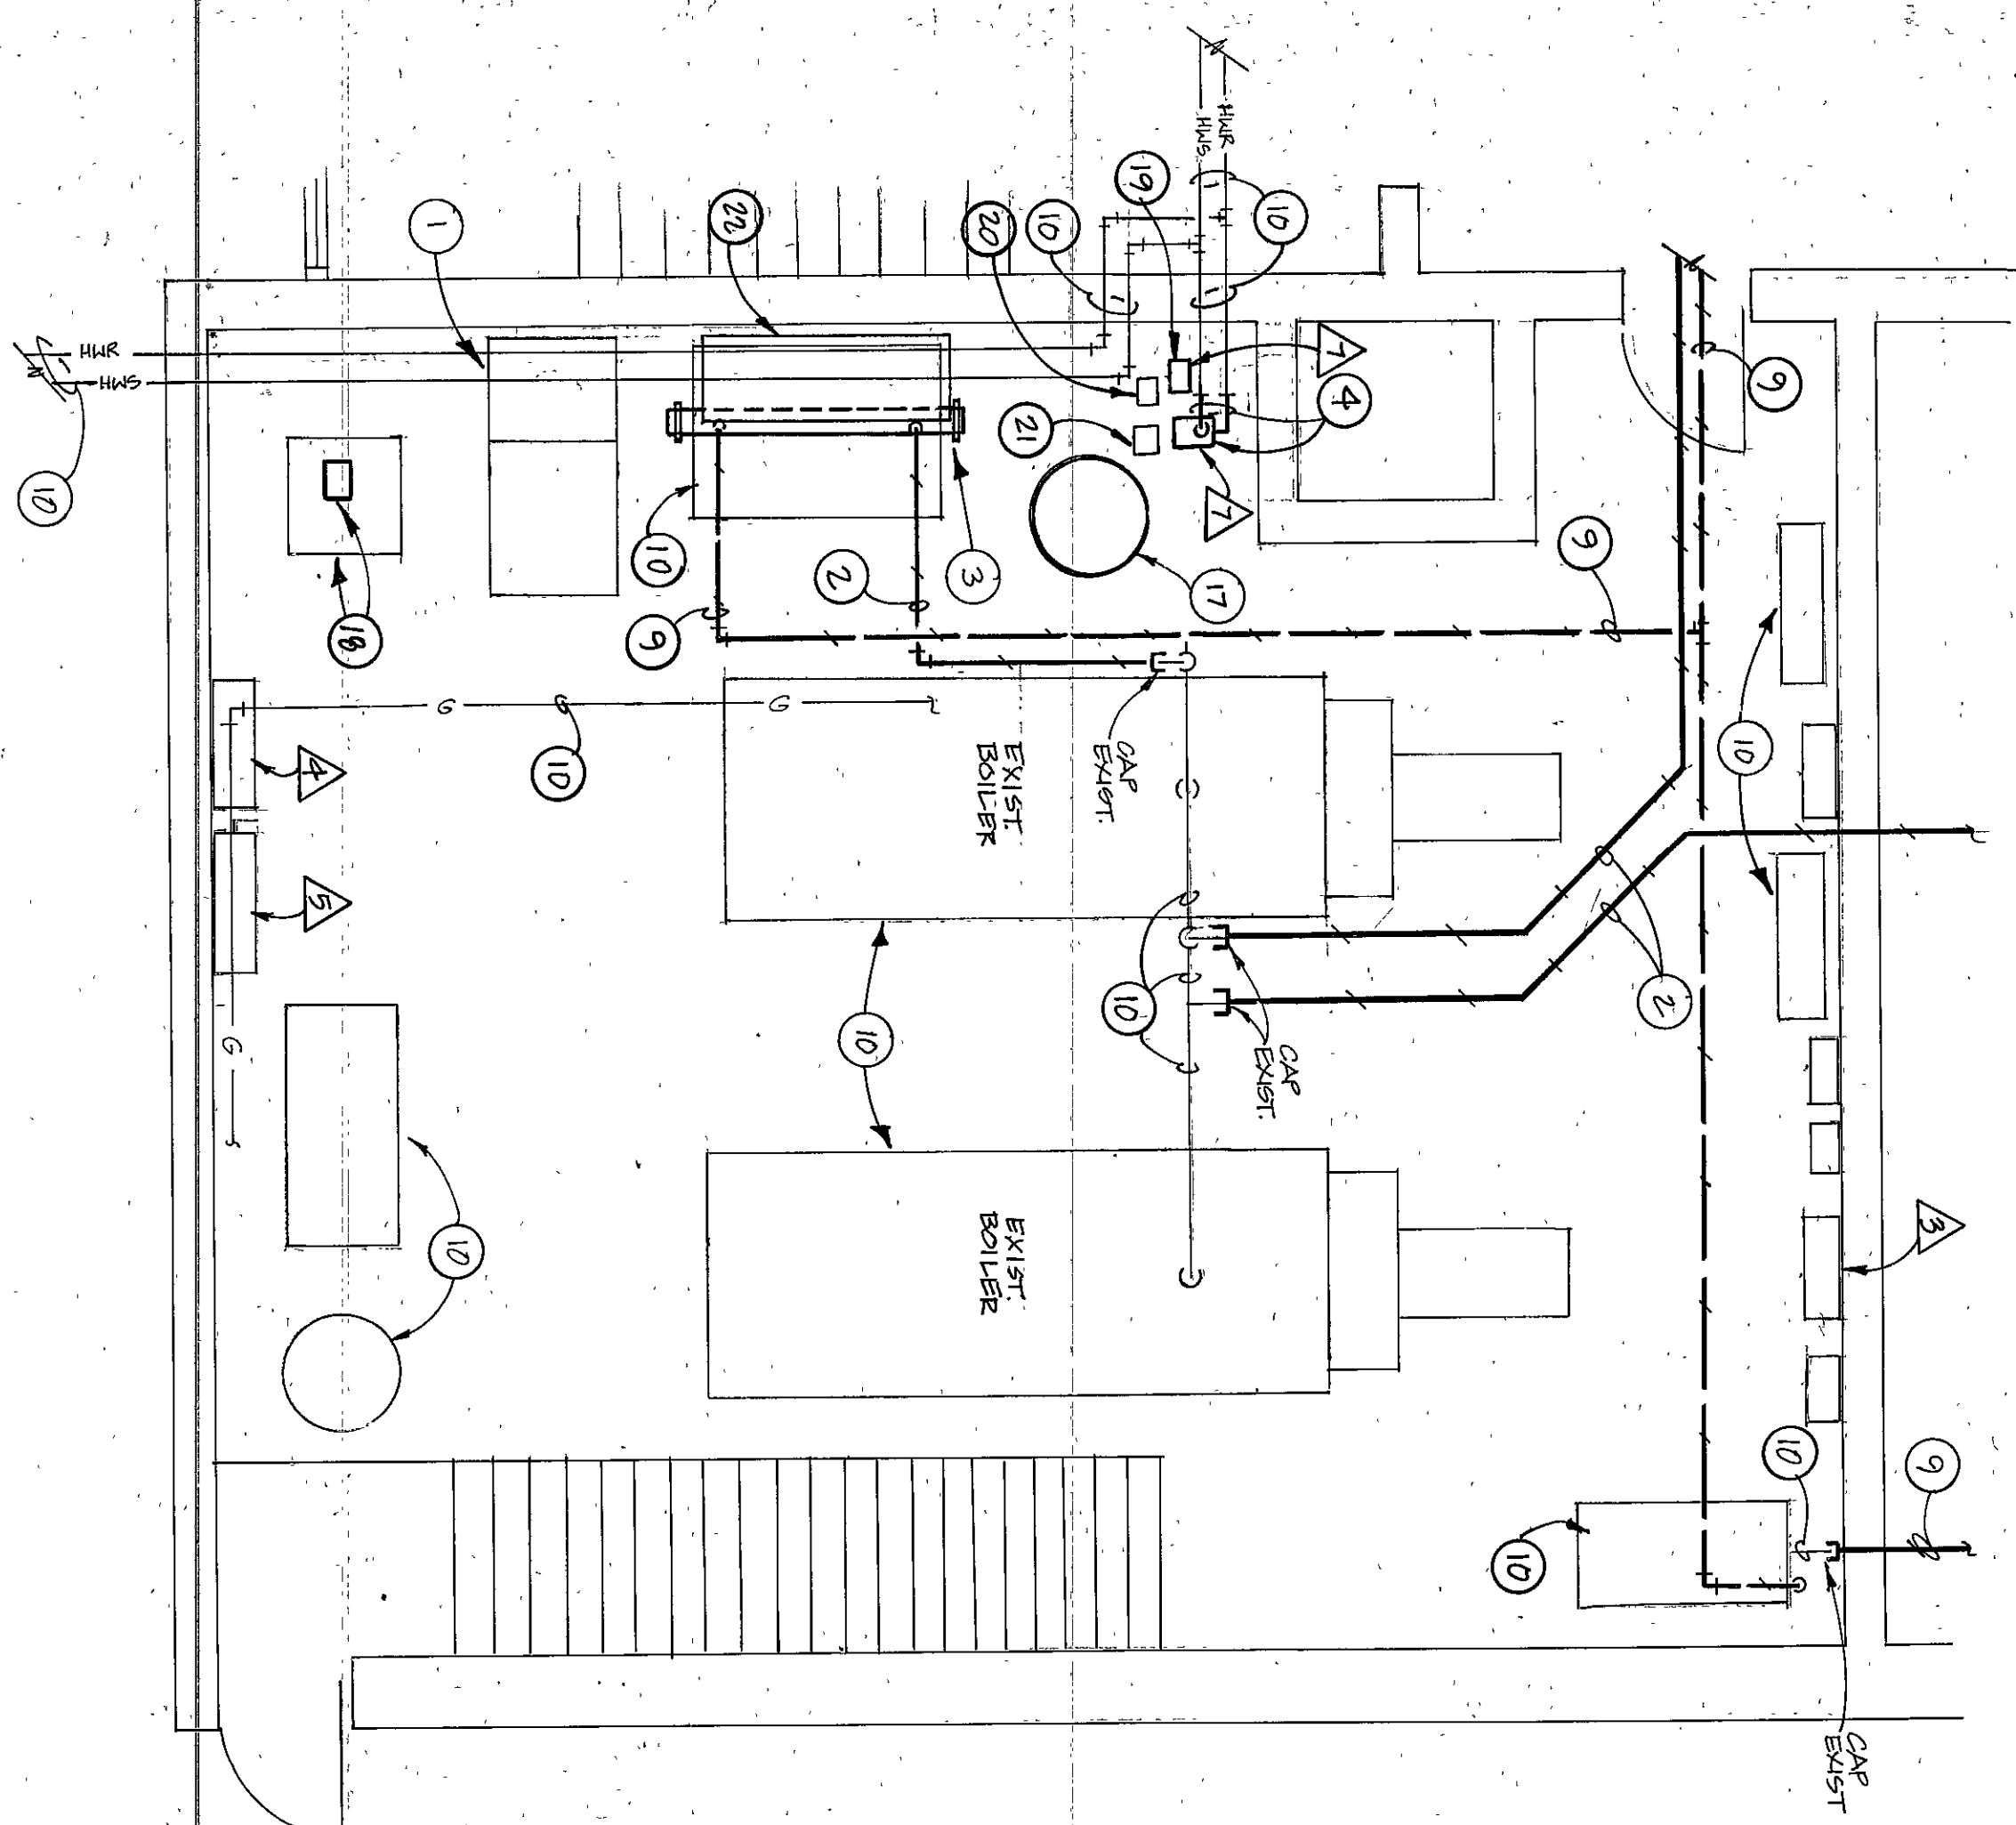

LOWER LEVEL DEMOLITION PLAN

