


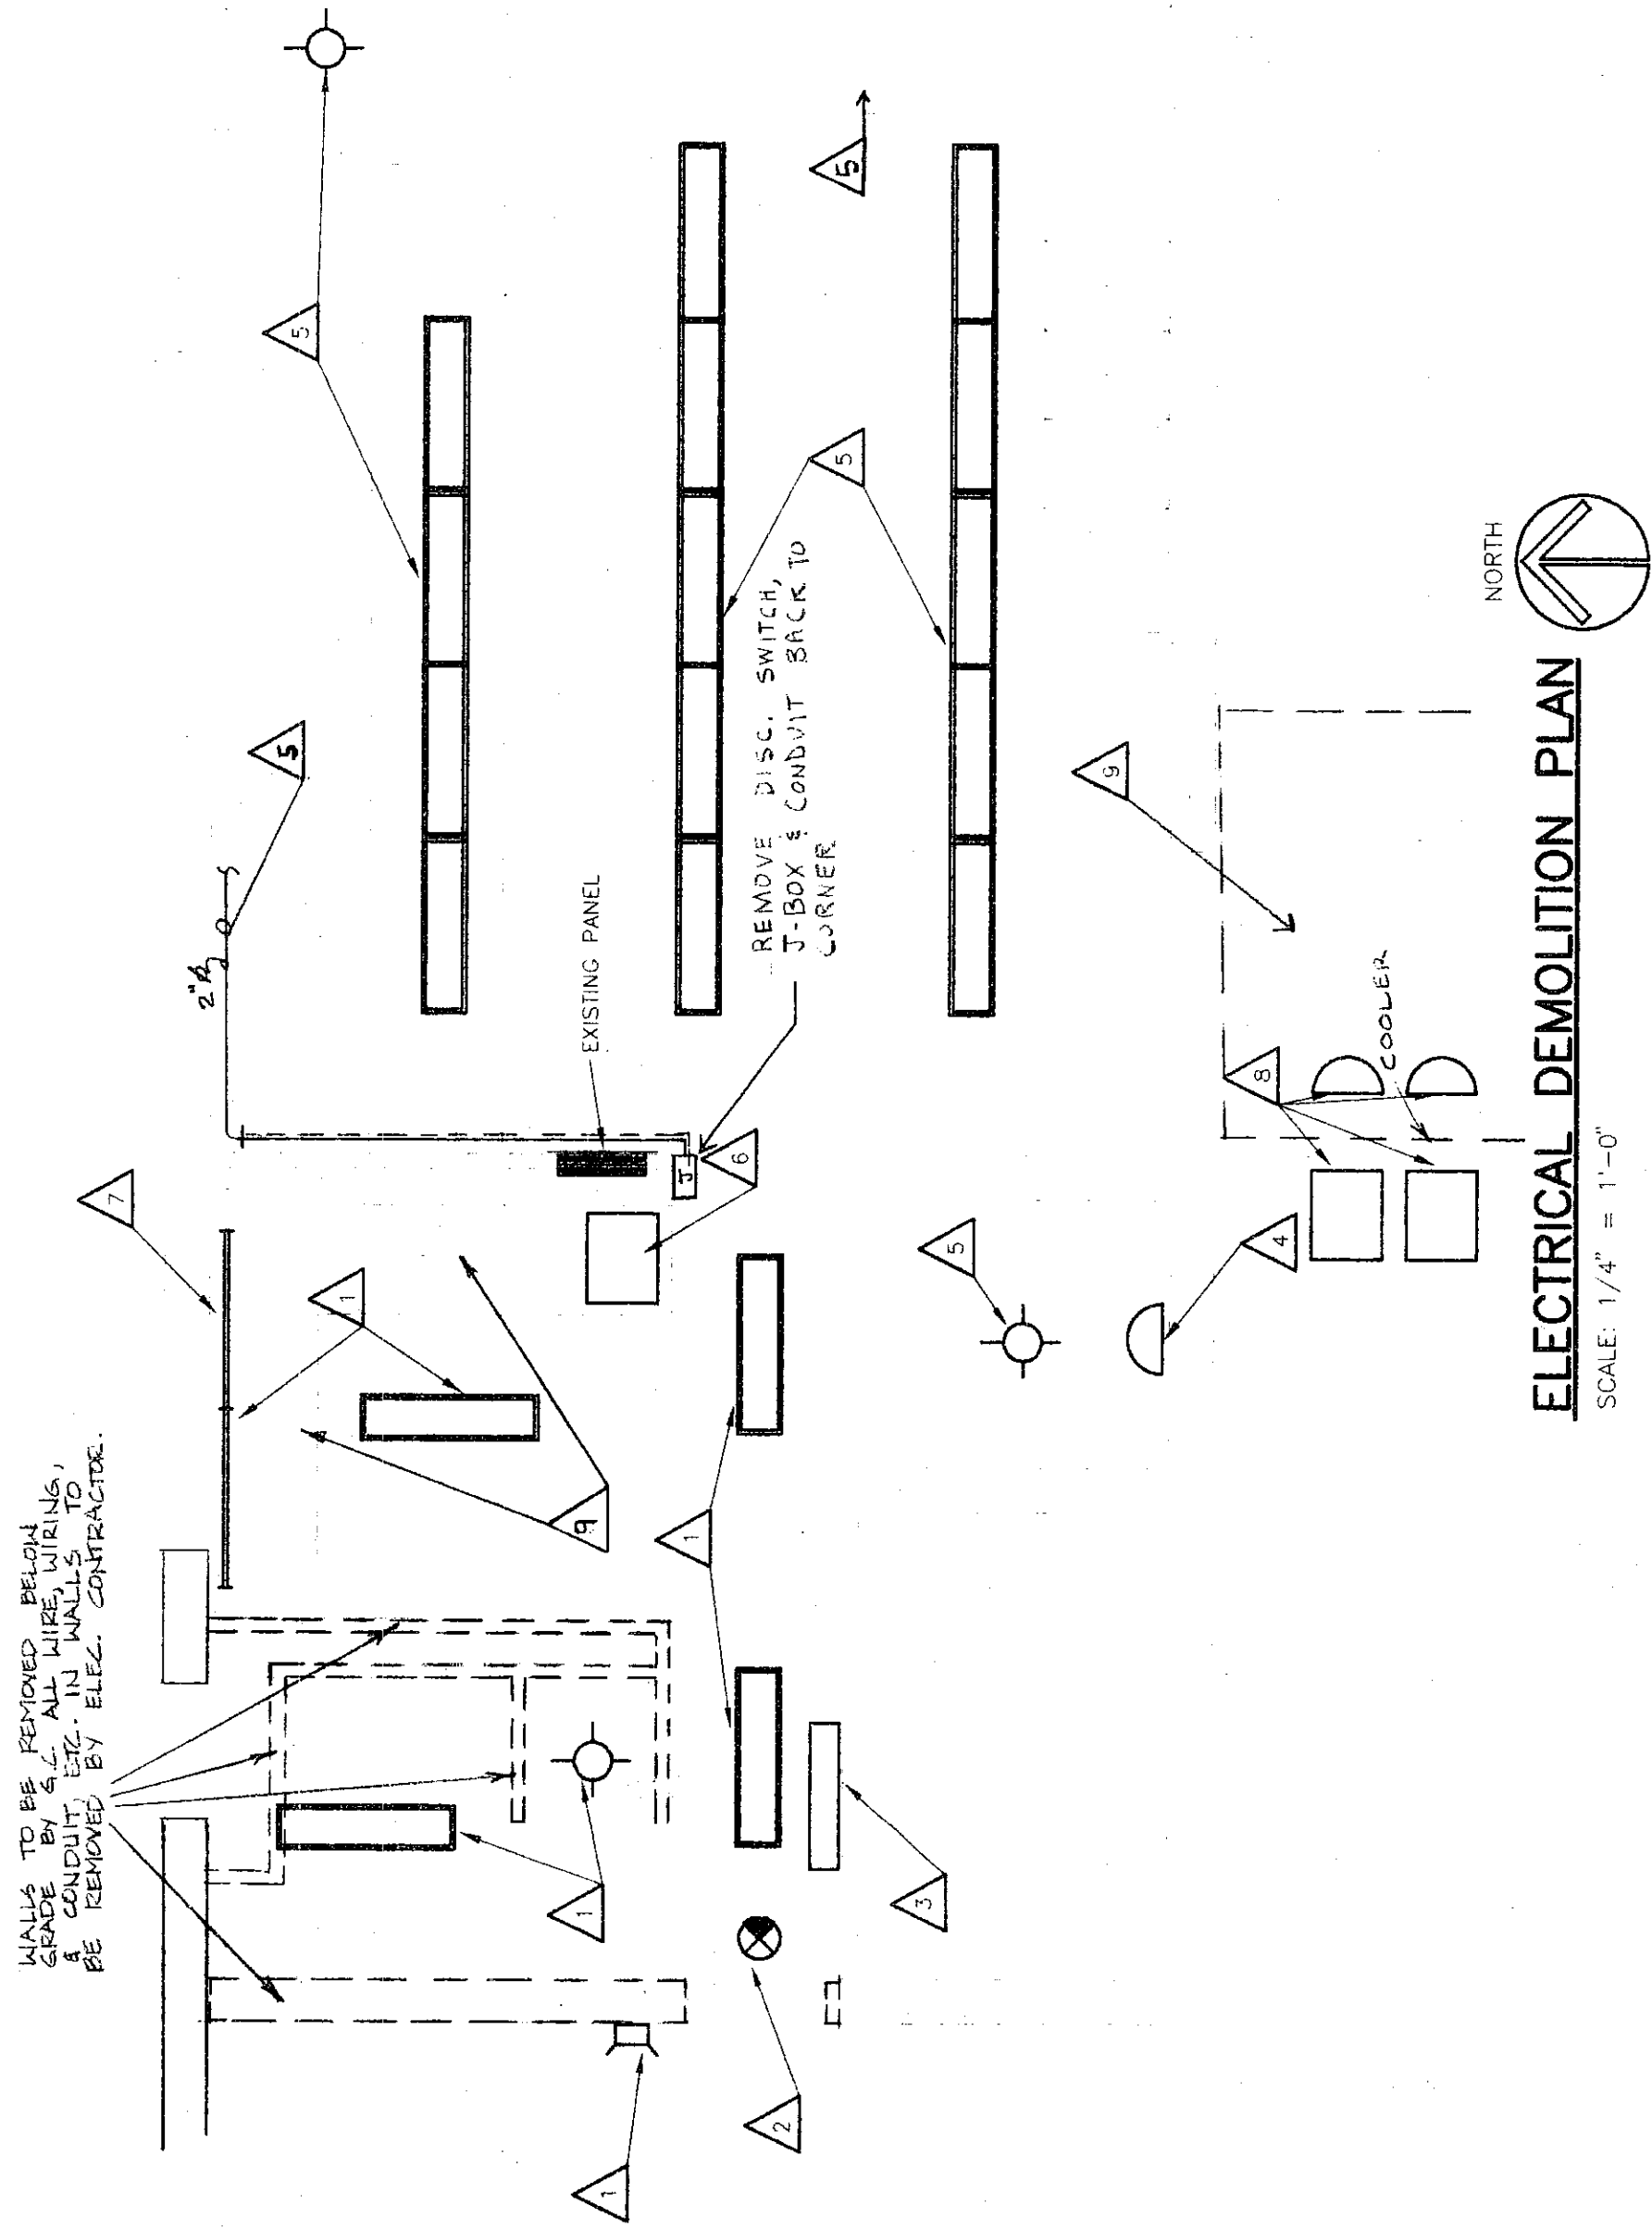


ELECTRICAL DEMOLITION NOTES

1. DISCONNECT AND REMOVE EXISTING LIGHT FIXTURE AND RELATED WIRING AND APPURTENANCES.
2. DISCONNECT AND REMOVE EXISTING EXIT LIGHT AND RELATED WIRING AND APPURTENANCES.
3. DISCONNECT AND REMOVE EXISTING WIRING TO CABINET HEATER AND ALL RELATED APPURTENANCES.
4. DISCONNECT AND REMOVE EXISTING ELECTRIC HEATER AND ALL RELATED WIRING AND APPURTENANCES.
5. EXISTING TO REMAIN.
6. DISCONNECT EXISTING BOOSTER HEATER, EXTEND FEEDER (3/4"Ø IN 2" C.) TO NEW PANEL RPT.
7. DISCONNECT DISHWASHER AND REMOVE ALL CONDUIT AND WIRE.
8. DISCONNECT MECH. EQUIPMENT, REMOVE ALL ASSOCIATED CONDUIT AND WIRE TO cooler.
9. DISCONNECT DISHWASHER, SMALL BOOSTER HEATER AND MISC. KITCHEN EQUIPMENT AS REQUIRED. REMOVE BRANCH CIRCUITS BACK TO EXISTING PANEL.

ELECTRICAL GENERAL DEMOLITION NOTES

1. THE ELECTRICAL DRAWINGS INDICATE EXISTING ELECTRICAL ITEMS TO BE REMOVED. THE DRAWINGS ARE INTENDED TO INDICATE THE TYPE OF WORK REQUIRED AND DO NOT INDICATE EVERY BOX, CONDUIT OR WIRE THAT MUST BE REMOVED. THE ELECTRICAL CONTRACTOR SHALL VISIT THE SITE PRIOR TO SUBMITTING A BID AND VERIFY EXISTING CONDITIONS.
2. ELECTRICAL ITEMS (LIGHT FIXTURES, ETC.) REMOVED AND NOT RELOCATED SHALL BE RESPONSIBLE FOR THE DISPOSAL OF MATERIAL AND SCRAP. THE OWNER DOES NOT WANT TO RETAIN OR REUSE. VERIFY, IN FIELD, THE ITEMS TO BE RETAINED WITH THE OWNERS REPRESENTATIVE.
3. THE ELECTRICAL CONTRACTOR SHALL OBTAIN APPROVAL FROM THE OWNER BEFORE TURNING OFF POWER TO CIRCUITS, FEEDERS, PANELS, ETC. WORK SHALL BE COORDINATED WITH THE OWNER TO MINIMIZE DISRUPTION TO NORMAL OPERATION.
4. THE ELECTRICAL CONTRACTOR SHALL COORDINATE ALL HIS WORK WITH THE MECHANICAL CONTRACTOR AND THE OTHER CONTRACTORS AT THE JOB SITE BEFORE REMOVING EXISTING ELECTRICAL AND INSTALLING NEW ITEMS.
5. WHERE LIGHTS, RECEPTACLES, ETC. ARE INDICATED AS BEING REMOVED, IT SHALL ALSO INCLUDE ALL ASSOCIATED CONDUIT AND WIRE TO THE PANELBOARD SERVING THE DEVICE. IF WIRING CAN BE REWORKED OR REMAIN TO SERVE NEW DEVICES OR LIGHTING BEING INSTALLED, WIRING SHALL REMAIN.
7. CONCEALED CONDUIT AND BOXES NOT REUSED SHALL REMAIN, BUT WIRE SHALL BE REMOVED. PROVIDE BLANK COVER PLATE OVER BOX OPENING.

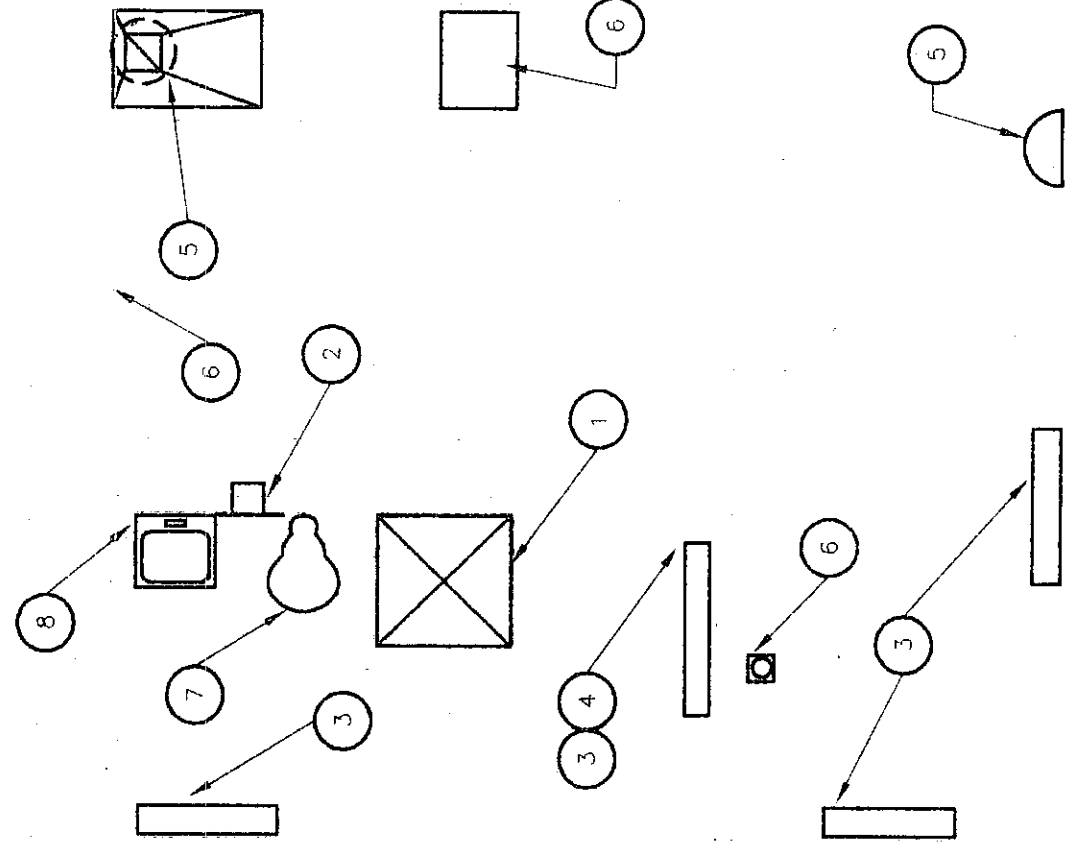

MECHANICAL GENERAL DEMOLITION NOTES

1. INSPECT ALL EQUIPMENT THAT IS TO BE RELOCATED OR REUSED. INFORM THE ENGINEER/OWNER OF ANY DAMAGED OR FAULTY COMPONENTS DISCOVERED DURING CONSTRUCTION.
2. WHERE REMOVAL OF PIPING, EQUIPMENT, ETC. IS NOTED, IT SHALL INCLUDE REMOVAL OF ALL ASSOCIATED APPURTENANCES, HANGERS, INSULATION, ETC. REMOVAL OF PIPING SHALL BE COMPLETE BACK TO THE MAIN LINE OR RISER, WHERE THE BRANCH CONNECTION SHALL BE CAPED OR PLUGGED. COORDINATE EXACT EXTENTS WITH NEW CONSTRUCTION.
3. THE OWNER RETAINS FIRST SALVAGE RIGHTS TO ALL EQUIPMENT. VERIFY IN FIELD THE ITEMS TO BE RETAINED WITH OWNERS REPRESENTATIVE. ALL OTHER MATERIALS SHALL BE REMOVED FROM THE SITE IMMEDIATELY.
4. COORDINATE SCHEDULE OF DEMOLITION WORK WITH OTHER TRADES. COORDINATE SHUT-DOWN OF MAIN SERVICES WITH OWNER (IE - COLD WATER, ETC.).
5. ANY ITEMS TO REMAIN THAT ARE DAMAGED BY THE MECHANICAL TRADE SHALL BE REPAIRED AT NO ADDITIONAL COSTS TO THE OWNER.
6. PIPING SHOWN ON DRAWINGS IS INTENDED TO INDICATE GENERAL PIPING EXTENT AND LOCATION. VERIFY EXISTING CONDITIONS, LOCATIONS, ARRANGEMENT, ETC.

MECHANICAL DEMOLITION NOTES

1. DISCONNECT AND REMOVE EXISTING SERVICE SINK AND ALL RELATED APPURTENANCES. CAP EXISTING PIPING BELOW FLOOR OR ABOVE CEILING AS REQUIRED.
2. DISCONNECT AND REMOVE EXISTING EXHAUST FAN. CAP EXISTING DUCTWORK THAT REMAINS ABOVE CEILING.
3. DISCONNECT AND REMOVE EXISTING FIN RADIATION. CAP EXISTING PIPING THAT REMAINS IN WALL OR ABOVE CEILING.
4. DISCONNECT AND REMOVE EXISTING CABINET HEATER. CAP EXISTING PIPING THAT REMAINS IN WALL OR ABOVE CEILING.
5. DISCONNECT AND REMOVE EXISTING REFRIGERATION EQUIPMENT.
6. DISCONNECT EXISTING DISHWASHER DISPOSAL AND BOOSTER HEATER.
7. DISCONNECT AND REMOVE EXISTING WATER CLOSET AND ALL RELATED PIPING. CAP EXISTING WASTE, SUPPLY AND VENT PIPING ABOVE CEILING OR BELOW FLOOR AS REQUIRED.
8. DISCONNECT AND REMOVE EXISTING LAVATORY AND ALL RELATED PIPING. CAP EXISTING WASTE, SUPPLY AND VENT PIPING ABOVE CEILING OR BELOW FLOOR AS REQUIRED.
9. DISCONNECT EXISTING 3 COMPARTMENT SINK.

95-M-62

REVISIONS	B

