

ROOM	AREA	CEILING
E101	CLASSROOM	9'-0"
E102	CLASSROOM	9'-0"
E103	CLASSROOM	9'-0"
E104	CLASSROOM	9'-0"
E105	CLASSROOM	9'-0"
E106	CLASSROOM	9'-0"
E107	CLASSROOM	9'-0"
E108	CLASSROOM	9'-0"
E109	CLASSROOM	9'-0"
E110	CLASSROOM	9'-0"
E111	CLASSROOM	9'-0"
E112	CLASSROOM	9'-0"
E113	CLASSROOM	9'-0"
E114	CLASSROOM	9'-0"
E115	CLASSROOM	9'-0"
E116	CLASSROOM	9'-0"
E117	CLASSROOM	9'-0"
E118	CLASSROOM	9'-0"
E119	CLASSROOM	9'-0"
E120	CLASSROOM	9'-0"
E121	CLASSROOM	9'-0"
E122	CLASSROOM	9'-0"
E123	CLASSROOM	9'-0"
E124	CLASSROOM	9'-0"
E125	CLASSROOM	9'-0"
E126	CLASSROOM	9'-0"
E127	CLASSROOM	9'-0"
E128	CLASSROOM	9'-0"
E129	CLASSROOM	9'-0"
E130	CLASSROOM	9'-0"
E131	CLASSROOM	9'-0"
E132	CLASSROOM	9'-0"
E133	CLASSROOM	9'-0"
E134	CLASSROOM	9'-0"
E135	CLASSROOM	9'-0"
E136	CLASSROOM	9'-0"
E137	CLASSROOM	9'-0"
E138	CLASSROOM	9'-0"
E139	CLASSROOM	9'-0"
E140	CLASSROOM	9'-0"
E141	CLASSROOM	9'-0"
E142	CLASSROOM	9'-0"
E143	CLASSROOM	9'-0"
E144	CLASSROOM	9'-0"
E145	CLASSROOM	9'-0"

EQUIPMENT PLAN GENERAL NOTES


1. INDICATES SCHEDULED RESIDENTIAL AND SECURITY CASEWORK. REFER TO SPECIFICATION SECTION 11400 FOR SCHEDULE.
2. INDICATES SCHEDULED DIAGNOSTIC CASEWORK. REFER TO SPECIFICATION SECTION 11410 FOR SCHEDULE.
3. INDICATES SCHEDULED PHYSICAL EDUCATION CASEWORK. REFER TO SPECIFICATION SECTION 11420 FOR SCHEDULE.
4. INDICATES SCHEDULED MEDIA CENTER CASEWORK. REFER TO SPECIFICATION SECTION 12315 FOR SCHEDULE.
5. INDICATES SCHEDULED EDUCATIONAL CASEWORK. REFER TO SPECIFICATION SECTION 12324 FOR SCHEDULE.
6. INDICATES SCHEDULED SCIENCE CASEWORK. REFER TO SPECIFICATION SECTION 12345 FOR SCHEDULE.
7. INDICATES SCHEDULED MUSIC CASEWORK. REFER TO SPECIFICATION SECTION 12354 FOR SCHEDULE.
8. COUNTERTOPS SHALL BE PROVIDED WITH A 4" HIGH BACKSPLASH AND ENDGRIPS EXCEPT WHEN DETAILED OTHERWISE.
9. PROVIDE FILTERS AS REQUIRED BETWEEN CASEWORK UNITS AND OTHER WALL UNITS AND WALL.
10. PROVIDE CONTINUOUS COUNTERTOPS.
11. ALL EXPOSED EDGES AND BACKS SHALL BE FINISHED.
12. THE CABINET INSTALLER SHALL CALL OUT BETWEEN COUNTERTOPS AND BACKSPLASHES, ENDSPLASHES AND WALLS.
13. THE CABINET INSTALLER SHALL CALL OUT CASEWORK UNITS AS INSTALLED EQUIPMENT.
14. ALL WALL-MOUNTED CASEWORK SHALL BE MOUNTED WITH THE TOP @ 7'-0" A.F.F. UNLESS NOTED OTHERWISE.
15. SEE SHEET A7.26 FOR MOUNTING HEIGHTS.
16. ALL CASEWORK GAPS AND SPACES SHALL BE LOCKABLE - CABINETS NOTED TO RESIDE UNITS SHALL BE CONSTRUCTED TO ALLOW FOR DIVISION 15 FOR SINK SIZES AND COORDINATE WITH DIVISION 15 FOR SINK SIZES.
17. PROVIDE A FINISHED TOP ON ALL CABINETS THAT DO NOT HAVE A BULKHEAD ABOVE THEM.
18. PROVIDE ABOVE ALL WALL CABINETS BELOW BULKHEADS CLOSURE PIECE. REFER TO DETAIL 3-A7.29.
19. REFER TO DETAIL 4-A7.29 FOR WALL CABINET CONSTRUCTION.
20. VERIFY LOCATION OF TV MONITORS IN CLASSROOMS IF ALTERNATIVE FOR THE SLOPED PROJECTION SCREEN IS NOT ACCEPTED.

LOCKER LEGEND


- 1. 12" X 12" X 6" STANDARD LOCKERS. REFER TO DETAIL 3-A7.29 & SPEC. SECT. 10500.
- 2. 12" X 12" X 72" STANDARD LOCKERS WITH SLOPED TOPS - REFER TO DETAIL 3-A7.30 & SPEC. SECT. 10500.
- 3. 12" X 12" X 60" ATHLETIC LOCKERS WITH SLOPED TOPS - REFER TO DETAILS 1-A7.30 & 2-A7.30 AND SPEC. SECTION 10500.
- 4. 12" X 12" X 12" 5 TIER HIGH ATHLETIC LOCKERS WITH SLOPED TOPS - REFER TO DETAILS 1-A7.30 & 2-A7.30 AND SPEC. SECTION 10500.
- 5. 24" X 12" X 72" ATHLETIC LOCKERS WITH SLOPED TOPS - REFER TO DETAIL 3-A7.30 & SPEC. SECT. 10500.
- 6. 24" X 24" X 72" ATHLETIC LOCKERS WITH SLOPED TOPS - REFER TO DETAIL 3-A7.30 & SPEC. SECT. 10500.

CASEWORK NOTES

1. OPERABLE WALL, MODEL 932 - REFER TO SPEC. SECT. 10560. REFER TO ROOMS E101, E102, E115, AND E117.
2. 30TH, COUNTERTOP - PROVIDE IN COUNTERTOP A HOLE FOR A 24" DIA. CLEAR INSIDE DIA. GROMMET - REFER TO ROOMS E106, E108, E109, E112, E113, E116, AND E118.
3. ADJUSTABLE COUNTERTOP - PROVIDE ADJUSTMENT FOR (4) DIFFERENT HEIGHTS AT 28 1/4", 30", 32 1/4", AND 34".
4. UNIT HEIGHT HAS BEEN ADJUSTED TO 34" TO MEET AMERICANS WITH DISABILITIES ACT (ADA) PER SPEC. SECT. 12324 ARTICLE 1.08.1.
5. PROVIDE A TRACKSTRIP 4" BELOW ALL WALL CABINETS IN THIS ROOM.
6. PROVIDE THIS CASEWORK AS AN ALTERNATE. REFER TO ALTERNATIVES.
7. PROVIDE MONITOR CABINET (DETAIL 1B-A7.29) IN CLASSROOM WHERE INDICATED. ADJUST VISUAL DISPLAY BORDERS ADDITIONALLY. REFER TO ALTERNATIVES.
8. REFER TO ELECTRICAL DRAWINGS FOR LOCATION OF COMPUTER HUB, MODIFY CASEWORK ACCORDINGLY.

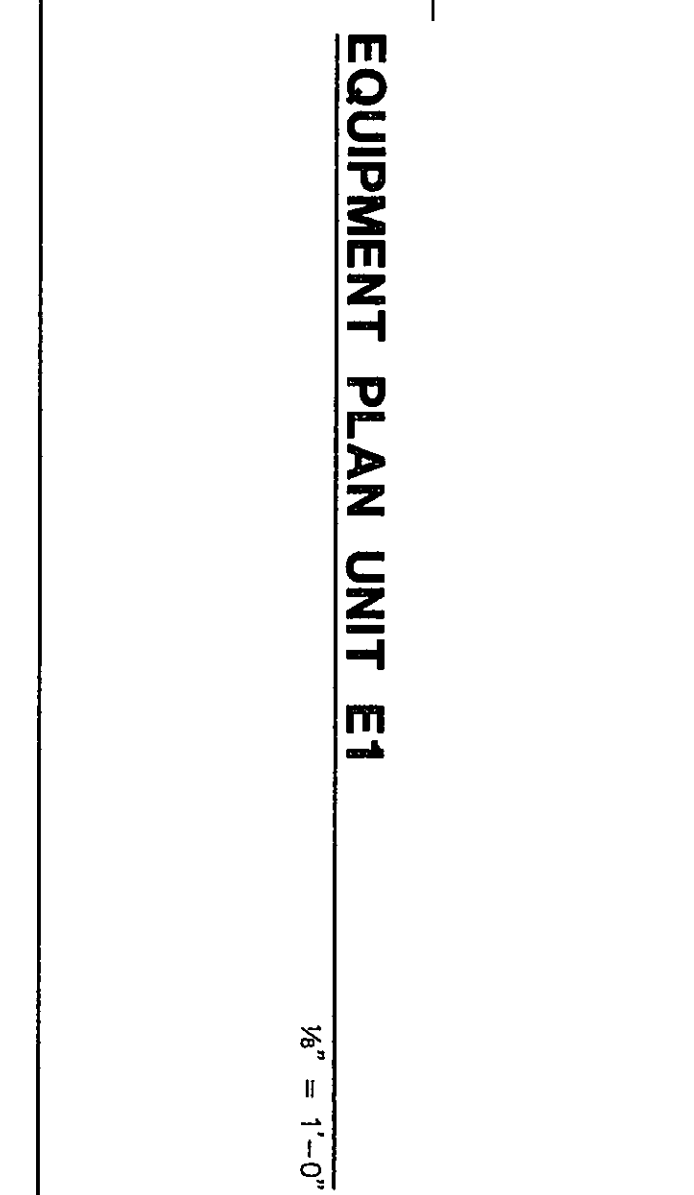


EQUIPMENT PLAN UNIT E1

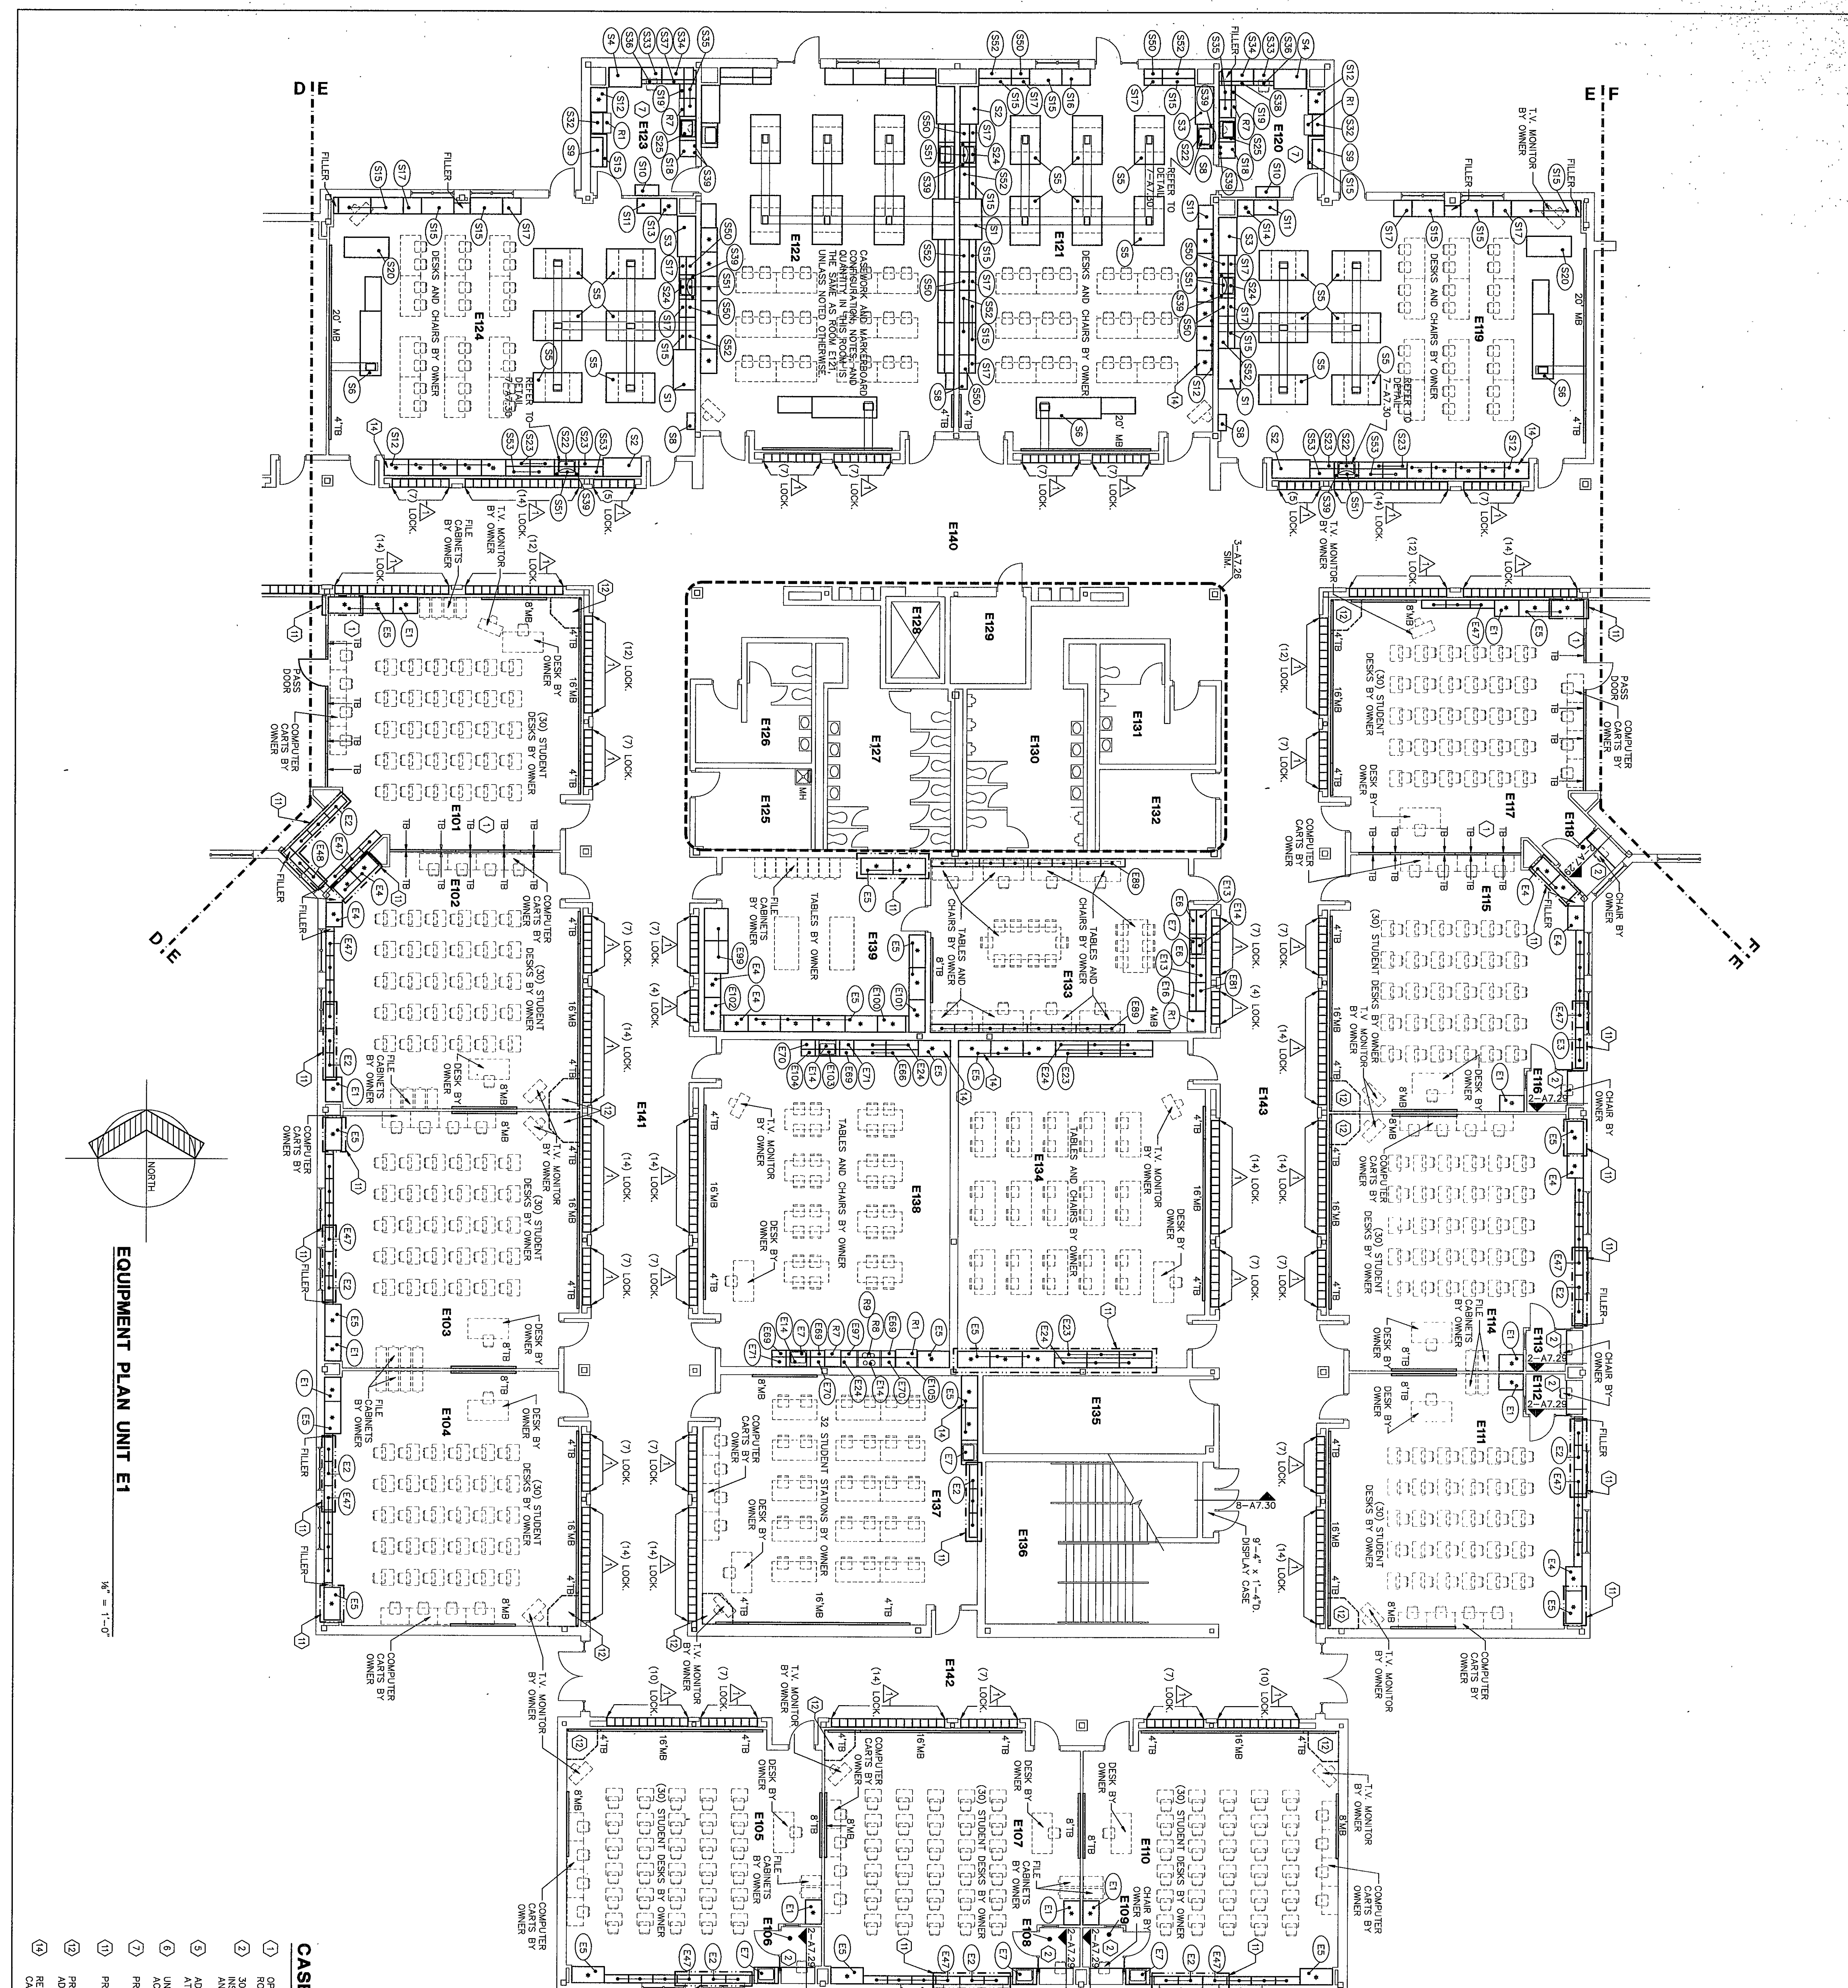

COPYRIGHT 1997 BY FANNING/HOWEY ASSOCIATES, INC.

THE NEW
CHESTERTON HIGH SCHOOL
 FOR THE
 DUNELAND SCHOOL CORPORATION
 CHESTERTON, INDIANA

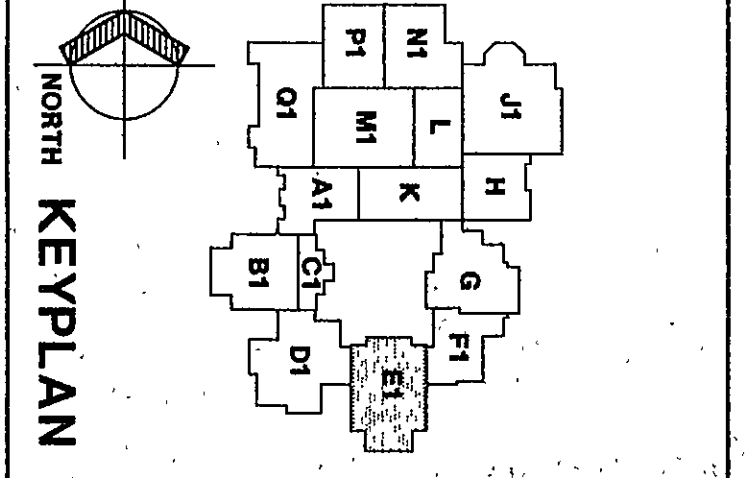

Fanning/Howey Associates, Inc.
 Architects Engineers Consultants

EQUIPMENT PLAN UNIT E1

DRAWN BY: LEC/SB COMM. NO.: 95067.00
 CHECKED BY: JHU DATE: APRIL 21, 1997

A7.8

REVISIONS NO. DATE

CHESTERTON HIGH SCHOOL
 95067.00