

PUMP BOARD PLAN TYPE : 1BL1		WELL TYPE : 3 PHASE, 4 WIRE + GND		MMS : 222 MLO RWD : 0.1A	
LOAD DESCRIPTION		C/O PUMP NO.	C/R CIR. NO.	PHASE	C/O AMP NO.
SPARE	1	1	2	A	1
SPARE	1	1	2	B	1
SPARE	1	1	2	C	1
RECEP.TS.	1	20	5	A	6
RECEP.TS.	1	20	5	B	6
RECEP.TS.	1	20	5	C	6
RECEP.TS.	1	20	11	A	12
RECEP.TS.	1	20	11	B	12
RECEP.TS.	1	20	11	C	12
RECEP.TS.	1	20	15	A	14
RECEP.TS.	1	20	15	B	16
RECEP.TS.	1	20	17	C	18
RECEP.TS.	1	20	13	A	20
RECEP.TS.	1	20	13	B	20
RECEP.TS.	1	20	13	C	20
RECEP.TS.	1	20	19	A	20
RECEP.TS.	1	20	21	B	20
RECEP.TS.	1	20	23	C	24
RECEP.TS.	1	20	25	A	26
RECEP.TS.	1	20	25	B	28
RECEP.TS.	1	20	29	C	30
RECEP.TS.	1	20	31	A	32
RECEP.TS.	1	20	33	B	34
RECEP.TS.	1	20	35	C	36
RECEP.TS.	1	20	35	A	20
RECEP.TS.	1	20	35	B	20
RECEP.TS.	1	20	35	C	20
RECEP.TS.	1	20	35	A	20
RECEP.TS.	1	20	35	B	20
RECEP.TS.	1	20	35	C	20
RECEP.TS.	1	20	35	A	20
RECEP.TS.	1	20	35	B	20
RECEP.TS.	1	20	35	C	20
RECEP.TS.	1	20	35	A	20
RECEP.TS.	1	20	35	B	20
RECEP.TS.	1	20	35	C	20
RECEP.TS.	1	20	35	A	20
RECEP.TS.	1	20	35	B	20
RECEP.TS.	1	20	35	C	20
RECEP.TS.	1	20	35	A	20
RECEP.TS.	1	20	35	B	20
RECEP.TS.	1	20	35	C	20
RECEP.TS.	1	20	35	A	20
RECEP.TS.	1	20	35	B	20
RECEP.TS.	1	20	35	C	20
RECEP.TS.	1	20	35	A	20
RECEP.TS.	1	20	35	B	20
RECEP.TS.	1	20	35	C	20
RECEP.TS.	1	20	35	A	20
RECEP.TS.	1	20	35	B	20
RECEP.TS.	1	20	35	C	20
RECEP.TS.	1	20	35	A	20
RECEP.TS.	1	20	35	B	20
RECEP.TS.	1	20	35	C	20
RECEP.TS.	1	20	35	A	20
RECEP.TS.	1	20	35	B	20
RECEP.TS.	1	20	35	C	20
RECEP.TS.	1	20	35	A	20
RECEP.TS.	1	20	35	B	20
RECEP.TS.	1	20	35	C	20
RECEP.TS.	1	20	35	A	20
RECEP.TS.	1	20	35	B	20
RECEP.TS.	1	20	35	C	20
RECEP.TS.	1	20	35	A	20
RECEP.TS.	1	20	35	B	20
RECEP.TS.	1	20	35	C	20
RECEP.TS.	1	20	35	A	20
RECEP.TS.	1	20	35	B	20
RECEP.TS.	1	20	35	C	20
RECEP.TS.	1	20	35	A	20
RECEP.TS.	1	20	35	B	20
RECEP.TS.	1	20	35	C	20

PANELBOARD		VOLTAGE: 3 PHASE, 4 WIRE + GND.		AMP: 325 M.O	
PLAN TYPE : FLS		200Y/120V NMD-SUF		ROOM : F120	
LOAD DESCRIPTION	P.O.E	C/R	PHASE	C/R	LOAD DESCRIPTION
SPARE	1	20	1	20	SPARE
SPARE	2	20	A	20	SPARE
SPARE	3	20	B	20	SPARE
SPARE	4	20	C	20	SPARE
COMBUSTIBLE RECEPT.	5	20		20	
TRACK LIGHTS	6	20	7	20	TRACK LIGHTS
TRACK LIGHTS	7	20	A	20	TRACK LIGHTS
TRACK LIGHTS	8	20	B	20	TRACK LIGHTS
TRACK LIGHTS	9	20	C	20	TRACK LIGHTS
TRACK LIGHTS	10	20		20	TRACK LIGHTS
TRACK LIGHTS	11	20	13	20	TRACK LIGHTS
TRACK LIGHTS	12	20	A	20	TRACK LIGHTS
TRACK LIGHTS	13	20	B	20	TRACK LIGHTS
TRACK LIGHTS	14	20	C	20	TRACK LIGHTS
TRACK LIGHTS	15	20		20	TRACK LIGHTS
TRACK LIGHTS	16	20	17	20	TRACK LIGHTS
TRACK LIGHTS	17	20	A	20	TRACK LIGHTS
TRACK LIGHTS	18	20	B	20	TRACK LIGHTS
TRACK LIGHTS	19	20	C	20	TRACK LIGHTS
TRACK LIGHTS	20	20		20	TRACK LIGHTS
TRACK LIGHTS	21	20	21	20	TRACK LIGHTS
TRACK LIGHTS	22	20	A	20	TRACK LIGHTS
TRACK LIGHTS	23	20	B	20	TRACK LIGHTS
TRACK LIGHTS	24	20	C	20	TRACK LIGHTS
TRACK LIGHTS	25	20		20	TRACK LIGHTS
SPARE	26	20	A	20	SPARE
SPARE	27	20	B	20	SPARE
SPARE	28	20	C	20	SPARE
SPARE	29	20		20	SPARE
SPARE	30	20	31	20	SPARE
SPARE	31	20	A	20	SPARE
SPARE	32	20	B	20	SPARE
SPARE	33	20	C	20	SPARE
SPARE	34	20		20	SPARE
SPARE	35	20	36	20	SPARE
SPARE	37	20	A	20	SPARE
SPARE	38	20	B	20	SPARE
SPARE	39	20	C	20	SPARE
SPARE	40	20		20	SPARE
SPARE	41	20	42	20	SPARE
SPARE	42	20		20	SPARE

FEED FROM : SEE R1SER

CONNECTED LOAD KYA : 22.4

LOAD KYA : 16.0

RECEPT : 0.0

MOTORS : 0.0

SPARE : 6.0


MISC WIRING : 0.0

PROJECT NAME : HIGH SCHOOL

Y
GH SCHOOL

CORPORATION
INDIANA

COPYRIGHT 1997 BY FANNING/HOWEY ASS

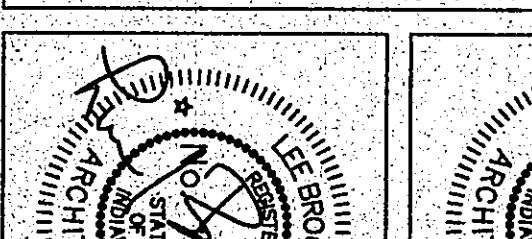

PANEL BOARD		VOLTAGE: 120V		WIRE # 600.		MMS: 225 IN LO	
PLAN TYPE: 16.3		300Y/120V NMD		SURF.		ROOM: 1.131	
LOAD DESCRIPTION	POL	C/O	C/R	PHASE	C/R	C/O	C/R
	NO.	NO.	NO.		NO.	NO.	NO.
SPARE	1	20	1	A	2	20	1
SPARE	1	20	5	A	6	20	1
RECEP'S.	1	20	9	A	10	20	1
RECEP'S.	1	20	1	B	12	20	1
RECEP'S.	1	20	13	A	14	20	1
RECEP'S.	1	20	15	A	16	20	1
RECEP'S.	1	20	17	C	18	20	1
RECEP'S.	1	20	19	A	20	20	1
RECEP'S.	1	20	21	B	22	20	1
RECEP'S.	1	20	23	C	24	20	1
RECEP'S.	1	20	25	A	26	20	1
RECEP'S.	1	20	27	A	28	20	1
RECEP'S.	1	20	29	B	30	20	1
RECEP'S.	1	20	31	A	32	20	1
RECEP'S.	1	20	33	B	34	20	1
HAND DRYER	1	25	35	C	36	20	1
HAND DRYER	1	25	37	A	38	20	1
EF-618, 63	1	20	39	B	40	20	1
EF-621	1	20	41	C	42	20	1
FEED FROM: 1ST RISER							
FEED FROM: 1ST RISER							
CONNECTED LOAD KVA:							
54.7							
LOADS KVA:							
0.0 LIGHTS							
21.7 RECEPT							
4.6 MISCELLANEOUS							
2.4 MOTORS							
0.0 SPARE							
PROJECT NAME:							
CHESTERTON							
HIGH SCHOOL							
CH-63, 64, F3 F9							
EF-618, 63							
SPARE: 012							

PANEL BOARD : 100L5										VOLTAGE : 3 PHASE, 4 WIRE + GND.										AMP'S 225 MLO	
PLAN TYPE : 100L5										208V/200V/200V/200V										RUM : 6131	
LOAD DESCRIPTION		C/B	C/B	C/R	C/R	C/R	C/B	C/B	LOAD DESCRIPTION	C/B		C/B	C/R	C/R	C/R	C/B	C/B				
AMP	POLE	AMP	NO.	PHASE	NO.	AMP	POLE	AMP	NO.	PHASE	NO.	AMP	POLE	AMP	NO.	PHASE	NO.				
SPARE	1	20	1	A	1	20	1	20	1	A	1	20	1	20	1	A	1				
SPARE	1	20	3	B	3	20	1	20	3	B	3	20	1	20	3	B	3				
SPARE	1	20	5	C	5	20	1	20	5	C	5	20	1	20	5	C	5				
RECEP'S	1	20	7	A	7	20	1	20	7	A	7	20	1	20	7	A	7				
DRIP COND	1	20	11	B	11	20	1	20	11	B	11	20	1	20	11	B	11				
RECEP'S	1	20	13	A	13	20	1	20	13	A	13	20	1	20	13	A	13				
RECEP'S	1	20	17	B	17	20	1	20	17	B	17	20	1	20	17	B	17				
RECEP'S	1	20	19	A	19	20	1	20	19	A	19	20	1	20	19	A	19				
RECEP'S	1	20	21	B	21	20	1	20	21	B	21	20	1	20	21	B	21				
RECEP'S	1	20	23	C	23	20	1	20	23	C	23	20	1	20	23	C	23				
RECEP'S	1	20	25	A	25	20	1	20	25	A	25	20	1	20	25	A	25				
RECEP'S	1	20	27	B	27	20	1	20	27	B	27	20	1	20	27	B	27				
RECEP'S	1	20	29	C	29	20	1	20	29	C	29	20	1	20	29	C	29				
RECEP'S	1	20	31	A	31	20	1	20	31	A	31	20	1	20	31	A	31				
RECEP'S	1	20	33	B	33	20	1	20	33	B	33	20	1	20	33	B	33				
RECEP'S	1	20	35	C	35	20	1	20	35	C	35	20	1	20	35	C	35				
SPARE	1	20	37	A	37	20	1	20	37	A	37	20	1	20	37	A	37				
SPARE	1	20	39	B	39	20	1	20	39	B	39	20	1	20	39	B	39				
SPARE	1	20	41	C	41	20	1	20	41	C	41	20	1	20	41	C	41				

FEED FROM : SEE RISER
CONNECTED LOAD WVA : 18.9

LOADS WVA:
12.8 RECEPT
0.0 WATERS
0.0 MISCELLANEOUS

PROJECT NAME: H-10
DESIGN: H-10

PLANT BOARD										VOL. TRANS. 3 PHASE A W/RE + GND.				MMS. 226 IN. O. ROUN. 0.131	
PLAN TYPE: 10.1.7										208V/120V NMDU. 100%.					
LOAD DESCRIPTION		C/B AMP.	C/B NO.	C/R NO.	PHASE	C/R. AMP.	C/B AMP.	C/B NO.	LOAD DESCRIPTION						
SPARE		20	1		A	2	20	1	SPARE						
SPARE		20	5		B	6	20	1	SPARE						
RECEPIS		20			A	6	20	1	RECEPIS						
RECEPIS		20			B	10	20	1	RECEPIS						
RECEPIS		20	11		A	12	20	1	RECEPIS						
RECEPIS		20			B	12	20	1	RECEPIS						
RECEPIS		20	13		A	14	20	1	SPARE						
RECEPIS		20	15		B	16	20	1	RECEPIS						
RECEPIS		20	17		A	18	20	1	SPARE						
RECEPIS		20	19		A	22	20	1	SPARE						
RECEPIS		20	21		B	22	20	1	SPARE						
RECEPIS		20	23		A	24	20	1	SPARE						
RECEPIS		20	25		A	26	20	1	SPARE						
RECEPIS		20	27		B	28	20	1	SPARE						
RECEPIS		20	29		A	30	20	1	SPARE						
RECEPIS		20	31		B	32	20	1	SPARE						
RECEPIS		20	33		A	34	20	1	SPARE						
RECEPIS		20	35		B	36	20	1	SPARE						
RECEPIS		20	37		A	38	20	1	SPARE						
RECEPIS		20	39		B	39	20	1	SPARE						
SPARE		20	41		A	42	20	1	SPARE						
SPARE		20			B		20	1	SPARE						

FEED FROM: SEE RASER
CONNECTED LOAD VISA
21.8

LOADED VIA:
0.0 LIGHTS
15.6 RECEPT
0.0 MISCELLANEOUS

PROJECT NAME:
DISSEMINATION
HIGH SCHOOL

PANEL BOARD		VOLTAGE: 3 PHASE, 4 WIRE, 3 COND.				AMPS: 225 M.A.O	
PLANT TYPE: 1HL2		208V/120V MDOO. SHUF.				ROOM: H124	
LOAD DESCRIPTION	C/B POLE	C/R NO.	PHASE	C/R NO.	C/B AMP	LOAD DESCRIPTION	
SPACE	1	20	A	2	20	SPACE	
SPACE	1	20	B	4	20	SPACE	
SPACE	1	20	C	6	20	SPACE	
WATER HEATER	1	20	A	8	25	SPACE	
WATER HEATER	1	20	B	10	25	SPACE	
GEN. BLOCK HEATER	1	20	A	12	20	SPACE	
GEN. BLOCK HEATER	1	20	B	14	20	SPACE	
CH S	1	20	A	16	20	SPACE	
CH S	1	20	B	18	20	SPACE	
AIR PAPER	1	20	A	20	20	SPACE	
PUMP	1	20	B	22	20	SPACE	
TEMP CONT. PANEL	1	20	A	24	20	SPACE	
TEMP CONT. PANEL	1	20	B	26	20	SPACE	
TEMP CONT. PANEL	1	20	C	30	20	SPACE	
RECETS	1	20	A	28	20	SPACE	
RECETS	1	20	B	32	20	SPACE	
RECETS	1	20	C	36	20	SPACE	
SPACE	1	20	A	34	20	SPACE	
SPACE	1	20	B	38	20	SPACE	
SPACE	1	20	C	42	20	SPACE	
SPACE	1	20	A	40	20	SPACE	
SPACE	1	20	B	44	20	SPACE	
SPACE	1	20	C	48	20	SPACE	

FEED FROM: SEE RISER
CONNECTED LOAD KVA: 7.6
0.5 LIGHTS
3.5 MOTORS
6.0 SPARK

PROJECT NAME:
CHESTNUT
HIGH SCHOOL