


59

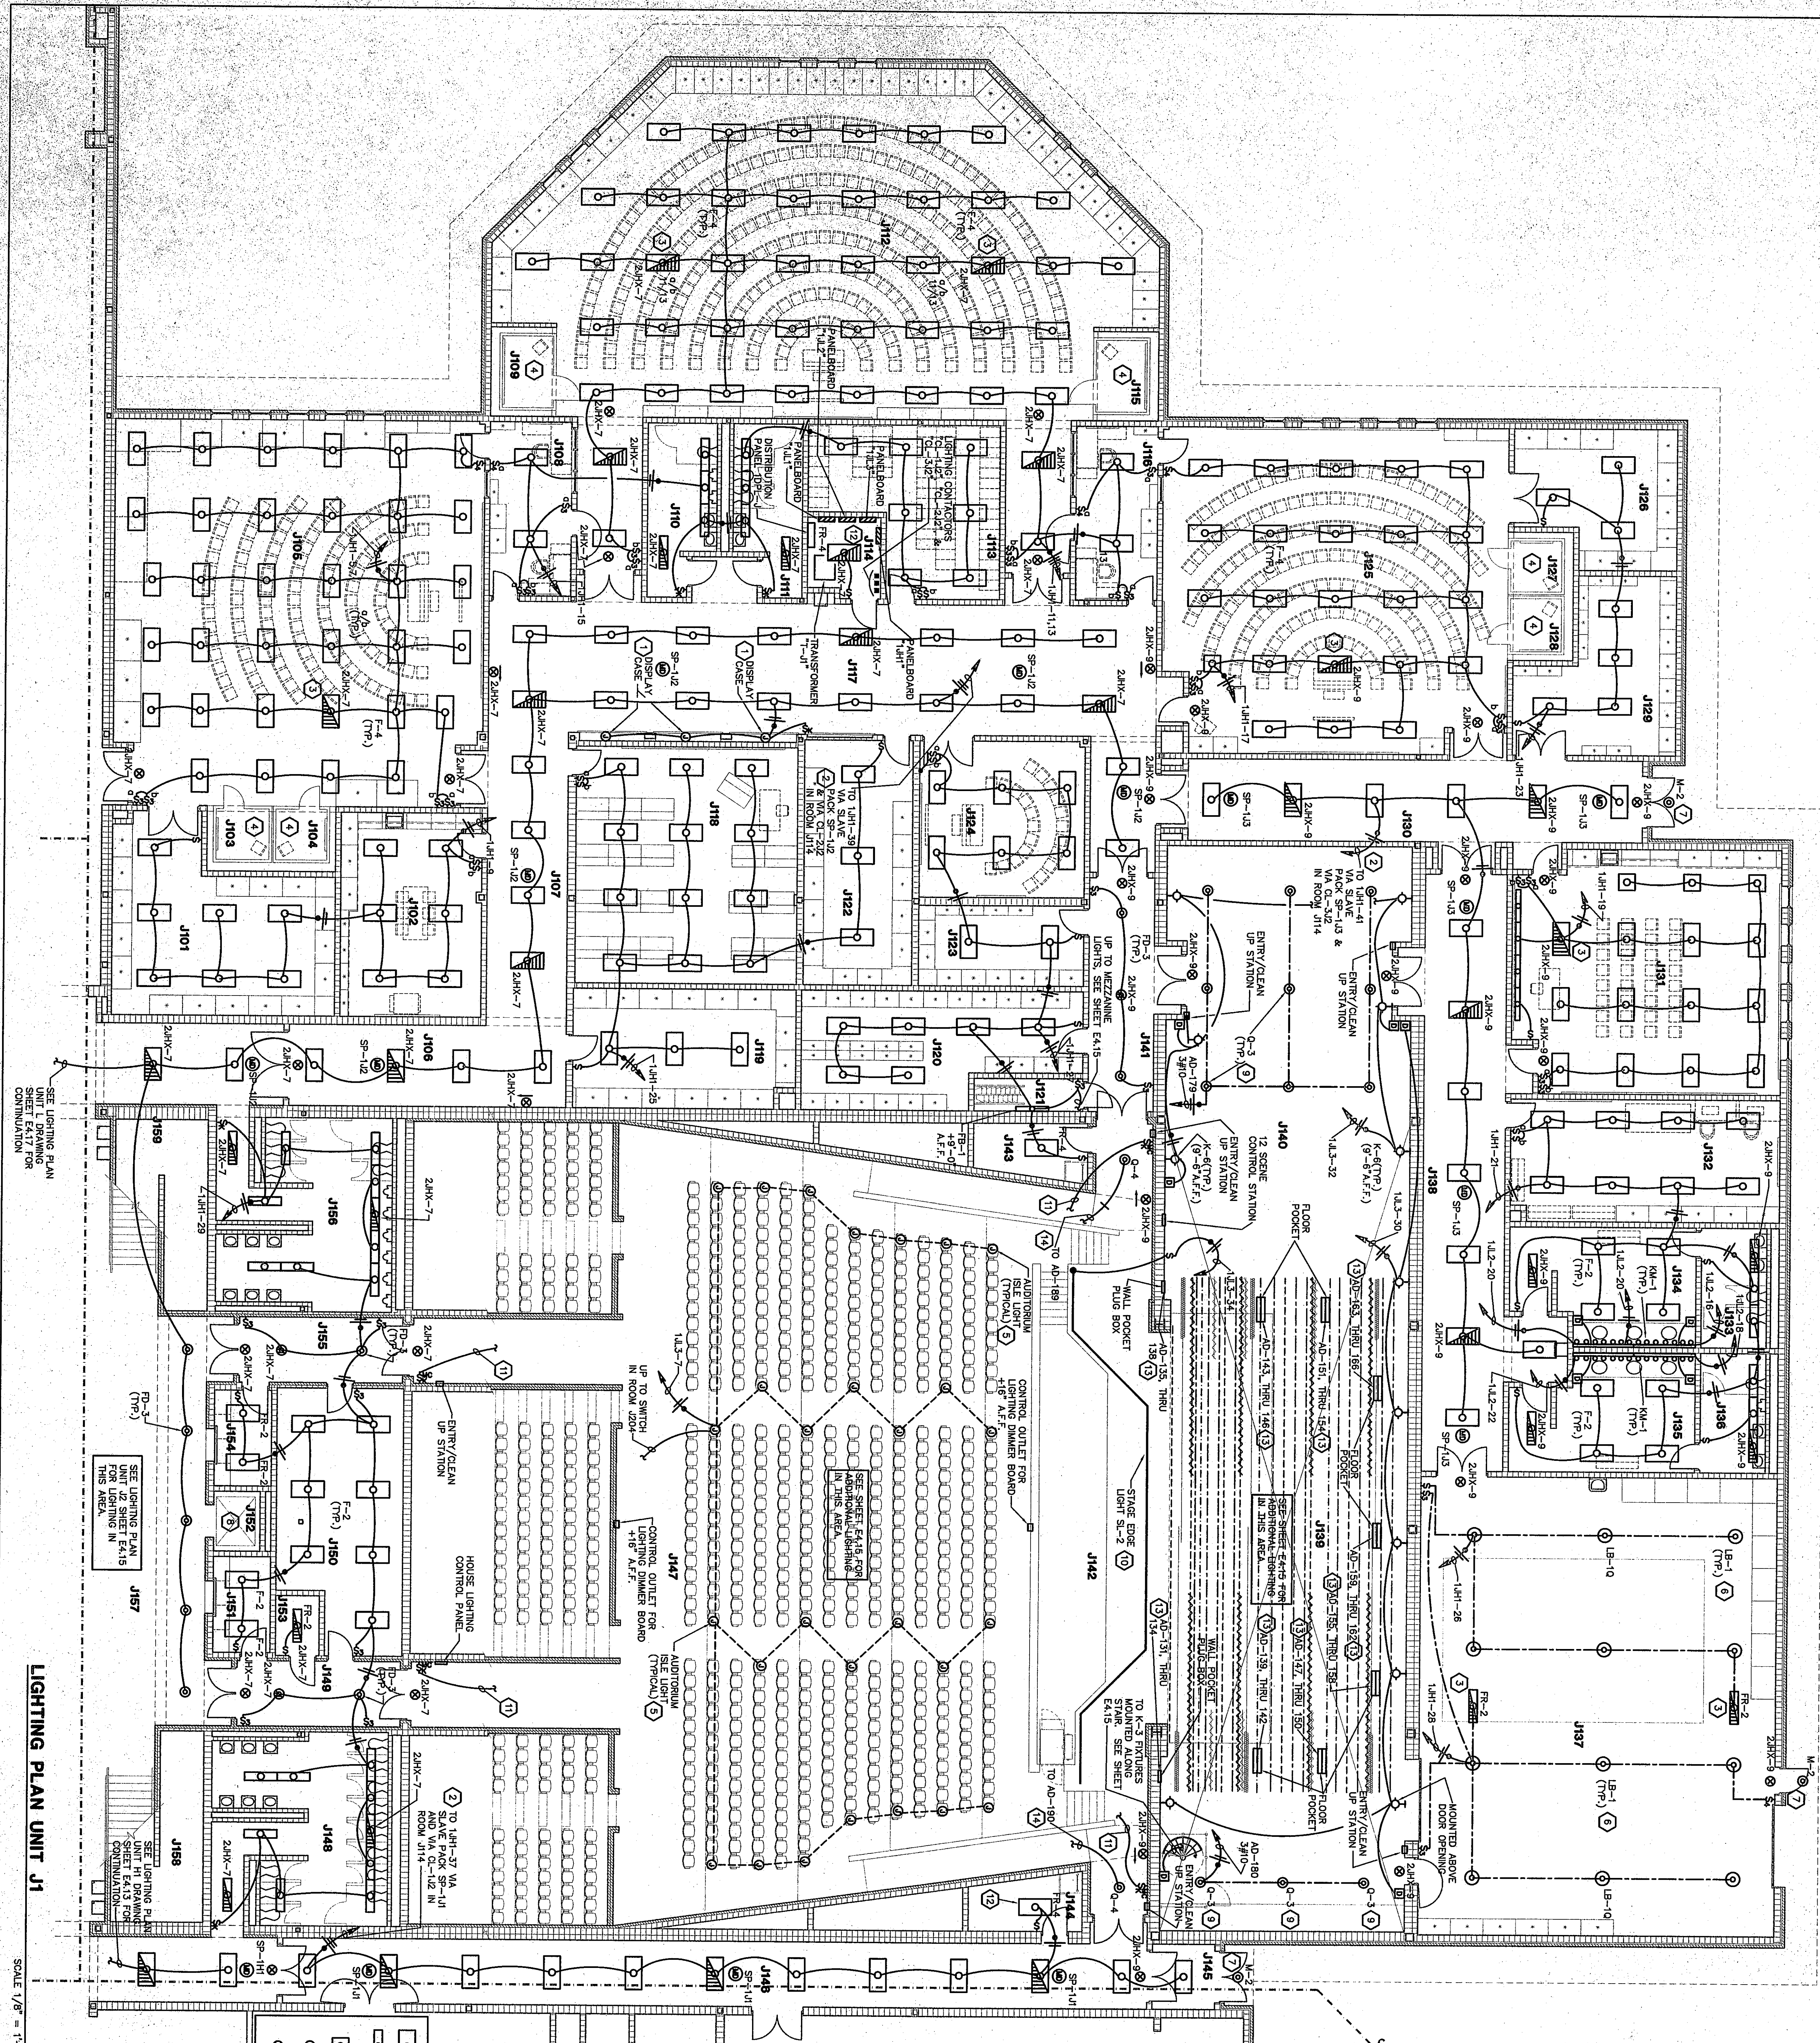


SEE LIGHTING PLAN UNIT 1 DRAWING SHEET E4.17 FOR CONTINUATION

SEE LIGHTING PLAN UNIT 1 DRAWING SHEET E4.18 FOR CONTINUATION

SEE LIGHTING PLAN UNIT 1 DRAWING SHEET E4.19 FOR CONTINUATION

SEE LIGHTING PLAN UNIT 1 DRAWING SHEET E4.20 FOR CONTINUATION

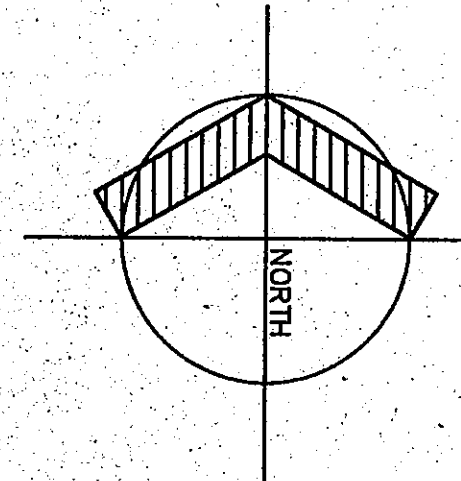

SCALE 1/8" = 1'-0"

- PLAN NOTES:**
1. PREMANUFACTURED DISPLAY CASE WITH LIGHT FIXTURE, LAMPS MOUNTED AND WIRE PER DETAIL 8/E1.4.
 2. PROVIDE THE EMERGENCY LIGHT FIXTURE WITH A CONTROL LIGHT FIXTURE, WIRE PER DETAIL 8/E1.5.
 3. MUSIC PRACTICE ROOMS, SEE SHEET E4.14 FOR WIRING REQUIREMENTS.
 4. AUDITORIUM SET LIGHT PROVIDED BY SEATING MANUFACTURER, DIVISION 16 SHALL WIRE EACH SET LIGHT PER DETAIL 8/E1.7.
 5. MOUNT BOTTOM OF LIGHT FIXTURE TYPE LB-1 AND RB-2 AT MOUNTING REQUIREMENTS DETAIL 8/E1.1 FOR LOW BAY.
 6. SECURITY LIGHTING, SEE SITE PLAN.
 7. SEE POWER PLAN UNIT J1, SHEET E4.14 FOR ELEVATOR PIT REQUIREMENTS.
 8. MOUNT LIGHT FIXTURE TYPE Q-3 AT 14'-0" ABOVE FINISH FLOOR.
 9. DIVISION 16 SHALL MOUNT STAGE EDGE LIGHT IN FLOOR 6" AWAY FROM EDGE OF ORCHESTRA PIT. SEE DETAIL 8/E1.3.
 10. MOMENTARY SWITCH TO CONTROL LIGHTING CONTACTOR C-11B, SEE LIGHTING PLAN UNIT 12 SHEET E4.15.
 11. MOUNT LIGHT FIXTURE TYPE RB-4 AT 4'-0" ABOVE FINISH FLOOR.
 12. RUN #10 AND WIRE (EACH CIRCUIT WITH FULL SIZE DEDICATED NEUTRAL) PLUS GROUND.
 13. WIRE FIXTURE Q-4 TO DIMMER PACK CIRCUIT AS INDICATED.
- ALL 2'x4' LIGHT FIXTURES SHALL BE PLAN TYPE F-3 UNLESS OTHERWISE NOTED.
ALL 1'x4' LIGHT FIXTURES SHALL BE PLAN TYPE F-1 UNLESS OTHERWISE NOTED.
ALL 2'x2' LIGHT FIXTURES SHALL BE PLAN TYPE F-22 UNLESS OTHERWISE NOTED.
ALL RECESS CAN LIGHTS SHALL BE PLAN TYPE RD-1 UNLESS OTHERWISE NOTED.
ALL EXIT SIGNS SHALL BE PLAN TYPE XB-1 UNLESS OTHERWISE NOTED.

ROOM LEGEND "J1"

ROOM NO.	ROOM NAME	AREA S.F.	CEILING HEIGHT
J101	PRACTICE ROOM	556	9'-4"
J102	PRACTICE ROOM	556	9'-4"
J103	PRACTICE ROOM	556	9'-4"
J104	PRACTICE ROOM	556	9'-4"
J105	PRACTICE ROOM	556	9'-4"
J106	PRACTICE ROOM	556	9'-4"
J107	PRACTICE ROOM	556	9'-4"
J108	PRACTICE ROOM	556	9'-4"
J109	PRACTICE ROOM	556	9'-4"
J110	PRACTICE ROOM	556	9'-4"
J111	PRACTICE ROOM	556	9'-4"
J112	PRACTICE ROOM	556	9'-4"
J113	PRACTICE ROOM	556	9'-4"
J114	PRACTICE ROOM	556	9'-4"
J115	PRACTICE ROOM	556	9'-4"
J116	PRACTICE ROOM	556	9'-4"
J117	PRACTICE ROOM	556	9'-4"
J118	PRACTICE ROOM	556	9'-4"
J119	PRACTICE ROOM	556	9'-4"
J120	PRACTICE ROOM	556	9'-4"
J121	PRACTICE ROOM	556	9'-4"
J122	PRACTICE ROOM	556	9'-4"
J123	PRACTICE ROOM	556	9'-4"
J124	PRACTICE ROOM	556	9'-4"
J125	PRACTICE ROOM	556	9'-4"
J126	PRACTICE ROOM	556	9'-4"
J127	PRACTICE ROOM	556	9'-4"
J128	PRACTICE ROOM	556	9'-4"
J129	PRACTICE ROOM	556	9'-4"
J130	PRACTICE ROOM	556	9'-4"
J131	PRACTICE ROOM	556	9'-4"
J132	PRACTICE ROOM	556	9'-4"
J133	PRACTICE ROOM	556	9'-4"
J134	PRACTICE ROOM	556	9'-4"
J135	PRACTICE ROOM	556	9'-4"
J136	PRACTICE ROOM	556	9'-4"
J137	PRACTICE ROOM	556	9'-4"
J138	PRACTICE ROOM	556	9'-4"
J139	PRACTICE ROOM	556	9'-4"
J140	PRACTICE ROOM	556	9'-4"
J141	PRACTICE ROOM	556	9'-4"
J142	PRACTICE ROOM	556	9'-4"
J143	PRACTICE ROOM	556	9'-4"
J144	PRACTICE ROOM	556	9'-4"
J145	PRACTICE ROOM	556	9'-4"
J146	PRACTICE ROOM	556	9'-4"
J147	PRACTICE ROOM	556	9'-4"
J148	PRACTICE ROOM	556	9'-4"
J149	PRACTICE ROOM	556	9'-4"
J150	PRACTICE ROOM	556	9'-4"
J151	PRACTICE ROOM	556	9'-4"
J152	PRACTICE ROOM	556	9'-4"
J153	PRACTICE ROOM	556	9'-4"
J154	PRACTICE ROOM	556	9'-4"
J155	PRACTICE ROOM	556	9'-4"
J156	PRACTICE ROOM	556	9'-4"
J157	PRACTICE ROOM	556	9'-4"
J158	PRACTICE ROOM	556	9'-4"
J159	PRACTICE ROOM	556	9'-4"
J160	PRACTICE ROOM	556	9'-4"
J161	PRACTICE ROOM	556	9'-4"
J162	PRACTICE ROOM	556	9'-4"
J163	PRACTICE ROOM	556	9'-4"
J164	PRACTICE ROOM	556	9'-4"
J165	PRACTICE ROOM	556	9'-4"
J166	PRACTICE ROOM	556	9'-4"
J167	PRACTICE ROOM	556	9'-4"
J168	PRACTICE ROOM	556	9'-4"
J169	PRACTICE ROOM	556	9'-4"
J170	PRACTICE ROOM	556	9'-4"
J171	PRACTICE ROOM	556	9'-4"
J172	PRACTICE ROOM	556	9'-4"
J173	PRACTICE ROOM	556	9'-4"
J174	PRACTICE ROOM	556	9'-4"
J175	PRACTICE ROOM	556	9'-4"
J176	PRACTICE ROOM	556	9'-4"
J177	PRACTICE ROOM	556	9'-4"
J178	PRACTICE ROOM	556	9'-4"
J179	PRACTICE ROOM	556	9'-4"
J180	PRACTICE ROOM	556	9'-4"
J181	PRACTICE ROOM	556	9'-4"
J182	PRACTICE ROOM	556	9'-4"
J183	PRACTICE ROOM	556	9'-4"
J184	PRACTICE ROOM	556	9'-4"
J185	PRACTICE ROOM	556	9'-4"
J186	PRACTICE ROOM	556	9'-4"
J187	PRACTICE ROOM	556	9'-4"
J188	PRACTICE ROOM	556	9'-4"
J189	PRACTICE ROOM	556	9'-4"
J190	PRACTICE ROOM	556	9'-4"
J191	PRACTICE ROOM	556	9'-4"
J192	PRACTICE ROOM	556	9'-4"
J193	PRACTICE ROOM	556	9'-4"
J194	PRACTICE ROOM	556	9'-4"
J195	PRACTICE ROOM	556	9'-4"
J196	PRACTICE ROOM	556	9'-4"
J197	PRACTICE ROOM	556	9'-4"
J198	PRACTICE ROOM	556	9'-4"
J199	PRACTICE ROOM	556	9'-4"
J200	PRACTICE ROOM	556	9'-4"

Lighting Plan Unit J1

DRAWN BY: MRS. COMM. NO.: 95067.00
CHECKED BY: WBH DATE: APRIL 21, 1997

E4.14

REVISIONS NO. DATE

Fanning/Howey Associates, Inc.

Architects Engineers Consultants

THE NEW CHESTERTON HIGH SCHOOL FOR THE DUNELAND SCHOOL CORPORATION CHESTERTON, INDIANA

COPYRIGHT 1997 BY FANNING/HOWEY ASSOCIATES, INC.