



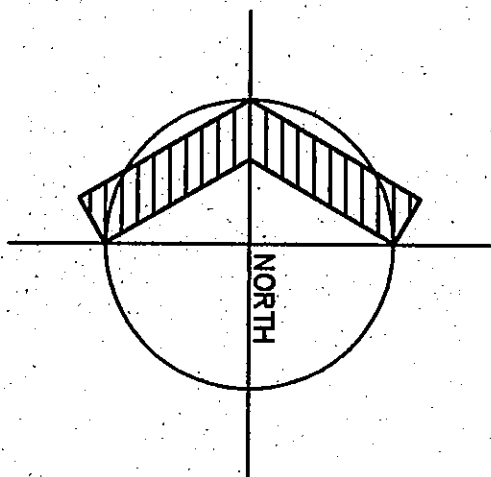


SCALE 1/8" = 1'-0"

PLAN NOTES:

- 1 MOUNT DUPLEX RECEPTACLE AT 16 INCHES ABOVE GRID IRON FLOOR.
- 2 MOUNT DUPLEX RECEPTACLE AT 16 INCHES ABOVE CATWALK FLOOR.
- 3 PROVIDE BLAST FURNACE RELAY SQUARE D MOTOR BLAST FURNACE STARTER TO BE INTERCONNECTED WITH MOTOR TERMINALS AND CONTROL CIRCUIT OF STARTER TO OPEN STARTER UPON SENSING PHASE LOSS.
- 4 VERIFY EXACT LOCATION OF FIRE CURTAIN MOTOR IN THE FIELD.

REVISIONS	NO.	DATE
-----------	-----	------

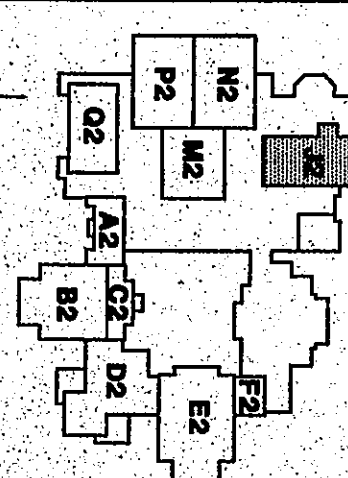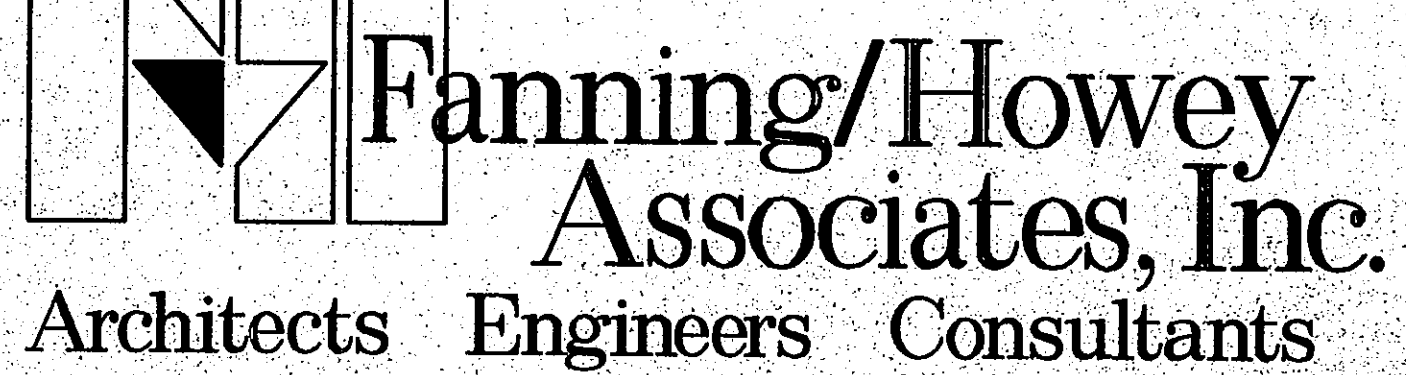

COPYRIGHT 1997 BY FANNING/HOWEY ASSOCIATES, INC.

