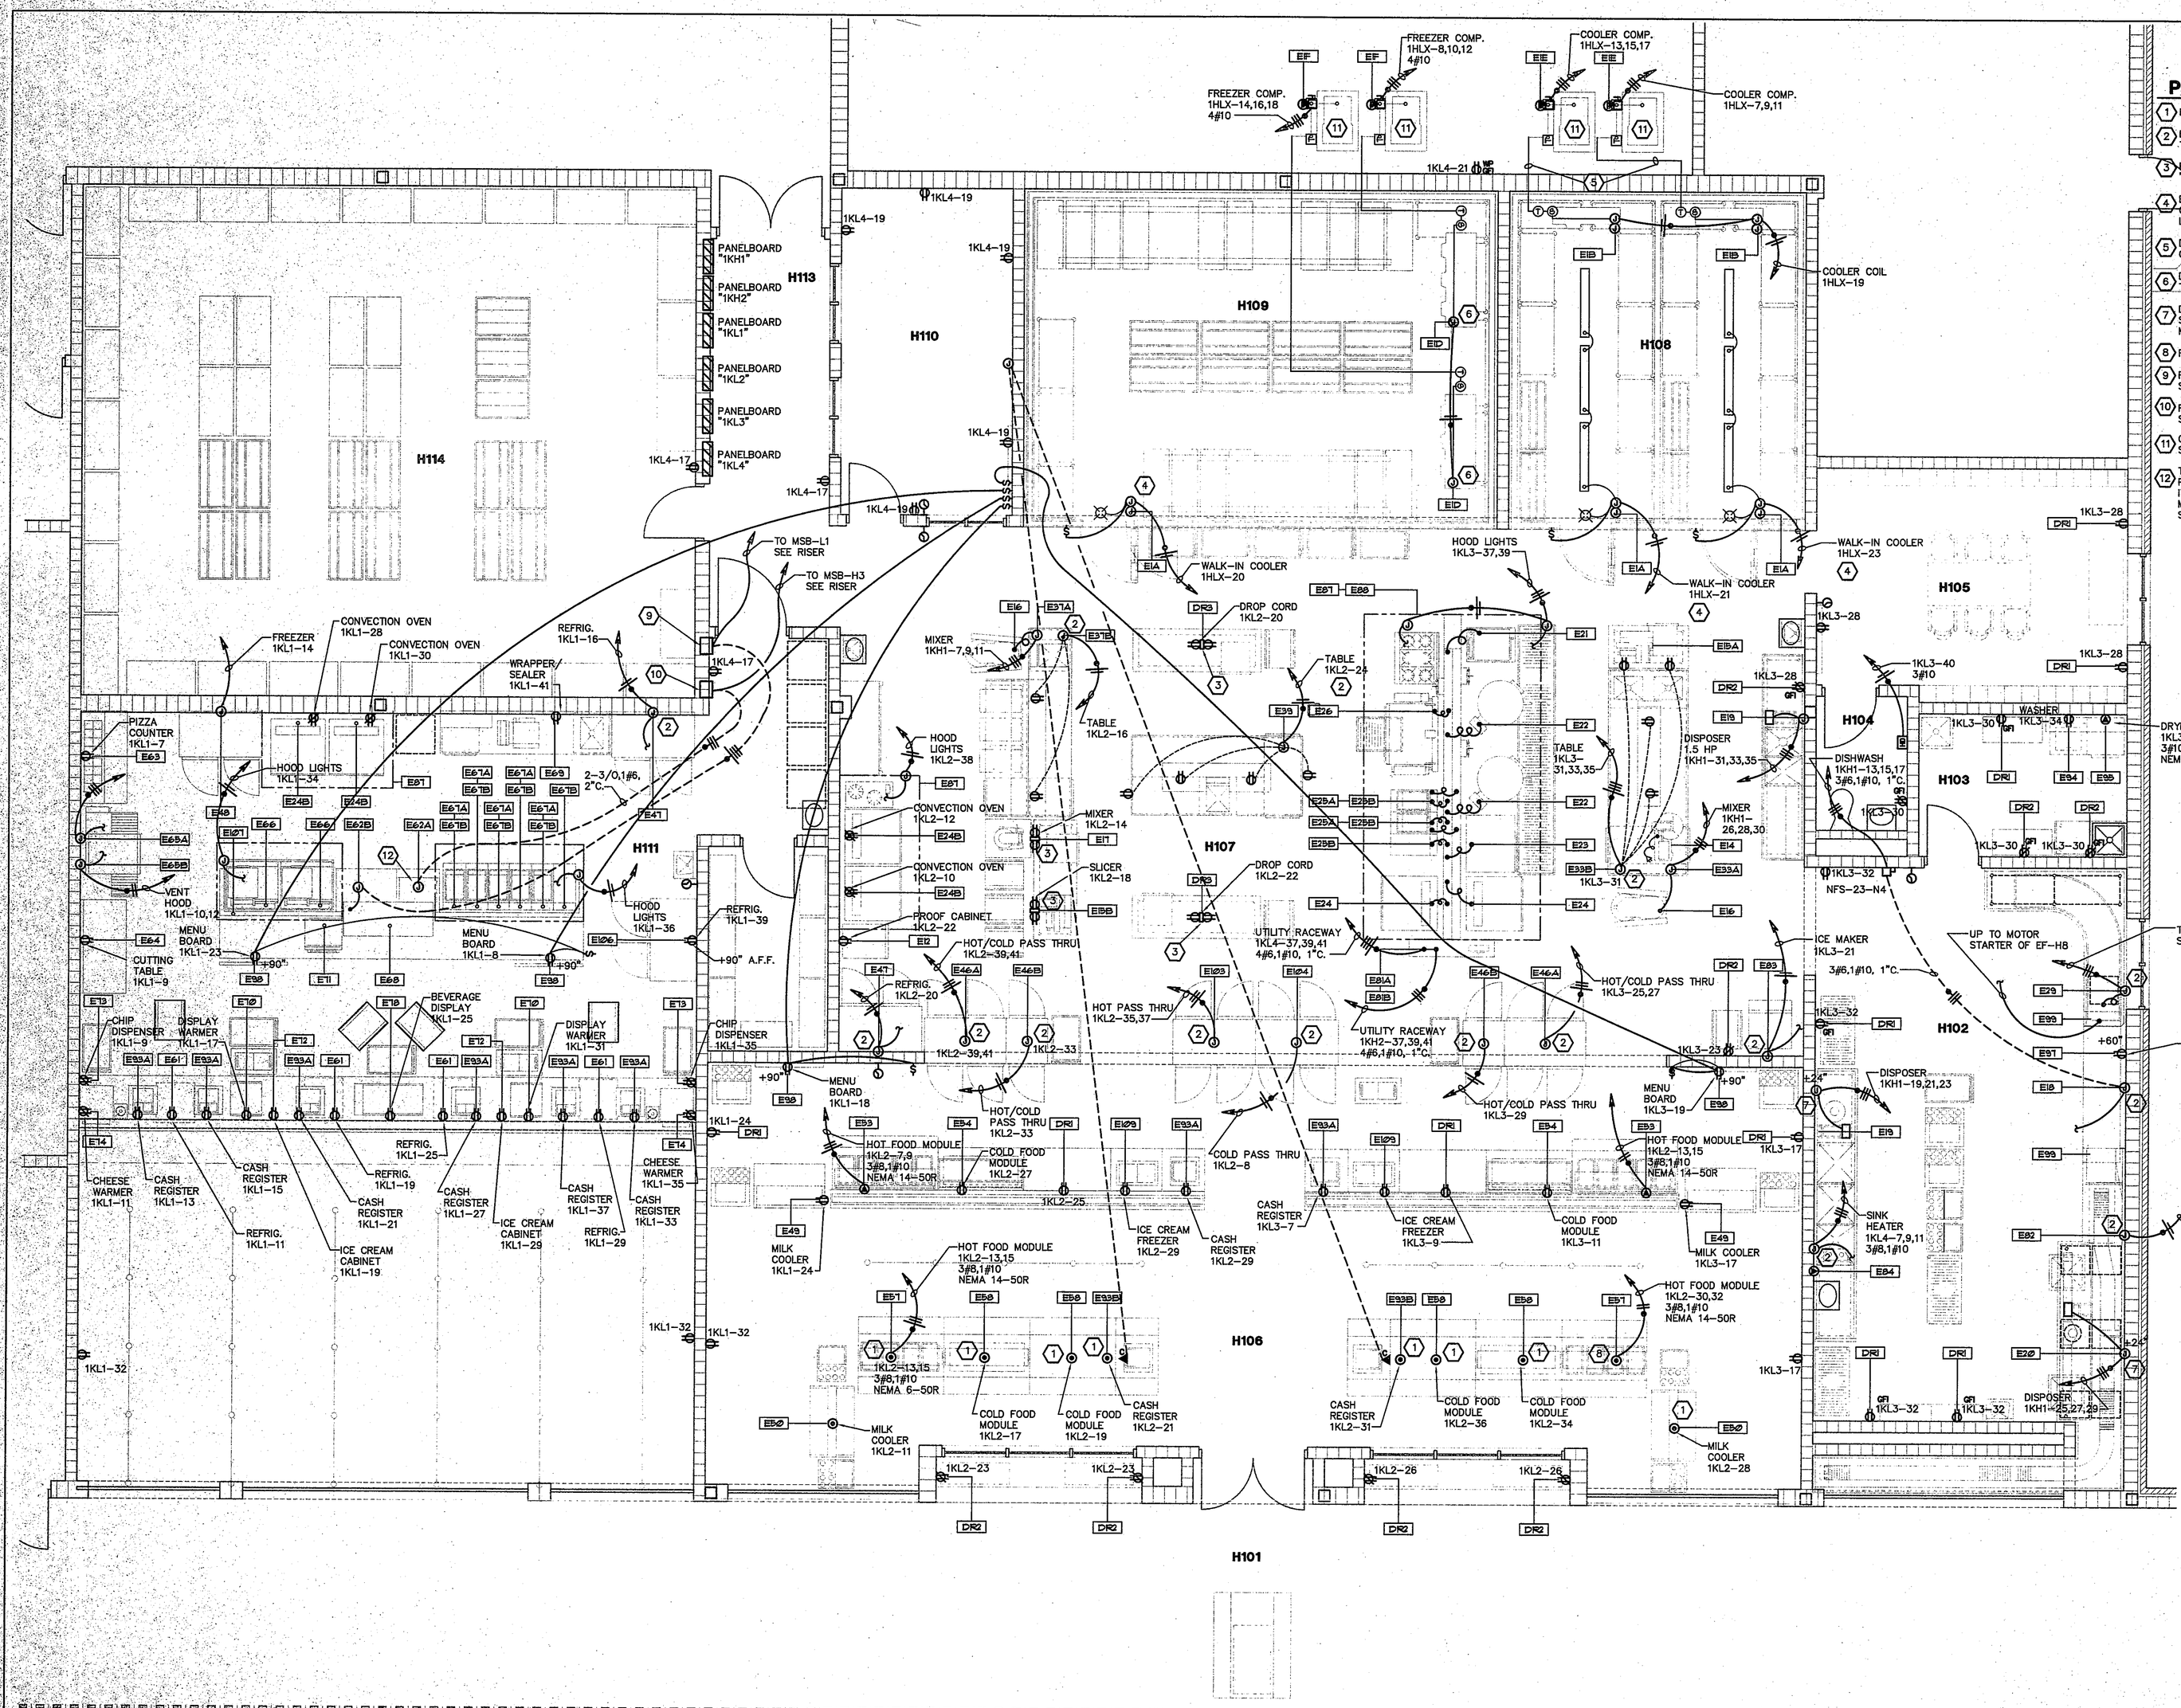

PLAN NOTES:

1. REFER TO DETAIL "8/E1.2" FOR RECEPTACLE MOUNTING.
2. DIV. 16 TO WIRE IN SEAL TIGHT CONDUIT FROM ROUGH-IN TO EQUIPMENT.
3. REEL DROP CORD RECEPTACLE REQUIRED. REFER TO DETAIL "2/E1.?".
4. DIV. 16 DROP FROM ABOVE AND WIRE TO JUNCTION BOX ON TOP OF COOLER OR FREEZER. WIRE FROM JUNCTION BOX TO UNIT LIGHT FIXTURE.
5. DIV. 16 TO WIRE, IN SEAL-TIGHT CONDUIT, FROM JUNCTION BOX ON COOLER TO REMOTE TIMER ON COOLER COMPRESSOR.
6. DIV. 16 TO WIRE DRAIN LINE HEATER TO FREEZER COIL "HOT" TERMINALS. REFER TO DETAIL "?/E1.?".
7. DIV. 16 TO WIRE FROM JUNCTION BOX TO CONTROL PANEL WITH SEAL-TIGHT CONDUIT. ALSO WIRE SOLENOID VALVE AND CONTROL MODULE.
8. REFER TO DETAIL 4/E1.2 FOR RECEPTACLE MOUNTING.
9. FLUSH MOUNTED 150A, 3P, 240V UNIT CIRCUIT BREAKER WITH SHUNT TRIP. PROVIDE NEMA 1 ENCLOSURE WITH GROUND LUG.
10. FLUSH MOUNTED 200A, 3P, 480V UNIT CIRCUIT BREAKER WITH SHUNT TRIP. PROVIDE NEMA 1 ENCLOSURE WITH GROUND LUG.
11. COOLER/FREEZER COMPRESSORS ARE LOCATED ON THE ROOF, SEE SHEET A2.1 (COLUMN LINES 137 AND AW) FOR LOCATIONS.
12. TERMINATE FEEDER AT LUGS OF UNIT MOUNTED BREAKER PANEL PROVIDED BY FOOD SERVICE EQUIPMENT SUPPLIER. SERVICE FOR ITEMS E66, E67A, E67B, E68 AND E71 ARE BY PREWIRED OUTLETS MOUNTED ON ITEM E62 BY THE FOOD SERVICE EQUIPMENT SUPPLIER.

KITCHEN ELECTRICAL PLAN

SCALE 1/4" = 1'-0"

COPYRIGHT 1997 BY FANNING/HOWEY ASSOCIATES, INC.

DOUGLAS M. WICKSTROM REGISTERED No. 10051 STATE OF INDIANA ARCHITECT

LEE BROCKSMITH REGISTERED No. 7866 STATE OF INDIANA ARCHITECT

THE NEW
CHESTERTON HIGH SCHOOL
FOR THE
DUNELAND SCHOOL CORPORATION
CHESTERTON, INDIANA



KEYPLAN

Fanning/Howey Associates, Inc.
Architects Engineers Consultants

KITCHEN ELECTRICAL PLAN	
DRAWN BY: VBH	COMM. NO: 95067.00
CHECKED BY:	DATE: APRIL 21, 1997
REVISIONS NO.	DATE
E6.1	

CHESTERTON HIGH SCHOOL
95067.00

97-E-94