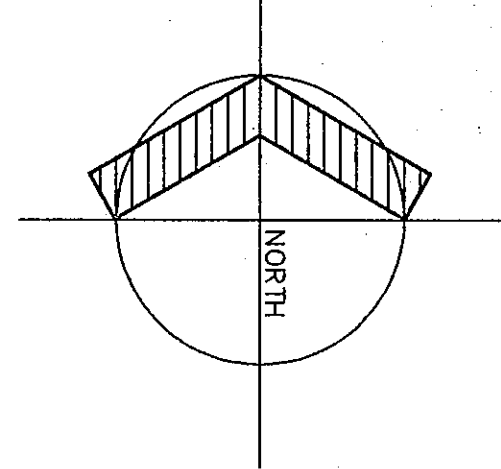




$$\underline{1/8'' = 1' - 0''}$$

REFER TO DWG. M2.14
FOR CONTINUATION.

1 ULTRA LOW LEAK MOTORIZED
CONTROL DAMPERS


1. ALL RECTANGULAR SUPPLY AND RETURN DUCTING IS TO BE PROTECTED WITH DUCTWRAP. ALL FRESH AIR INLET DUCTING IS TO BE PROTECTED WITH DUCTWRAP. ALL EXHAUST DUCTING IS TO BE WRAPPED WITH DUCTWRAP. ALL EXHAUST DUCTING IS TO BE WRAPPED WITH DUCTWRAP WITH THE EXCEPTION OF THE DUCT MADE UP AIR FAN. THE AIR FAN DUCT IS TO BE WRAPPED WITH DUCTWRAP. AFTER TO SPECIFICATION SECTION 15260 FOR DUCTWRAP REQUIREMENTS.
 2. TERMINAL UNITS FOR EXHAUST FANS AND RANGE HOODS TO SCREEN. SIZE SHOWN IS MINIMUM ACCEPTABLE SIZE.
 3. PROVIDE GROUND BLUE VOLTAGE DAMPERS ON ALL SUPPLY (MINIMUM RETURN GRILLE)
(MINIMUM RETURN GRILLE)
 4. PD-1 = 1 HR FIRE DAMPER ASSEMBLY
PD-2 = 2 HR FIRE DAMPER ASSEMBLY
PD-3 = 3 HR FIRE DAMPER ASSEMBLY
SD-1 = SMOKE DAMPER ASSEMBLY
 5. COORDINATE GRILLE & DIFFUSER LOCATIONS WITH REFLECTED CEILING AND ELECTRICAL PLANS. (DIFFUSERS TO BE MIN. 4'-0" FROM MONITOR DETECTORS)
 6. ALL LOW PRESSURE DUCT OFFSETS OVER PROJECTION SCREENS IN TYPICAL CLASSROOMS, TO BE ELIMINATED IN BASF BLD.
- INDICATES 1926 AIR TRANSFER OPENING IN WALL

NOTES

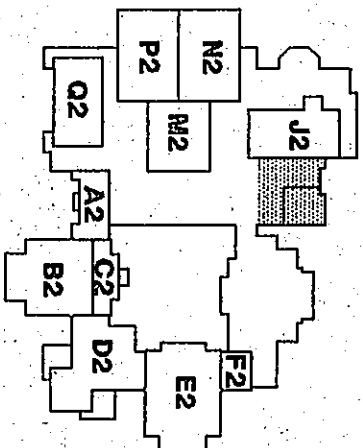

THE NEW
CHESTERTON HIGH SCHOOL
FOR THE
DUNELAND SCHOOL CORPORATION
CHESTERTON, INDIANA

COPYRIGHT 1997 BY FANNING/HOWEY ASSOCIATES, INC.

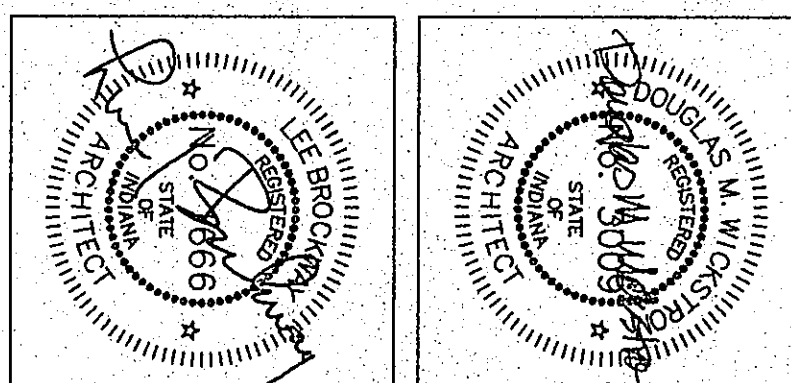


VENTILATION PLAN UNIT "H2"

DRAWN BY: SCB	COMM. NO.: 95067.00
CHECKED BY: CAM	DATE: APRIL 21, 1997

M2.15

REVISIONS	NO.	DATE
-----------	-----	------

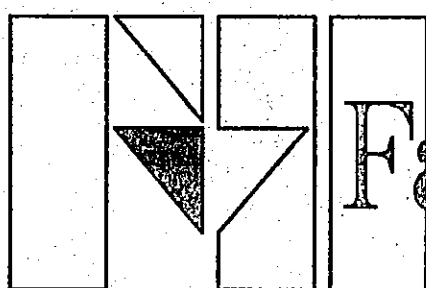

**Fanning/Howey
Associates, Inc.**
Architects Engineers Consultants