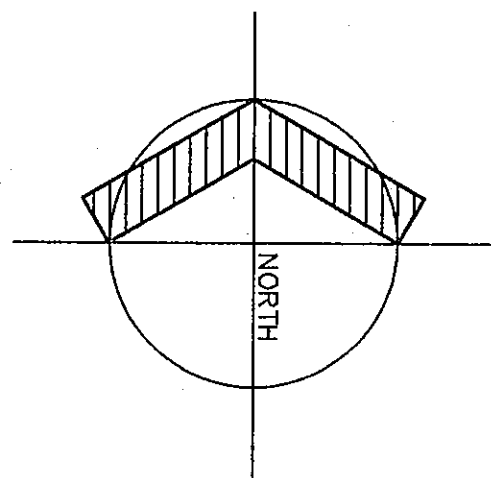



$$1/8'' = 1' - 0$$


NOTES


1. ALL RECTANGULAR SUPPLY AND RETURN DUCTING IS TO BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. THE INTAKE GRILLE TO THE RETURN DUCTING IS TO BE WARPED WITH DUCT WEAR. ALL STRAIGHT DUCTING IS TO BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. MAKE-UP AIR FROM A KITCHEN HOOD IS TO BE WARPED WITH DUCT WEAR. RETURN AIR FROM A KITCHEN HOOD IS TO BE WARPED WITH DUCT WEAR.
 2. TERMINAL, RAIN OR EXHAUST FANS AND DANCE FLOORS TO BE RUN IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. SCREEN SIZE SHOWN IS MINIMUM ACCEPTABLE SIZE.
 3. PROVIDE OPPOSED BLADE VULCAN DAMPERS ON ALL SUPPLY DIFFUSERS AND RETURN GRILLES (EXCEPT SLOT DIFFUSERS AND CYANUSILUM GRILL GRILLES).
 4. $FD-1 = 1$ HR FIRE DAMPER ASSEMBLY
 $FD-2 = 2$ HR FIRE DAMPER ASSEMBLY
 $FD-3 = 3$ HR FIRE DAMPER ASSEMBLY
 $SD-1 =$ SMOKE DAMPER ASSEMBLY
 5. COORDINATE GRILLE & DIFFUSER COATING WITH SELECTED CEILING AND ELECTRICAL PLANS. (DIFFUSERS TO BE MIN. 4" O" FROM MOTION DETECTORS).
 6. ALL LOW PRESSURE DUCT OFFERS OVER PROTECTION SCREWS IN TYPICAL CLASSROOMS, TO BE OPENED IN BASE BID.
- 1 INDICATES 1986 AIR TRANSFER OPENING IN WALL

VENTILATION PLAN UNIT "M2"


DRAWN BY: SCB	COMM. NO.: 95067.00
CHECKED BY: CAM	DATE: APRIL 21, 1997

M2.22

REVISIONS NO.	DATE
---------------	------

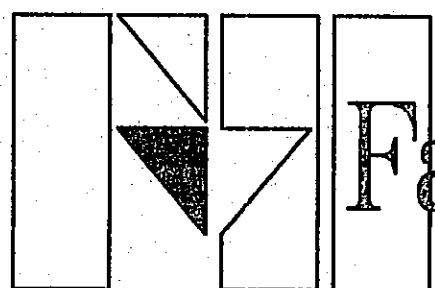

Architects Engineers Consultants

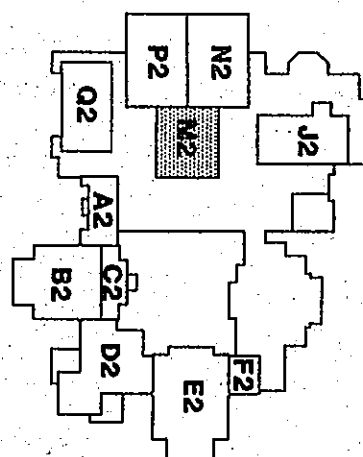

THE NEW
CHESTERTON HIGH SCHOOL
FOR THE
DUNELAND SCHOOL CORPORATION
CHESTERTON, INDIANA

COPYRIGHT 1997 BY FANNING/HOWEY ASSOCIATES, INC.

