

ROOM LEGEND "P1"			
ROOM	ROOM	AREA	REMARKS
P101	NUNS' TOL.	5.45	9'-0"
P102	ATHLETIC STORAGE	24.24	9'-0"
P103	TOILET	10.04	9'-0"
P104	ROOM	1.30	9'-0"
P105	SHOWERS	1.70	9'-0"
P106	BOB'S PE. LOCKER	1.70	9'-0"
P107	JUNIOR	7.71	9'-0"
P108	STAR	7.74	9'-0"
P109	COACH LOCKER	5.52	9'-0"
P110	OFFICE	27.72	9'-0"
P111	BOB'S PE. LOCKER	4.49	9'-0"
P112	PRINTING ROOM	4.49	9'-0"
P113	SHOWERS	1.30	9'-0"
P114	PE. LOCKER	1.30	9'-0"
P115	CONCESSION STAND	13.82	10'-0"
P116	CORRIDORS	38.93	10'-0"
P117	ELECTRICAL ROOM	9.5	10'-0"


- ① 4" SPLY. S4, S10 D/USERS TO BE TITLITE & BAILEY IMPELLANE SERIES C&B, 3/4" - 6" SLO D/USERS DEFLECTOR TO SUPPLY FEET AND AN INCH OF LESS THAN 25 DEFLECTOR TO BE SUPPLIED WITH DISTRIBUTION PLenum WITH CONNECTIONS FOR 10" X FLEX DUCT. UNIT TO BE MOUNTED FLUSH IN ARCHED PORTION OF BARREL. CEILING, FINISH BY ARCHITECT.
- ② 3/4" - 3" SLO DEFLECTOR DEFLECTOR TO RETURN 18"3/4" OF THE MOUNTED FLUSH IN ARCHED PORTION OF BARREL. CEILING, FINISH BY ARCHITECT.
- ③ 4" SPLY. S4, S10 D/USERS TO BE TITLITE & BAILEY IMPELLANE SERIES C&B, 3/4" - 6" SLO D/USERS DEFLECTOR TO SUPPLY 100 CFM/FT (400 CPM TOTAL) WITH A HEAD OF 15-25 FEET AND AN INCH OF LESS THAN 25 DEFLECTOR FOR 10" X FLEX DUCT. UNIT TO BE MOUNTED FLUSH IN ARCHED PORTION OF BARREL. CEILING, FINISH BY ARCHITECT.

1. ALL RECTANGULAR SUPPLY AND RETURN DUCTING IS TO BE WEAVERED WITH DUCTWEAVE. ALL FRESH AIR INTAKE DUCTING IS TO BE WEAVERED WITH DUCTWEAVE. ALL SPRAY DUCTING IS TO BE WEAVERED WITH DUCT WEAVE. ALL THE EXHAUSTION OF THE EXPOSED EXHAUST DUCTING IS TO BE WEAVERED WITH DUCTWEAVE. DUCT TAKE-UP AIR PAN TO KITCHEN HOOD IS TO BE WEAVERED WITH DUCTWEAVE. REFER TO SPECIFICATION SECTION 15250 FOR ADDITIONAL REQUIREMENTS.
2. REMOVAL UNIT FOR EXHAUST FANS AND RANGE HOODS TO BE REMOVED FROM THE BUILDING AND REPAIRED OR REPLACED. SIZE SHOWN IS MINIMUM ACCEPTABLE SIZE.
3. PROVIDE PROPOSED PAIR VOLUME DAMPERS ON ALL SUPPLY DIFFUSERS AND GRILLES (EXCEPT SLOT DIFFUSERS AND GRASSMANN RETURN GRILLES).
4. PD-1 = 1 HR FIRE DAMPER ASSEMBLY
PD-2 = 2 HR FIRE DAMPER ASSEMBLY
PD-3 = SMOKE DAMPER ASSEMBLY
5. COORDINATE SILENCE & DIFFUSER LOCATIONS WITH SELECTED EQUIPMENT AND ELECTRIC LOADS. (DIFFUSERS TO BE MAX. 4'-0" FROM MOTION DETECTORS).
6. AT LOW PRESSURE DUCT OFFSETS OR PROJECTION SCREENS IN TYPICAL CLASSROOMS, TO BE ELIMINATED IN BASE BID.


↑ INDICATES 16x8 AIR TRANSFER OPENING IN WALL

M2.25

REVISIONS NO.	DATE
---------------	------

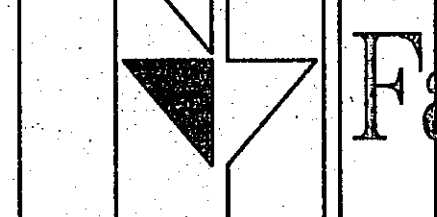

**Fanning/Howey
Associates, Inc.**
Architects Engineers Consultants

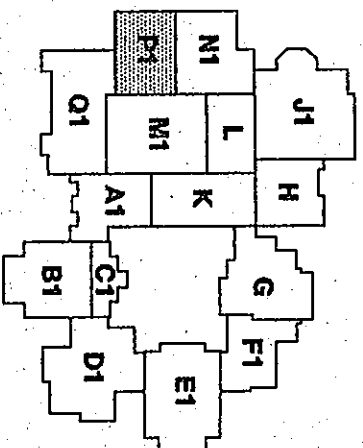

THE NEW
CHESTERTON HIGH SCHOOL
FOR THE
DUNELAND SCHOOL CORPORATION
CHESTERTON, INDIANA

COPYRIGHT 1997 BY FANNING/HOWEY ASSOCIATES, INC.

