

FLOOR PLAN UNIT "Q2"


1/8"=1'-0"

4. PD-1 = 1 HR FIRE DAMPER ASSEMBLY
FD-3 = 3 HR FIRE DAMPER ASSEMBLY
SD-1 = SMOKE DAMPER ASSEMBLY


5. COORDINATE GRILLE & DIFFUSER LOCATIONS WITH REFLECTED CEILING AND ELECTRICAL PLANS. (DIFFUSERS TO BE MIN. 4'-0" FROM MOTION DETECTORS).

6. ALL LOW PRESSURE DUCT OFFSETS OVER PROJECTION SCREENS IN TYPICAL CROSSSECTIONS, TO BE ELIMINATED IN BASE DR.

□ INDICATES 16X8 AIR TRANSFER OPENING IN WALL

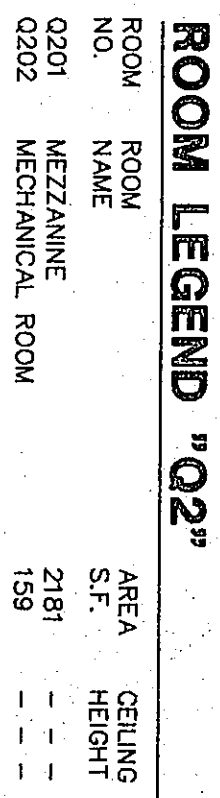[illegible]

INSTALL CONCRETE CURB AROUND
ALL MEZZANINE FLOOR PENETRATIONS

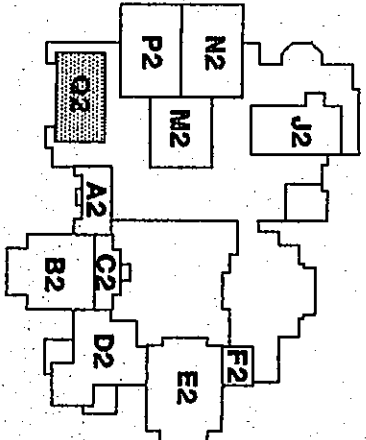

Copyright 1997 by Fanning/Howey Associates, Inc.