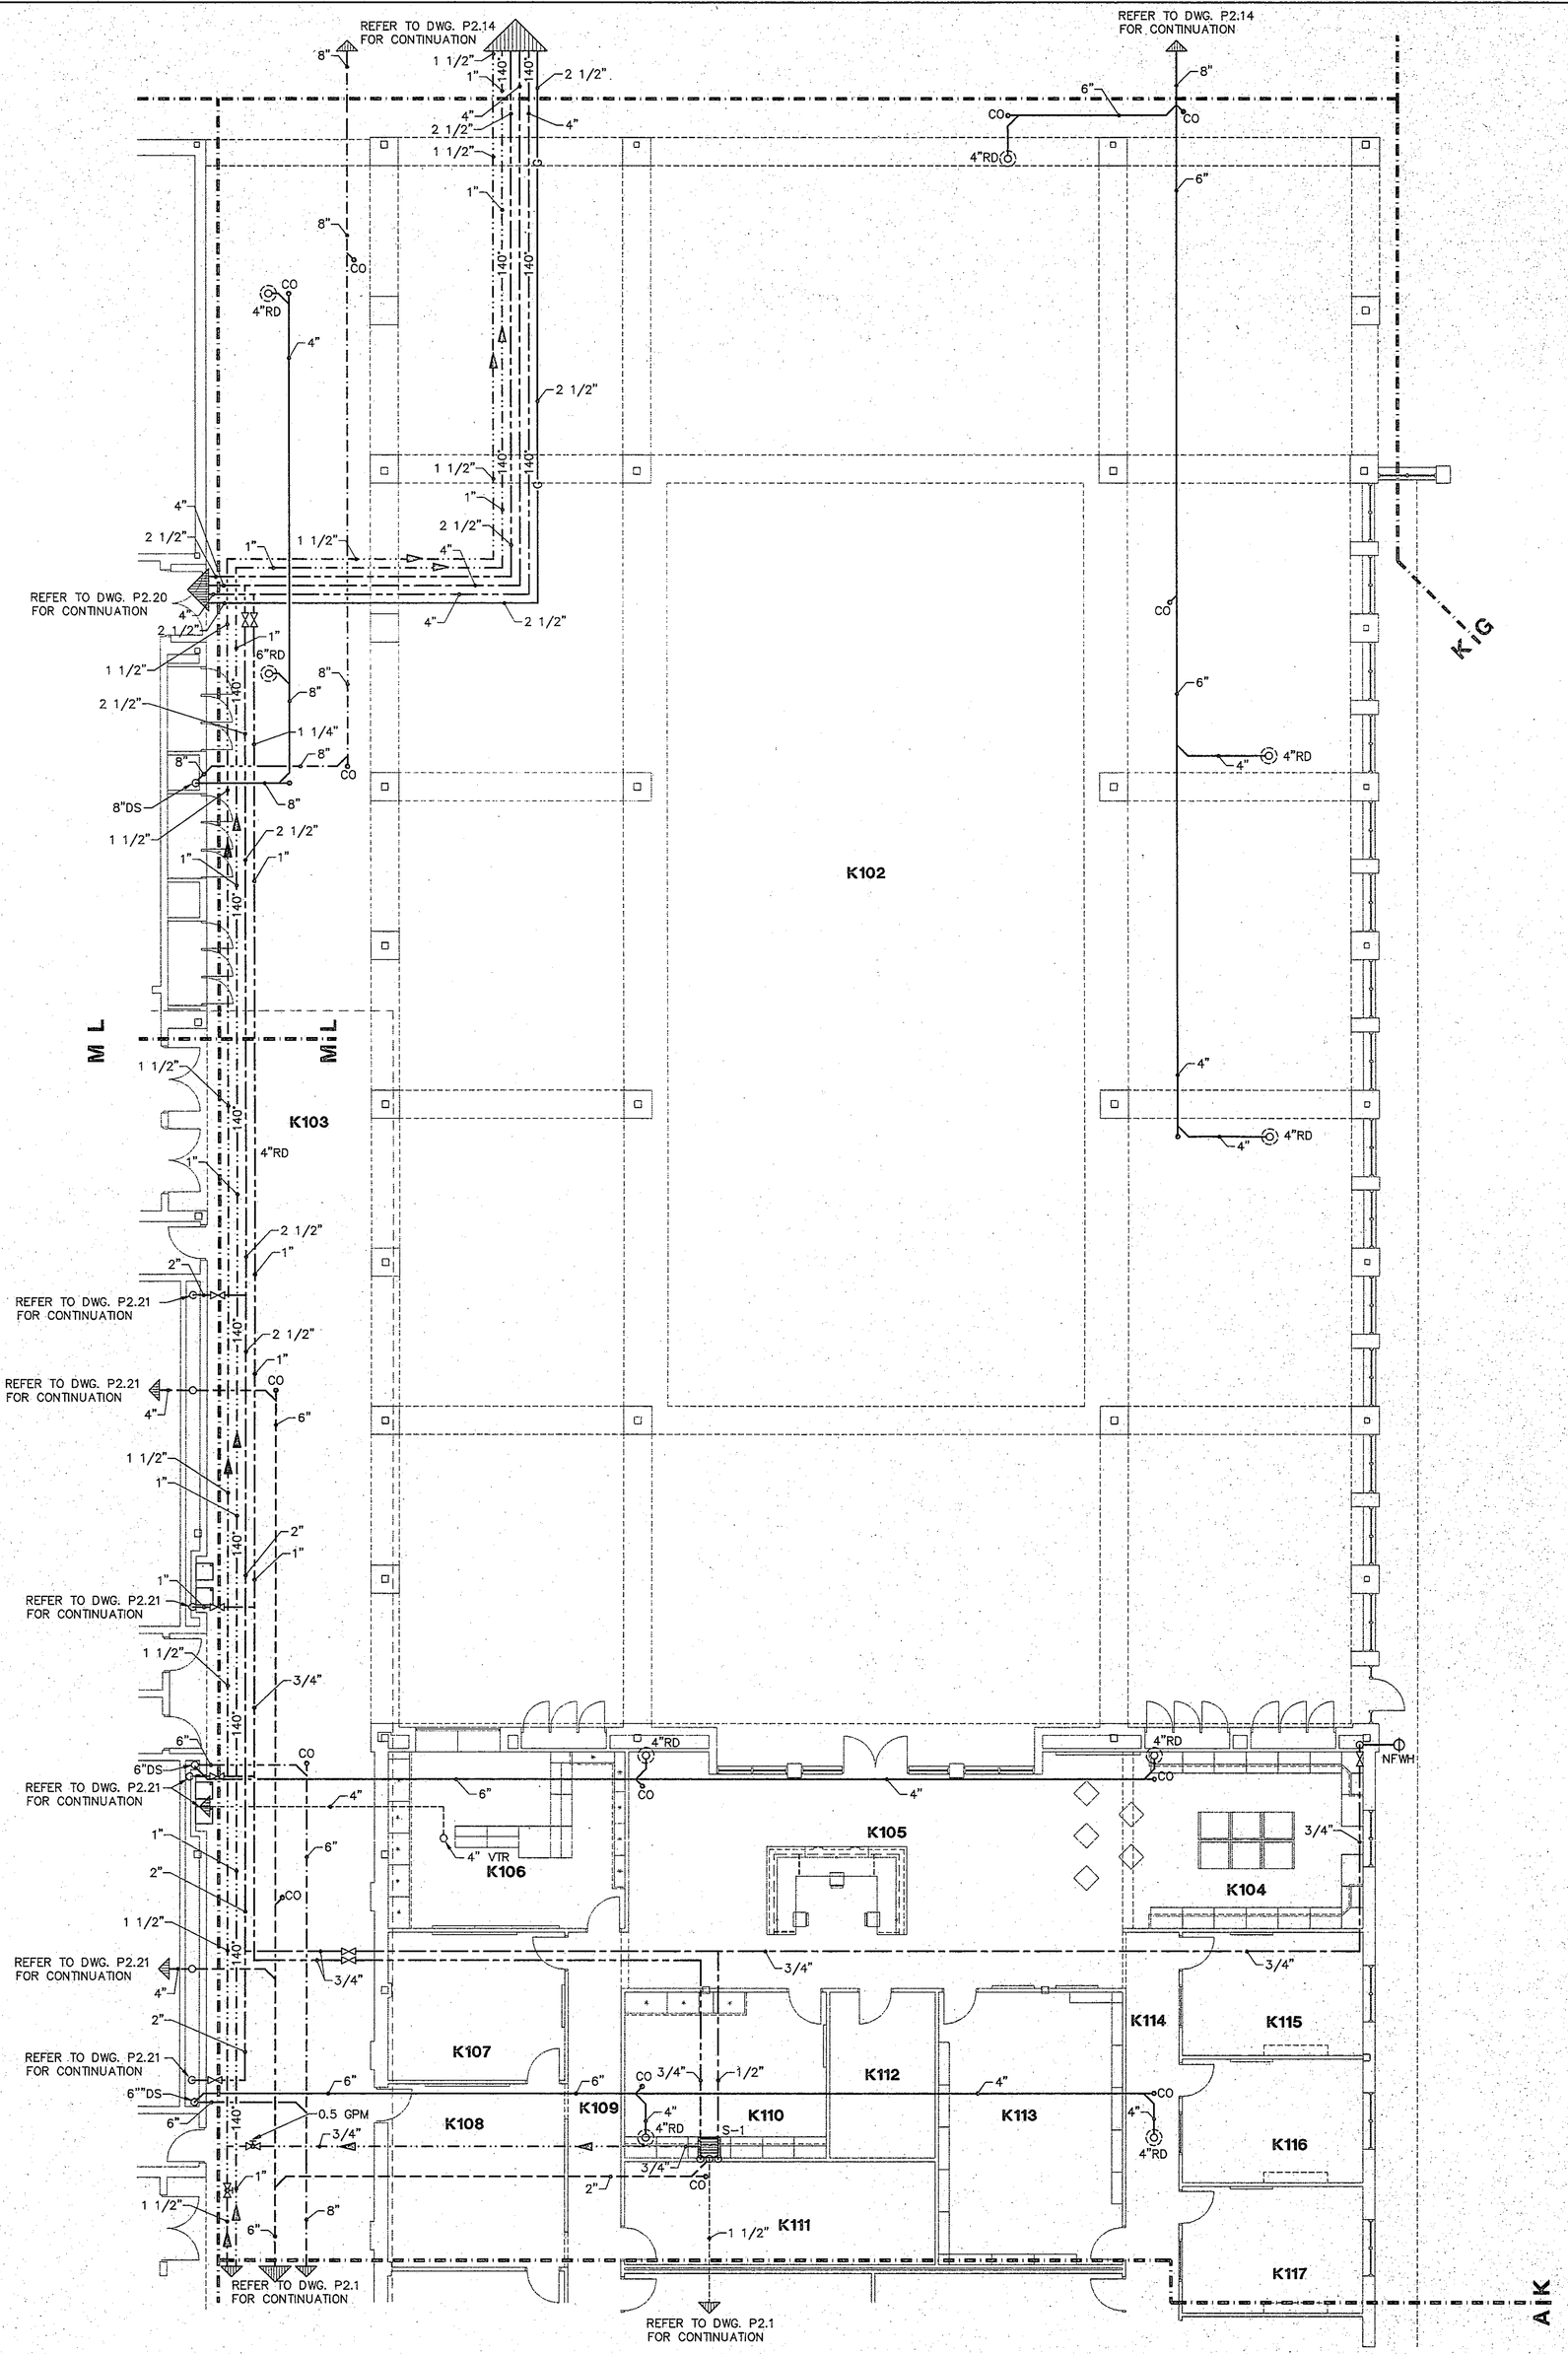

ROOM LEGEND "K1"

ROOM NO.	ROOM NAME	AREA S.F.	CEILING HEIGHT
K101	NOT USED		
K102	STUDENT DINING	13496	VARIES
K103	CORRIDOR	3241	10'-0"
K104	RESOURCE/CAREER CENTER	378	9'-4"
K105	RECEPTIONIST	981	9'-4"
K106	BOOKSTORE	372	9'-4"
K107	CONFERENCE	233	9'-4"
K108	SECRETARY	281	9'-4"
K109	CORRIDOR	155	9'-4"
K110	WORKROOM	298	9'-4"
K111	STORAGE	286	9'-4"
K112	FILES	157	9'-4"
K113	CENTRAL STORAGE	446	9'-4"
K114	CORRIDOR	155	9'-4"
K115	GUIDANCE OFFICE	198	9'-4"
K116	GUIDANCE OFFICE	198	9'-4"
K117	GUIDANCE OFFICE	204	9'-4"

PLUMBING PLAN NOTES:

1. 1/2" H&C WATER. 1 1/2" WASTE UP TO FIXTURE ABOVE
2. 1/2" COLD WATER UP AND DOWN TO DWC.
3. 1/2" HOT AND COLD WATER, 1 1/2" WASTE DOWN TO FLOOR BELOW.
4. 1/2"CW DOWN TO 6" ABOVE FLOOR. VALVE AND CAP FOR REFRIGERATOR ICEMAKER.
5. DISHWASHER TO BE CONNECTED TO WATER AND WASTE PLUMBING OF ADJACENT SINK.
6. HOT WATER AND/OR COLD WATER, GAS, AND SANITARY VENT PIPING ARE TO BE INSTALLED IN COVERED FLOOR TRENCHES. REFER TO DETAIL OF TRENCH INCLUDED ON ARCHITECTURAL PLANS.
7. HOT WATER AND/OR COLD WATER AND/OR GAS AND/OR SANITARY VENT PIPING TO BE INSTALLED IN BASE FRAMING OF CASEWORK BENEATH CABINETRY AND ABOVE FLOOR.
8. INSTALL DISPOSER AT THIS LOCATION, TO BE "IN-SINK-ERATOR", MODEL 77, 3/4 HP.
9. GAS PIPING DOWN TO SOLENOID VALVE WITHIN RECESSED CABINET, AND UP FROM CABINET. REFER TO DETAIL.
10. WASHING MACHINE FITTING. REFER TO DETAIL DWG. P3.1
11. 1/2" GAS AT 6" ABOVE FLOOR WITH STOP VALVE FOR RANGE CONNECTION.
12. DARKROOM SINK WITH MIXING FAUCET BY DIVISION 11470. SANITARY, VENT, H&C WATER CONNECTIONS BY DIVISION 15450. VERIFY ALL CONNECTIONS.
13. 1/2" COMPRESSED AIR PIPING DOWN TO 48" ABOVE FINISHED FLOOR. VALVE AND TEE WITH DIRT LEG, AND PLUG FOR FUTURE QUICK DICONNECT BY OWNER
14. GAS REGULATOR TO PROVIDE 45 CU. FT. OF 7"WC NATURAL GAS PRESSURE FROM 2 PSI. REFER TO DETAIL DWG. P3.1
15. GAS VALVE CABINET REFER TO DETAIL DWG. P3.1
16. COMPRESSED AIR PRESSURE REGULATOR PIPING DETAIL. REFER TO DETAIL DWG. P3.1
17. FLOOR DRAIN TO BE JOSAM 35233-2, WITH HINGED GRATE AND SEDIMENT BUCKET. TO BE INSTALLED W/ TRAP
18. SUMP PUMP TO BE LITTLE GIANT MODEL# 9E-CIA-RFS TO PUMP 30 GPM @ 20 FT. HD, 1/2 HP, 120V, COMPLETE WITH CHECK VALVE, UNION AND 24"ø BASIN
19. 1 1/2" OPEN SITE DRAIN. SEE DETAIL DWG. P3.1. LOCATE ABOVE CEILING TO ALLOW FOR MAINTENANCE ACCESS.

FLOOR PLAN UNIT "K"

1/8"=1'-0"

NORTH

97-P-30

COPYRIGHT 1997 BY FANNING/HOWEY ASSOCIATES, INC.

THE NEW
CHESTERTON HIGH SCHOOL
FOR THE
DUNELAND SCHOOL CORPORATION
CHESTERTON, INDIANA



Fanning/Howey Associates, Inc.
Architects Engineers Consultants

PLUMBING PLAN UNIT "K"

DRAWN BY: JJD	COMM. NO.: 95067.00	REVISIONS NO.	DATE
CHECKED BY: CAM	DATE: APRIL 21, 1997		

P2.18

CHESTERTON HIGH SCHOOL
95067.00