

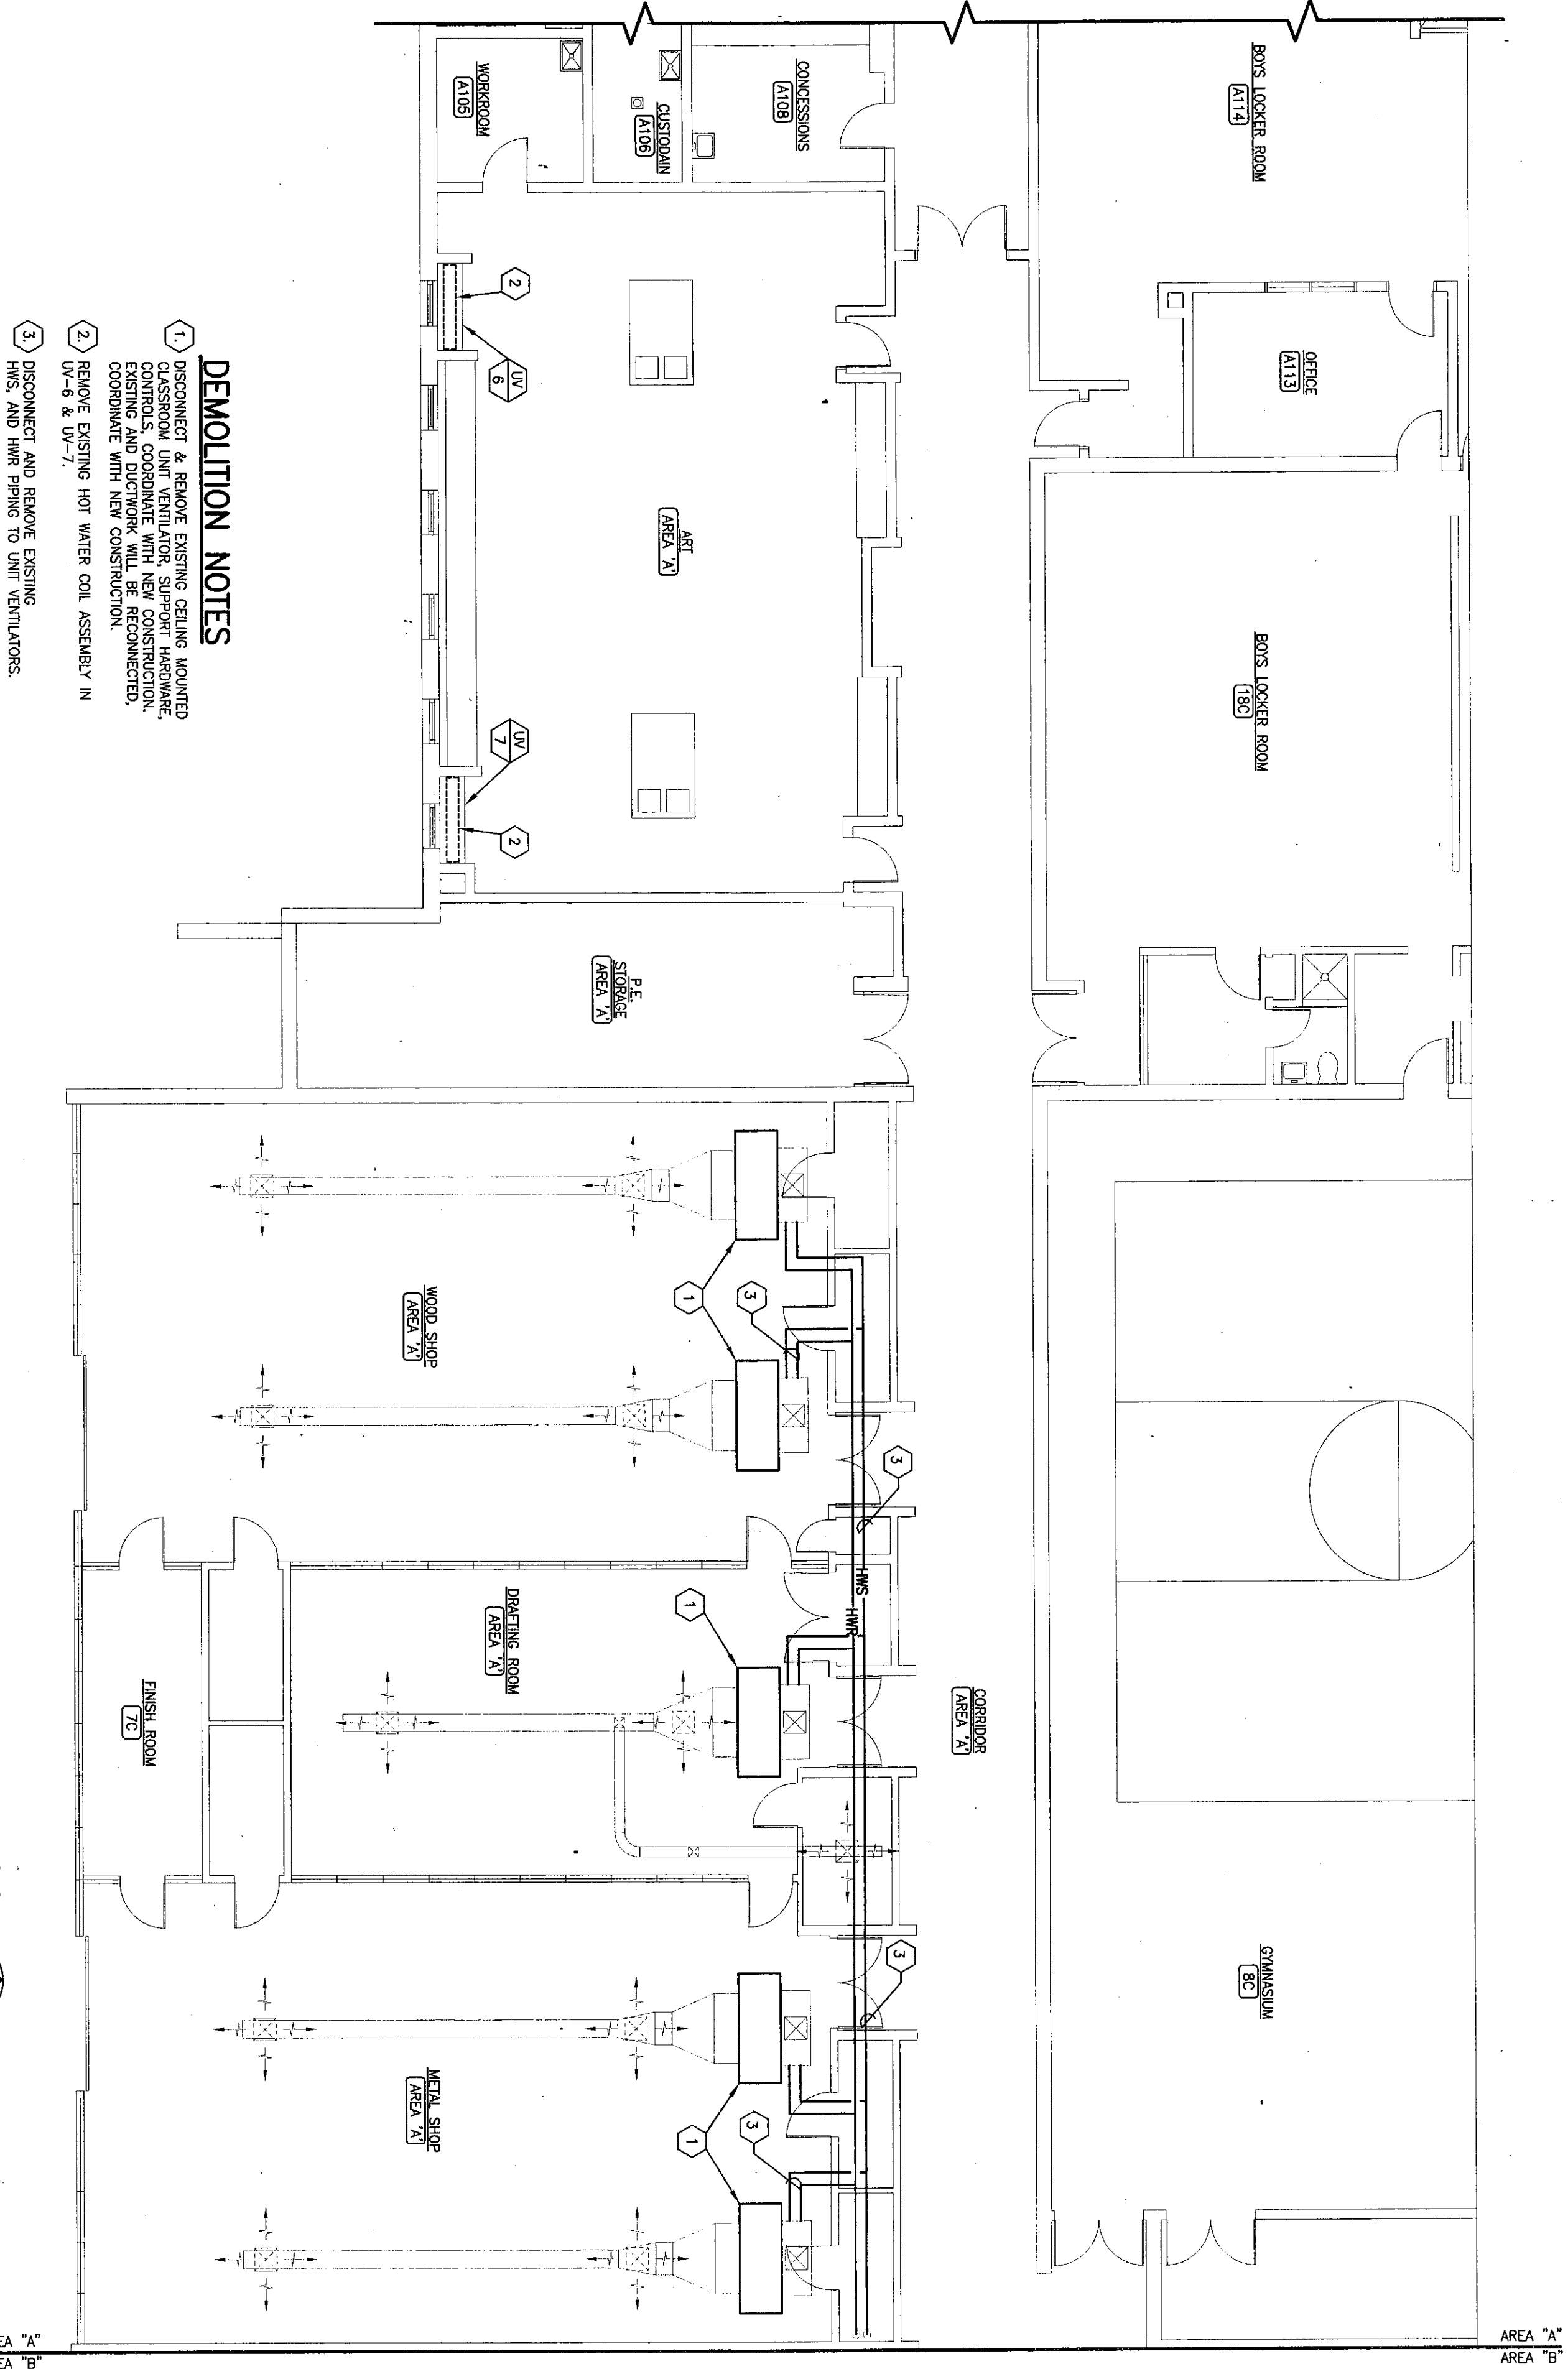


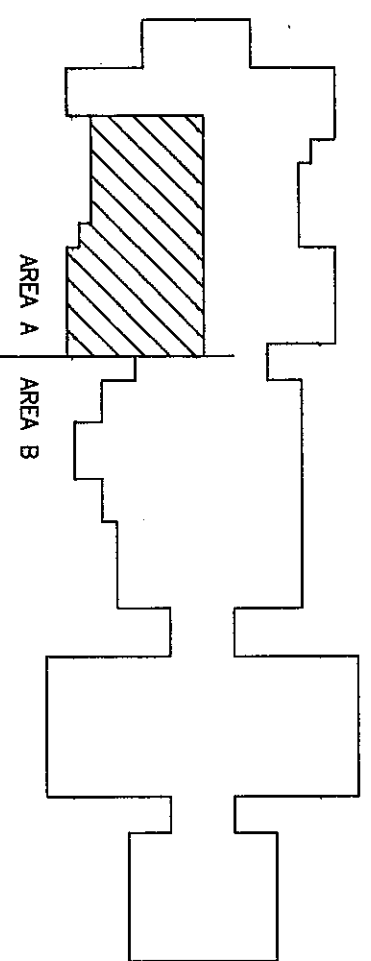


- DEMOLITION NOTES**
1. DISCONNECT & REMOVE EXISTING CEILING MOUNTED EQUIPMENT. COORDINATE WITH NEW CONSTRUCTION. EXISTING AND DUCTWORK WILL BE RECONNECTED. COORDINATE WITH NEW CONSTRUCTION.
 2. REMOVE EXISTING HOT WATER COIL ASSEMBLY IN UV-6 & UV-7.
 3. DISCONNECT AND REMOVE EXISTING FANS AND AIR FANS TO UNIT VENTILATORS.

FIRST FLOOR DEMOLITION PLAN - AREA 'A'
SCALE: 1/8" = 1'-0"
(ALTERNATE 1)




KEY PLAN
NOT TO SCALE




ALTERNATE BID #M-C-1
NOTE: SEE TO SPEC SECTION 0120 FOR ALTERNATE BID ON WESTCHESTER SCHOOL

M/E DESIGN SERVICES
MECHANICAL/ELECTRICAL CONSULTING ENGINEERS
1700 South, Indianapolis, Indiana 46244
(317) 256-1914
CDL No. 535

REVISIONS	BY

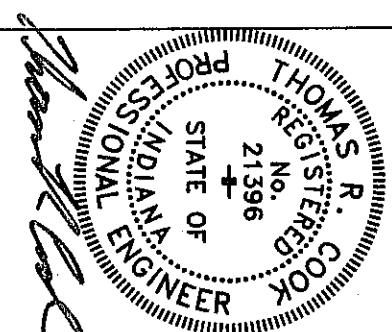

AREA 'A' - FIRST FLOOR DEMO PLAN
WESTCHESTER MIDDLE SCHOOL
FOR DUNELAND SCHOOL CORPORATION
1050 SOUTH FIFTH STREET
CHESTERTON, INDIANA
gerometta & kinel architects, inc.
chesterton, indiana



Date 3/22/99
Scale 1/8" = 1'-0"
Drawn CJC
Sheet 9917
Job 9917
MO.2
Of Sheets