




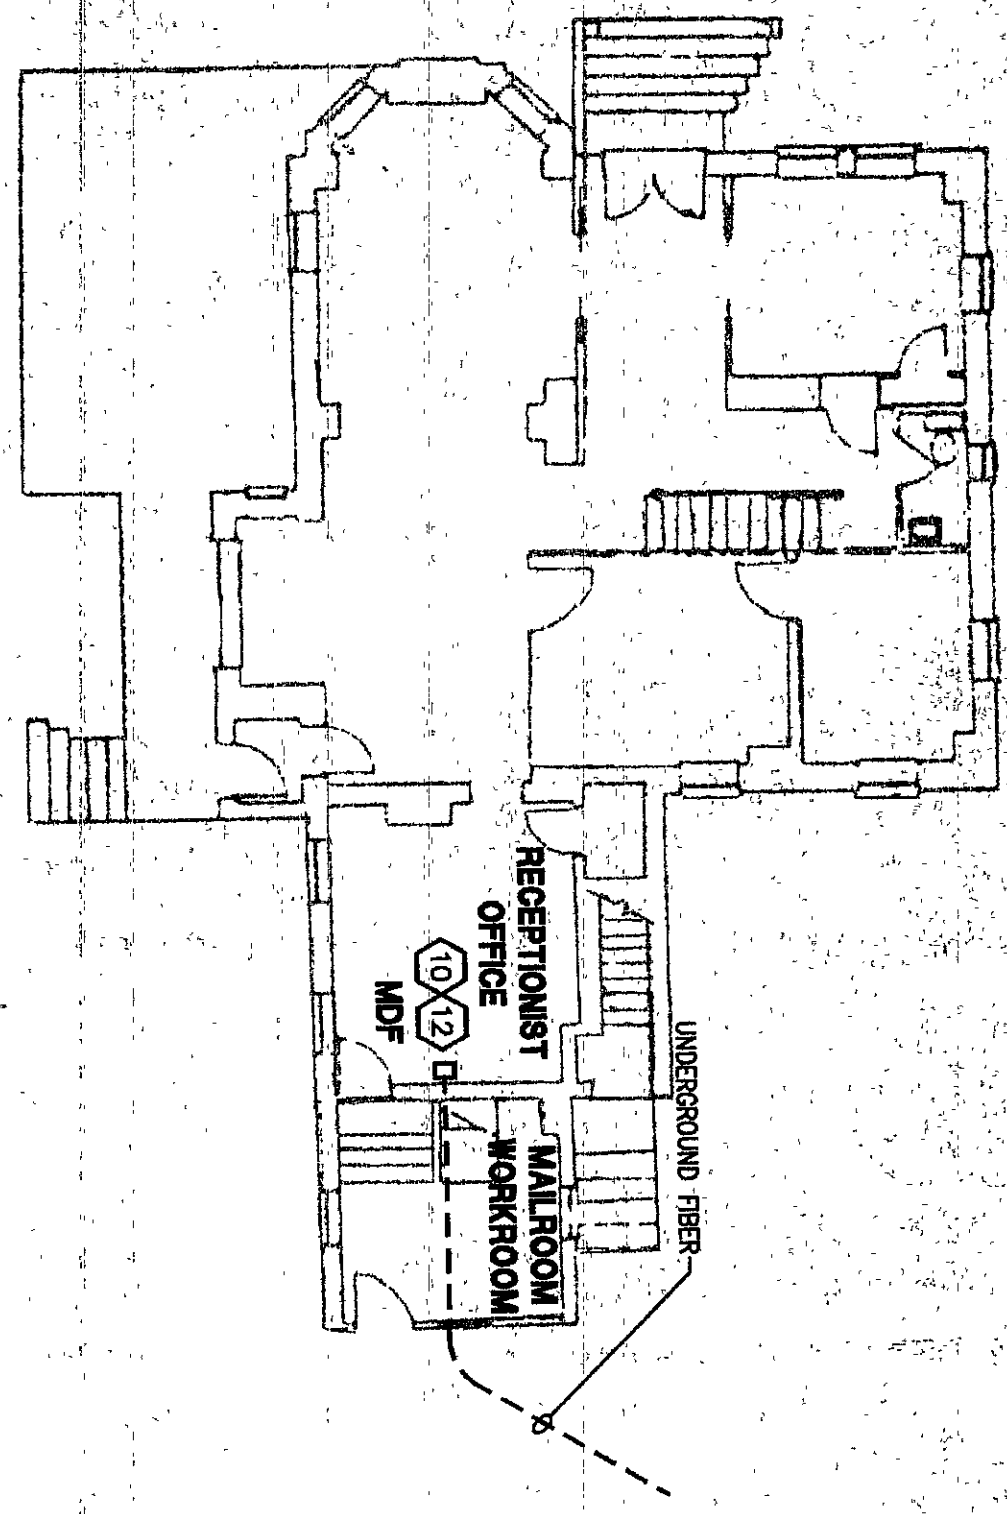


ADMINISTRATION CENTER
NO SCALE

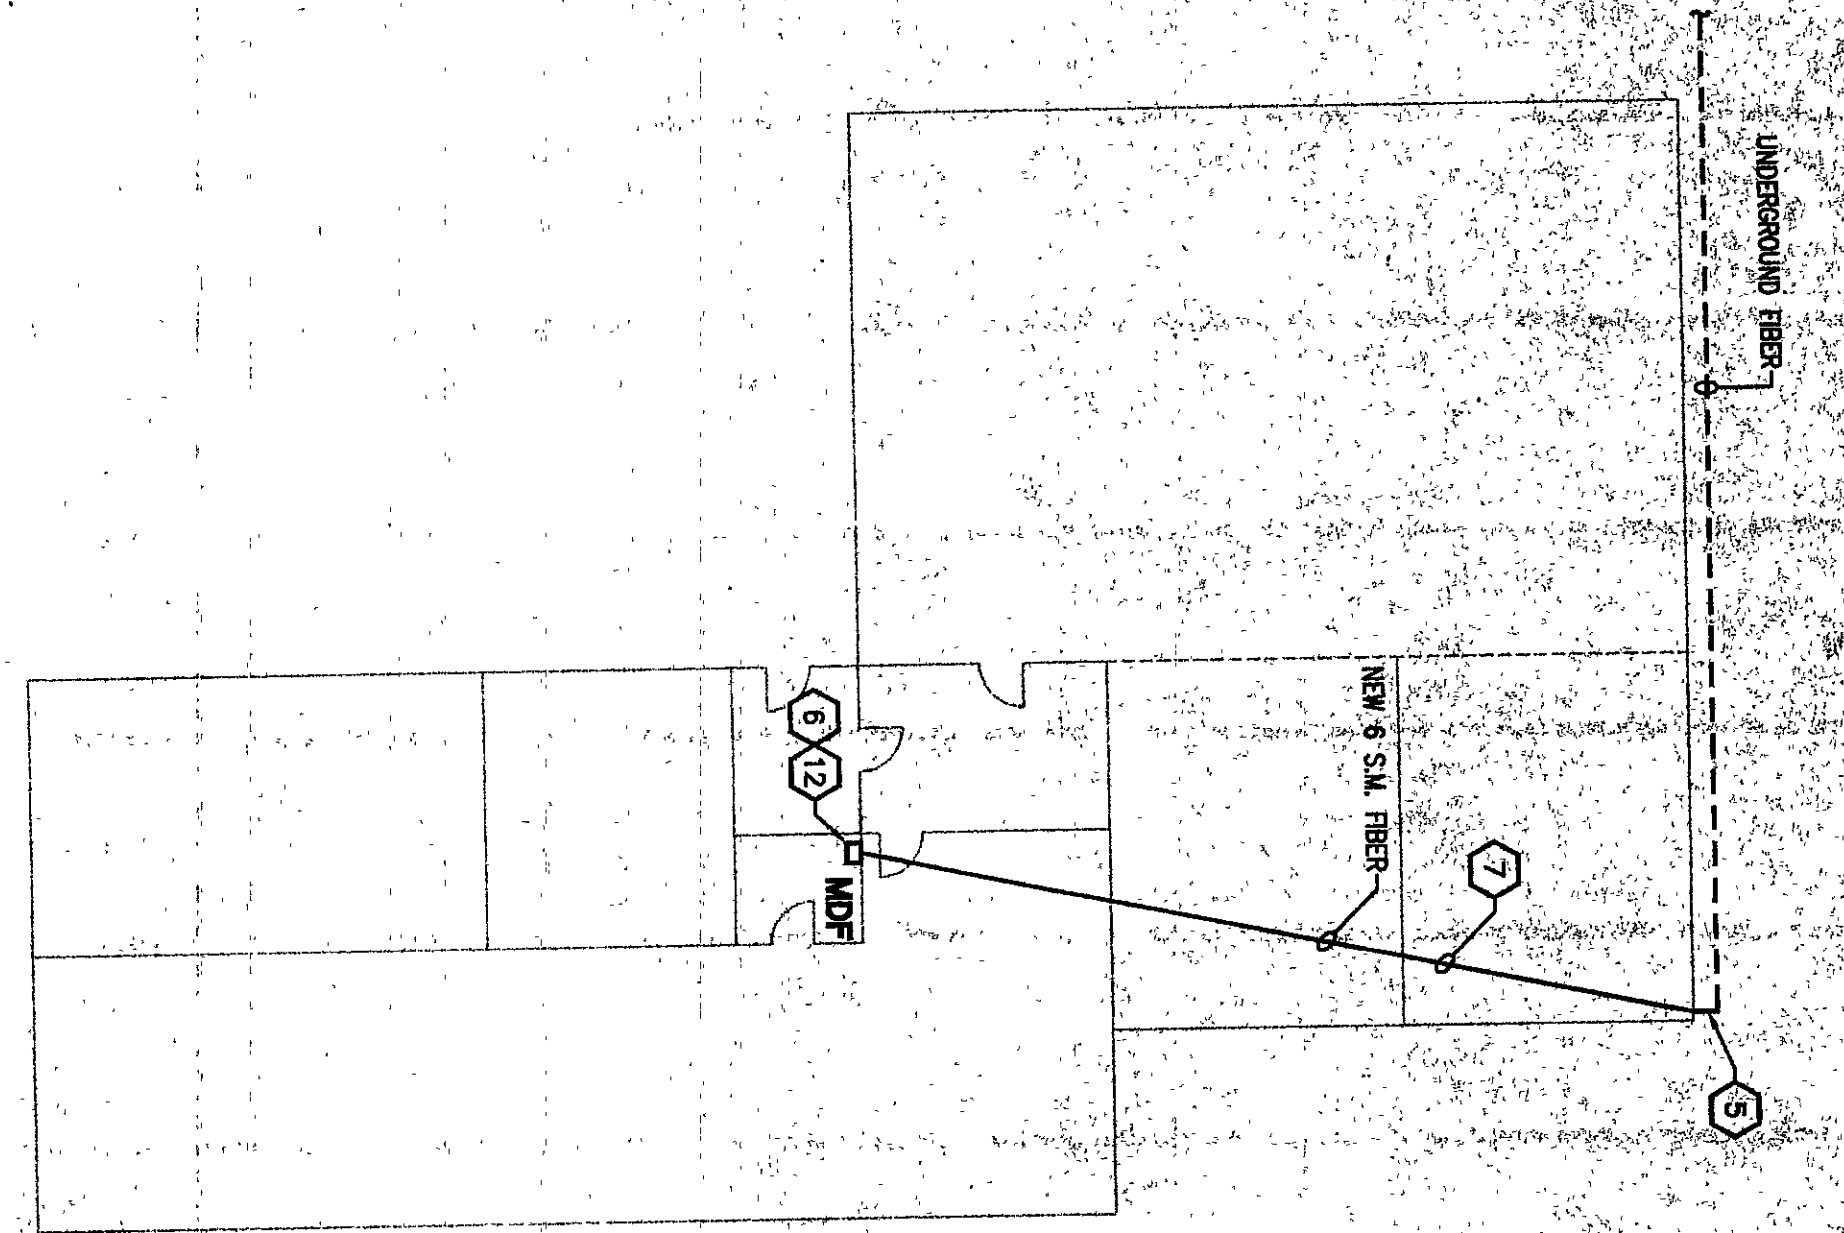


IMC
NO SCALE

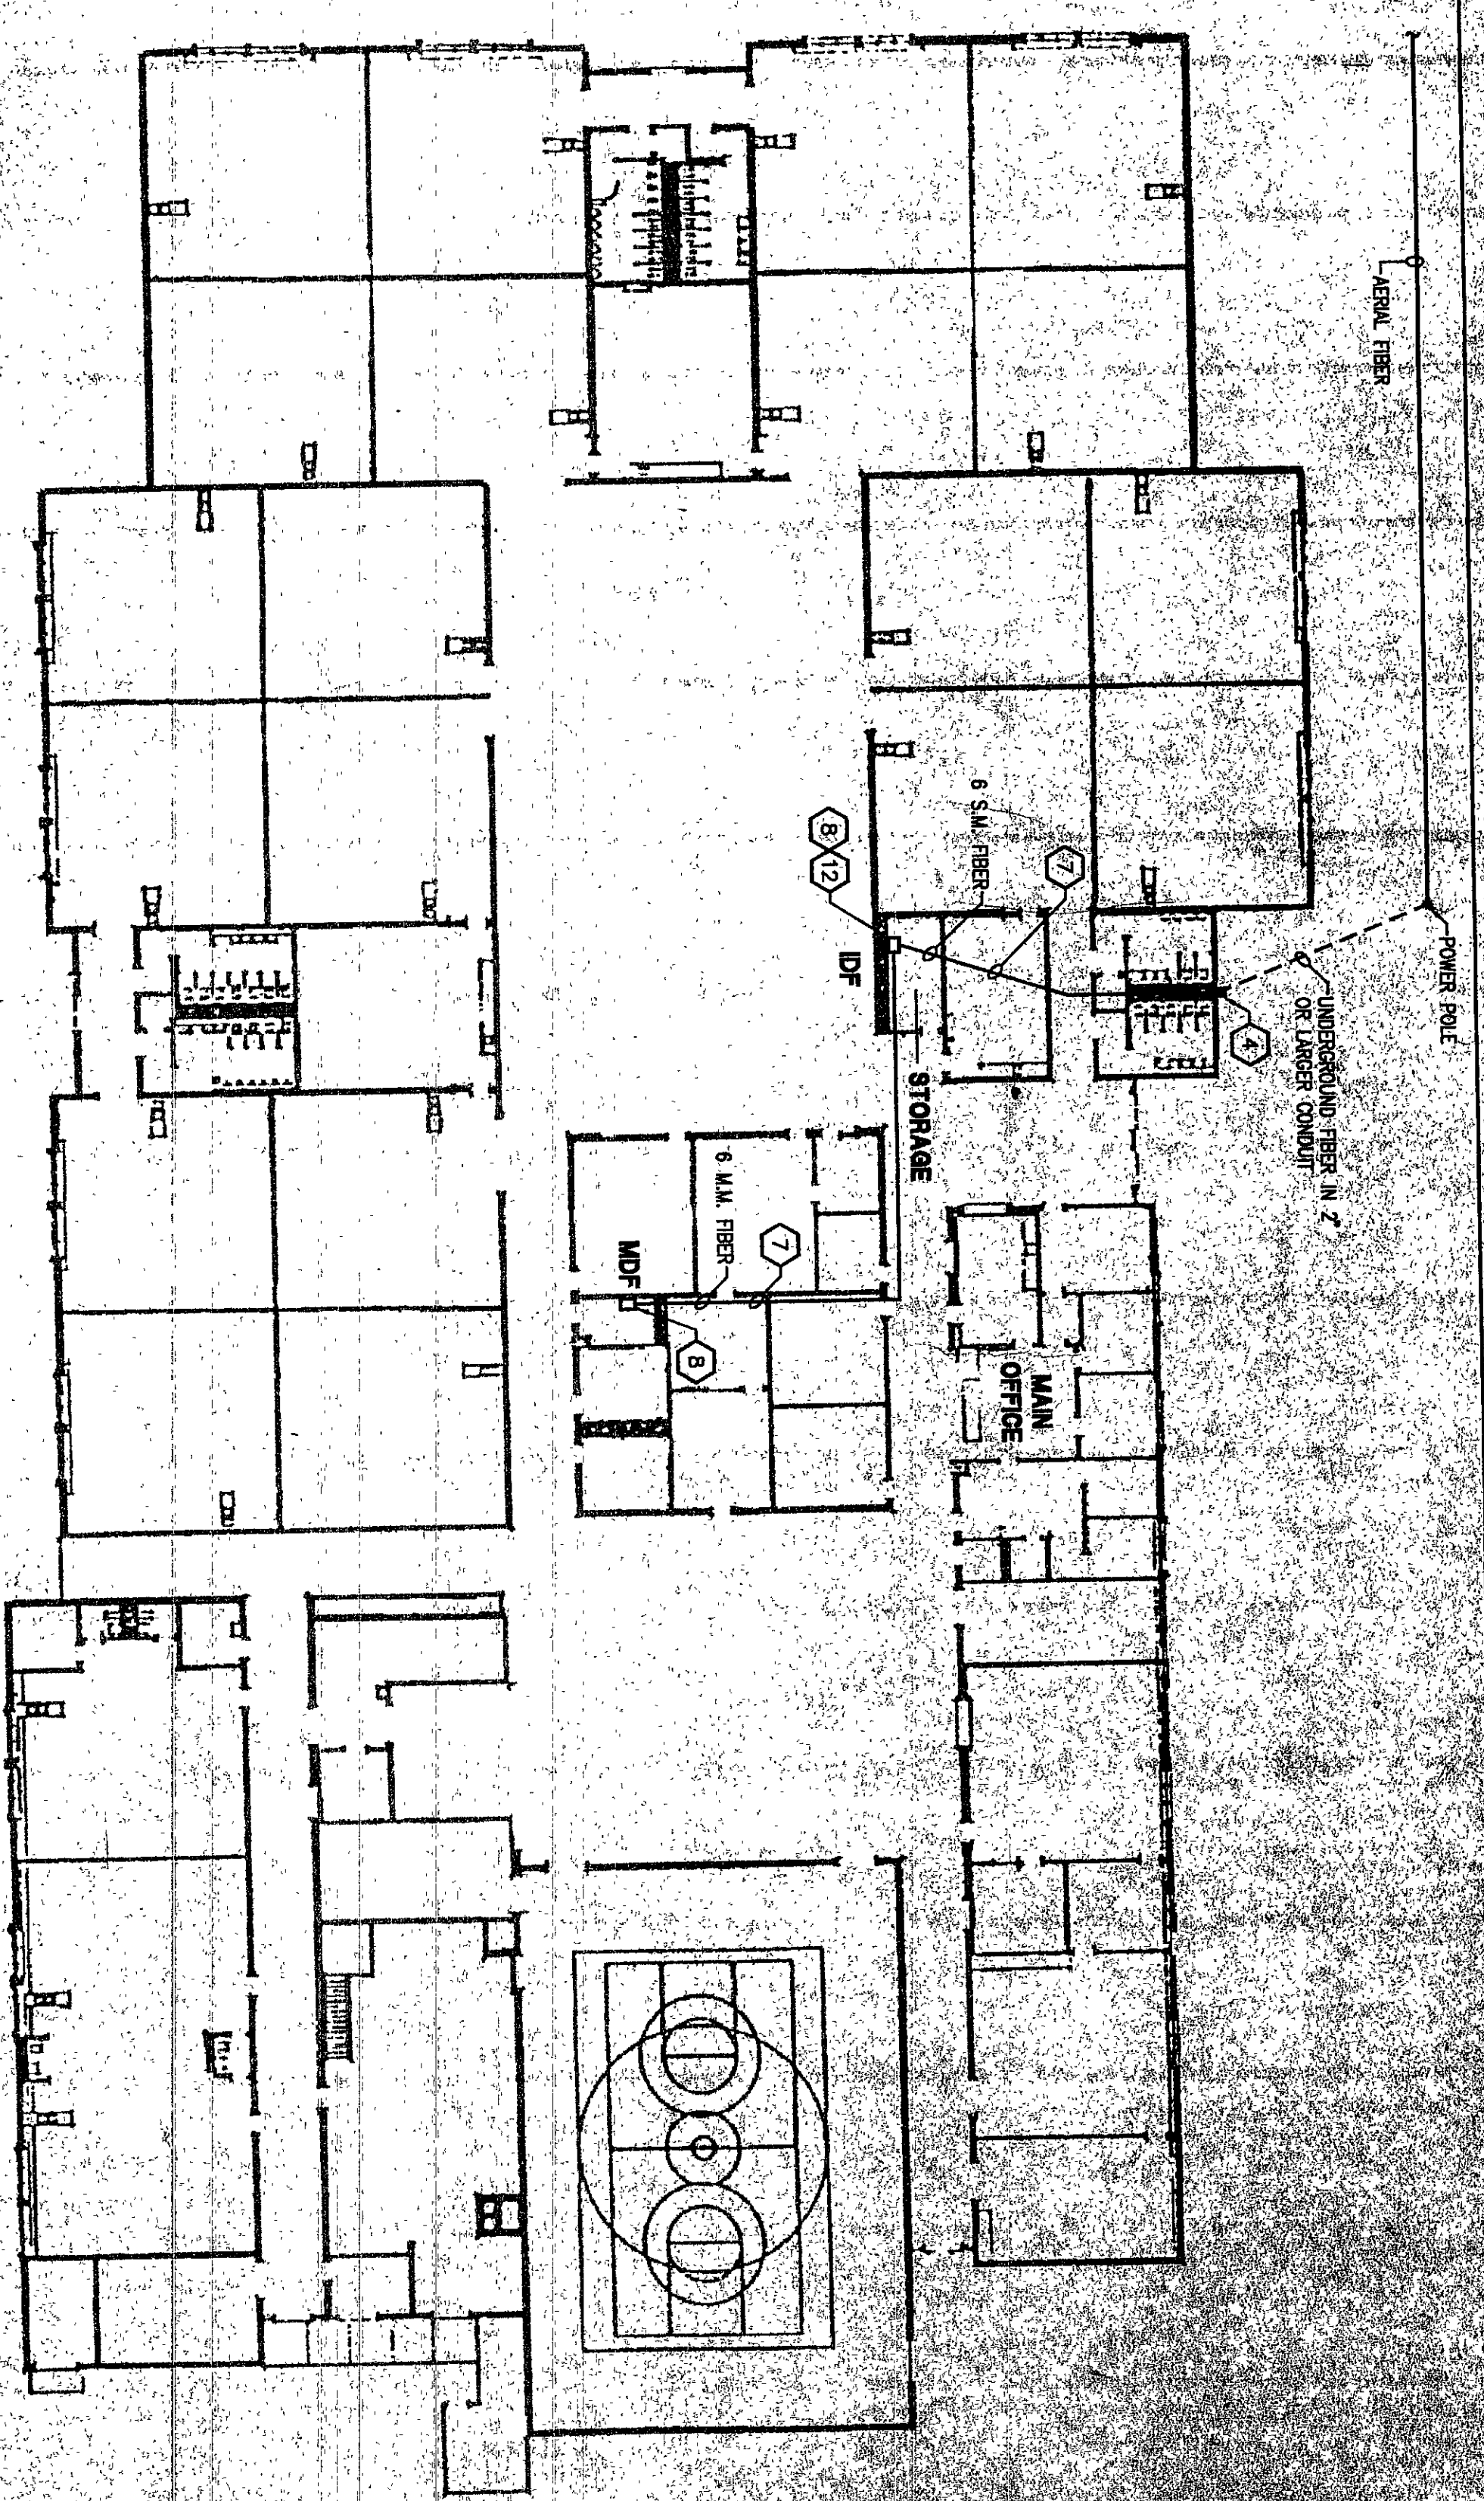

BRUMMITT ELEMENTARY SCHOOL
NO SCALE

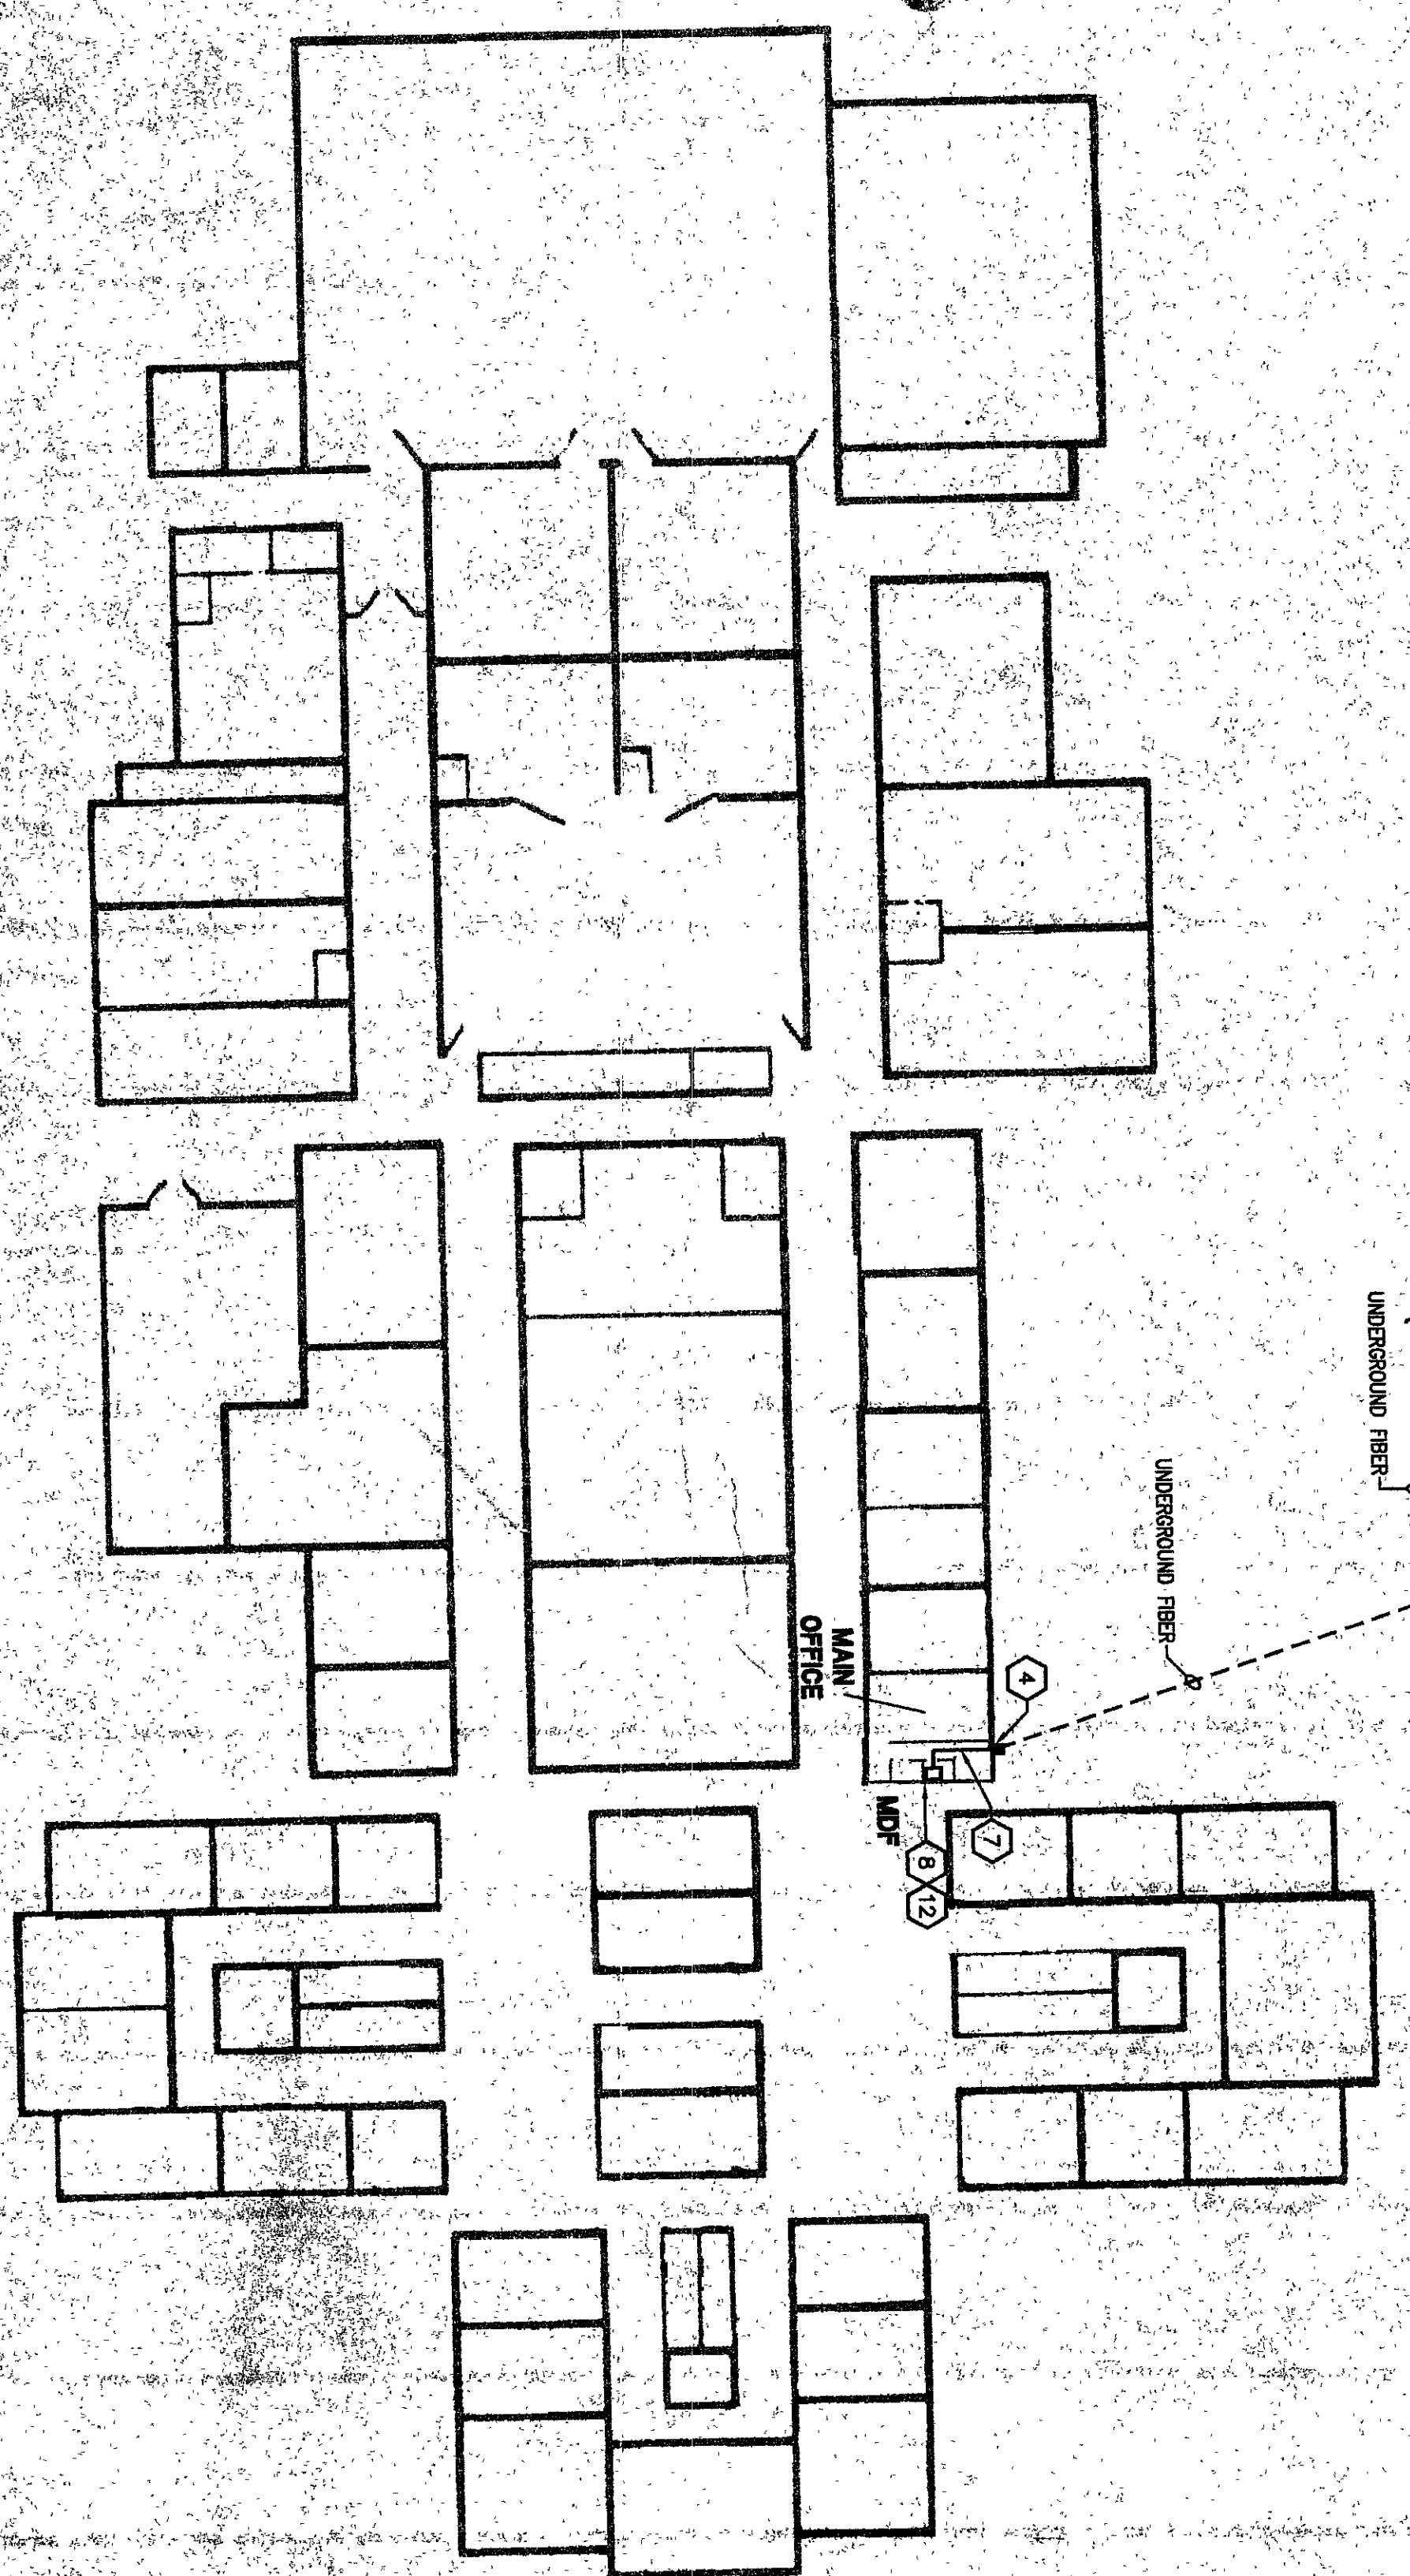


WESTCHESTER MIDDLE SCHOOL
NO SCALE

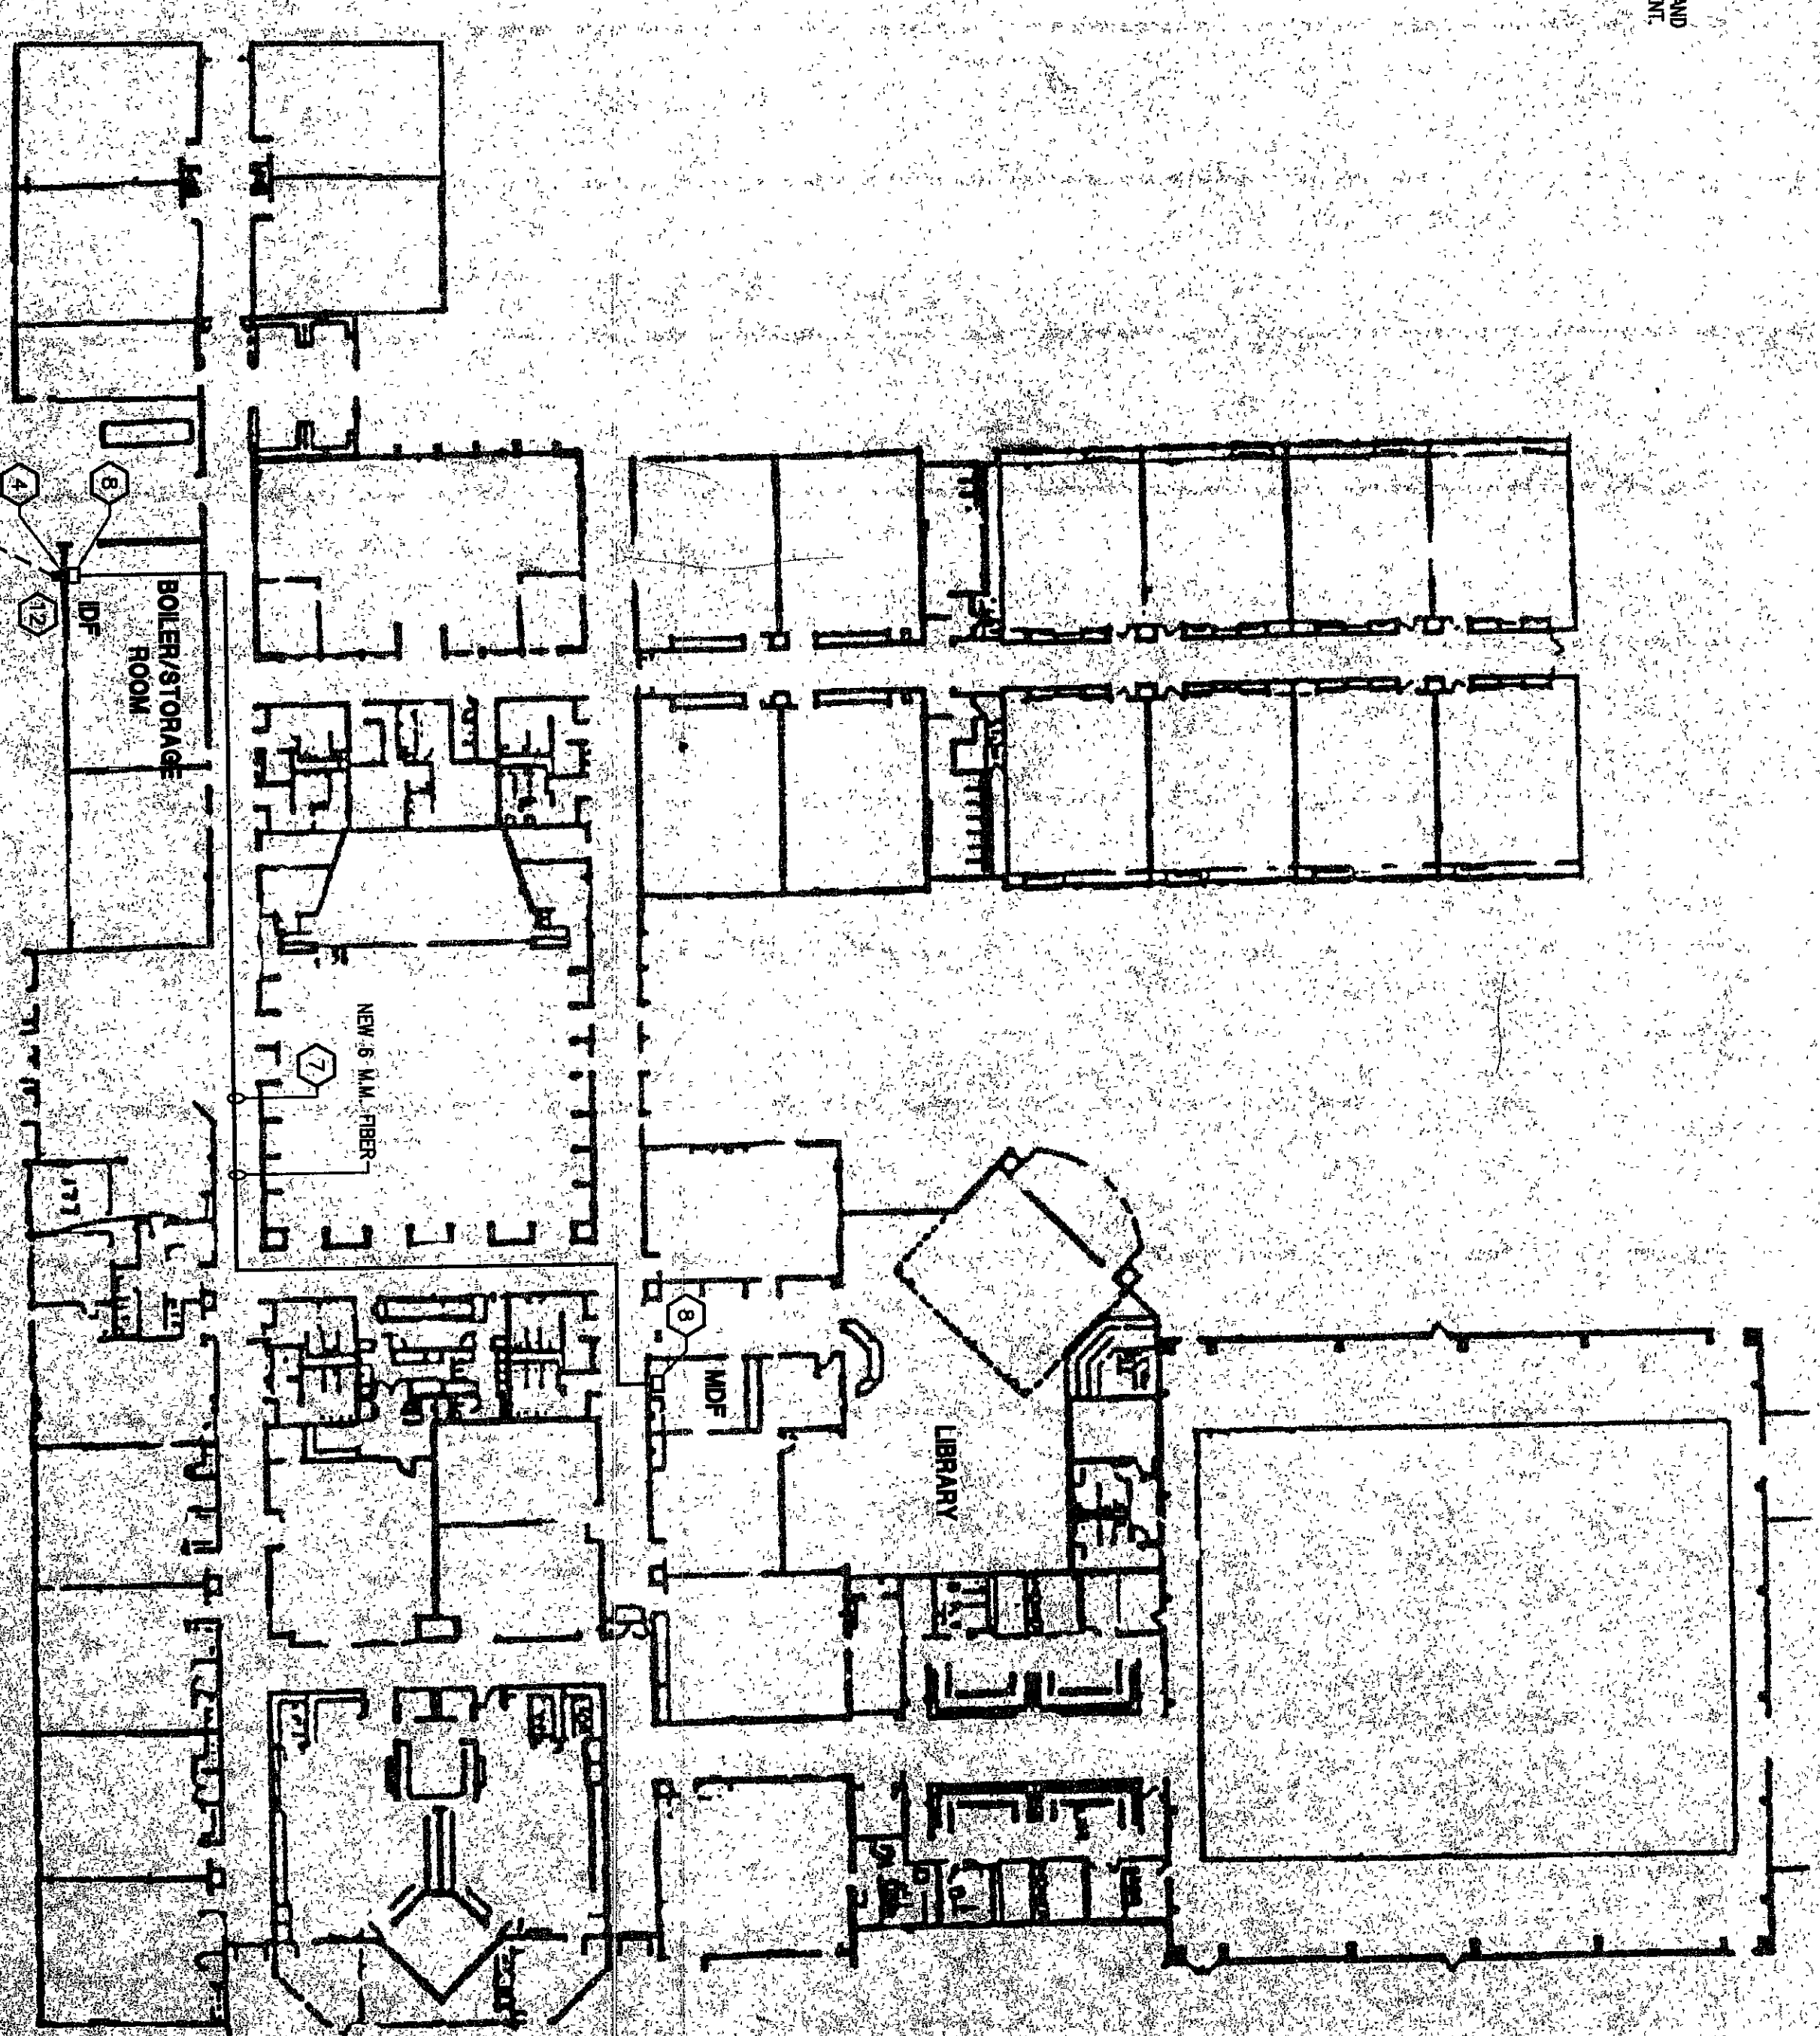

BALLY ELEMENTARY SCHOOL
NO SCALE

- PLAN NOTES:**
1. NEW 12' x 12' x 12' CEMENT BLOCK WALL, PROVIDE NEW EQUIPMENT CONDUIT TO ALL FIBER AND PATCH PANELS, SWITCHES, HUBS, ETC.
 2. EXISTING 12' x 12' x 12' CEMENT BLOCK WALL, PROVIDE NEW EQUIPMENT CONDUIT TO ALL FIBER AND PATCH PANELS, SWITCHES, HUBS, ETC.
 3. RUN 12' x 12' x 12' CEMENT BLOCK WALL, PROVIDE NEW EQUIPMENT CONDUIT TO ALL FIBER AND PATCH PANELS, SWITCHES, HUBS, ETC.
 4. PROVIDE CONDUIT AND FITTING PER DETAIL #2 ON DRAWING TEL-1.
 5. PROVIDE CONDUIT AND FITTING PER DETAIL #2 ON DRAWING TEL-1.
 6. EXISTING WALL MOUNTED EQUIPMENT RACK.
 7. RUN FIBER IN 2" CONDUIT ABOVE CEILING.
 8. EXISTING WALL MOUNTED EQUIPMENT RACK.
 9. PROVIDE 2" x 12' x 12' CEMENT BLOCK WALL, PROVIDE NEW EQUIPMENT CONDUIT TO ALL FIBER AND PATCH PANELS, SWITCHES, HUBS, ETC.
 10. PROVIDE CONDUIT AND FITTING PER DETAIL #2 ON DRAWING TEL-1.
 11. EXISTING 12' x 12' x 12' CEMENT BLOCK WALL, PROVIDE NEW EQUIPMENT CONDUIT TO ALL FIBER AND PATCH PANELS, SWITCHES, HUBS, ETC.
 12. LOCATION OF NEW WALL SWITCHES.

WIDE AREA NETWORK
DUNELAND SCHOOL CORPORATION
CHESTERTON, INDIANA

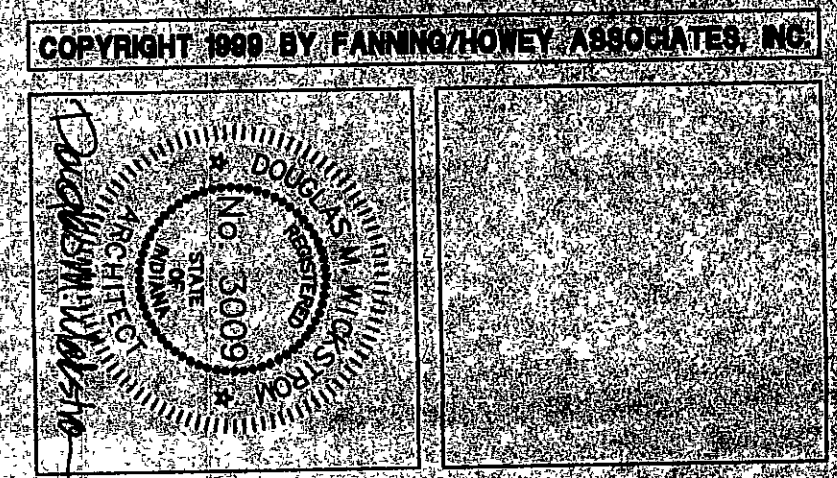

Fanning/Howey Associates, Inc.
Architects Engineers Consultants

BUILDING DETAILS	
DRAWN BY: JED	COMM. NO.: 95087-03
CHECKED BY: KRS	DATE: FEBRUARY 10, 1998
REVISIONS NO. DATE	
TE3.1	