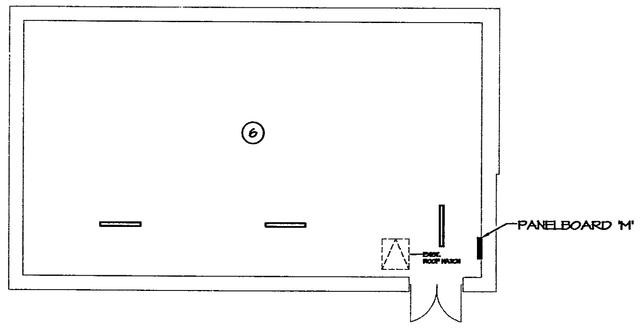

NOTES:

1. DISCONNECT AND REMOVE ALL ELECTRICAL WORK IN THIS AREA, UNLESS OTHERWISE NOTED.
2. DISCONNECT AND REMOVE ALL LIGHTING FIXTURES, INTERCOM SPEAKERS, SMOKE DETECTORS, HVAC UNLESS OTHERWISE NOTED. SMOKE DETECTORS SHALL BE CLEANED AND RE-INSTALLED IN NEW CEILING AT SAME LOCATION.
3. DISCONNECT AND REMOVE LIGHTING FIXTURES, CEILING FANS, AND SWITCHES. LIGHTING CIRCUIT TO REMAIN FOR CONNECTION TO NEW LIGHTING FIXTURES. LIGHTING SWITCHES TO REMAIN UNLESS OTHERWISE NOTED.
4. SEE RISER DIAGRAMS ON SHT. E-5.0 & E-5.1 FOR DEMOLITION WORK REQUIRED ON EXISTING PANEL BOARDS, DISTRIBUTION PANELS AND SWITCHBOARDS.
5. DISCONNECT AND REMOVE ELECTRICAL CONNECTION TO ELECTRIC HEAT UNIT.
6. DISCONNECT AND REMOVE ELECTRICAL CONNECTION TO HVAC EQUIPMENT, HOT WATER HEATER AND PUMPS. REMOVE LIGHTING FIXTURES FOR REPLACEMENT WITH NEW. LIGHTING CIRCUIT TO REMAIN.
7. COMPRESSORS FOR COOLER AND FREEZER UNITS TO REMAIN. DISCONNECT AND REMOVE EXIST. CIRCUIT. RECONNECT AS SHOWN ON E2.3.
8. DISCONNECT AND REMOVE COBRA HEAD LIGHT FIXTURE AT ROOF.

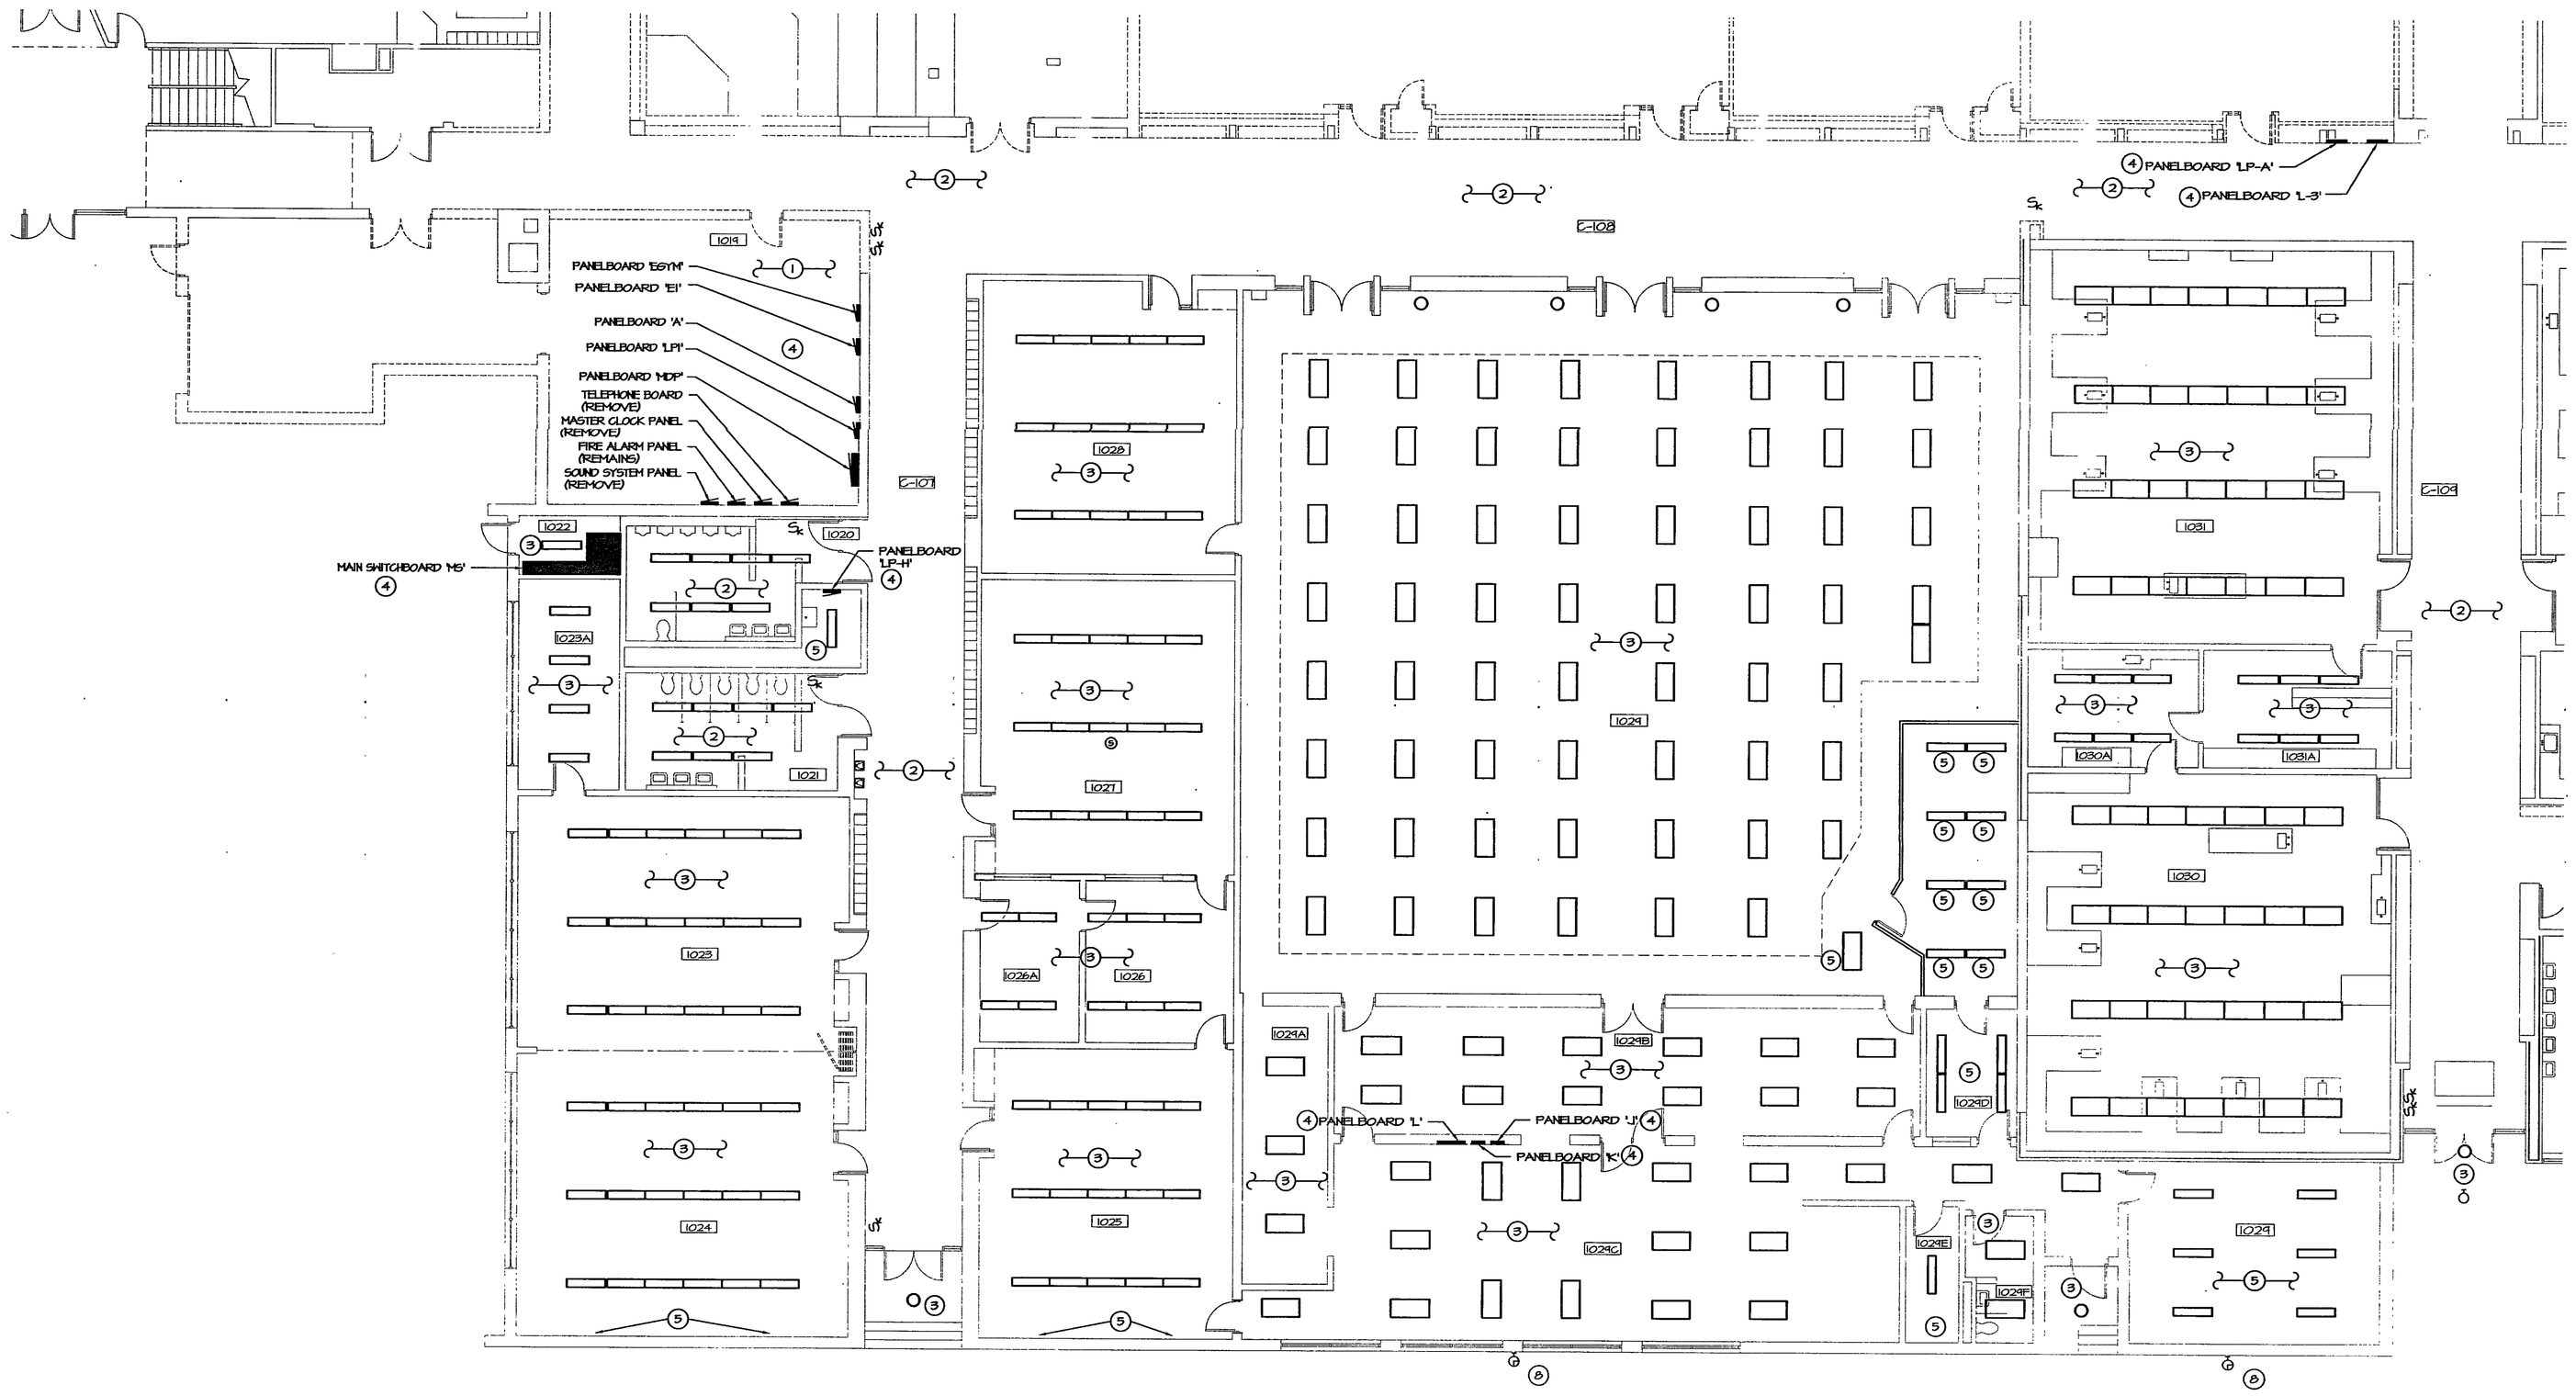

GENERAL ELECTRICAL REMOVAL NOTES:

1. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VISITING THE BUILDING AND SITE TO BECOME FAMILIAR WITH THE EXISTING CONDITIONS. THESE REMOVAL DRAWINGS SHALL SERVE TO AID THE CONTRACTOR IN HIS EVALUATION OF THE EXTENT OF DEMOLITION, BUT SHALL NOT BE HELD TO BE ALL INCLUSIVE.
2. FOR FURTHER INFORMATION WITH REGARD TO THE EXTENT OF DEMOLITION, SEE THE CONSTRUCTION PLANS WHICH ILLUSTRATE THE ADJACENT NEW CONSTRUCTION.
3. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL REMOVALS REQUIRED FOR THE INSTALLATION OF NEW WORK, WHETHER OR NOT IT IS SPECIFICALLY INDICATED OR NOTED IN THESE DOCUMENTS.
4. ALL EQUIPMENT REMOVED FOR RELOCATION SHALL BE REMOVED IN SUCH A MANNER THAT REUSE IS POSSIBLE.
5. ALL CONDUIT RUNS TO REMOVED EQUIPMENT SHALL HAVE ALL WIRING REMOVED UNLESS WIRING IS REQUIRED TO SERVE EXISTING EQUIPMENT TO REMAIN.
6. REMOVAL OF EMPTY CONCEALED CONDUIT WILL BE REQUIRED ONLY IF SUCH CONDUIT INTERFERES WITH NEW CONSTRUCTION.
7. IF PORTIONS OF CIRCUITS SERVING EQUIPMENT TO REMAIN MUST BE RELOCATED OR REMOVED DUE TO OTHER DEMOLITION OR DUE TO INTERFERENCE WITH NEW EQUIPMENT INSTALLATION, THE CIRCUITS SHALL BE MODIFIED IN A MANNER WHICH SHALL ENSURE PROPER OPERATION OF THE EQUIPMENT AFTER CONSTRUCTION IS COMPLETE. USE SAME GAUGE AND TYPE OF CONDUCTOR AND SAME CONDUIT SIZE AS EXISTING TO MAKE ALL REQUIRED CIRCUIT MODIFICATIONS.
8. IF WALLS, CEILING, FLOORS, OR EQUIPMENT ARE REMOVED, OR OTHER DEMOLITION OCCURS, WHICH EXPOSES CIRCUITS SERVING EQUIPMENT TO REMAIN, THE CIRCUITS SHALL BE RELOCATED OR MODIFIED IN SUCH A MANNER WHICH SHALL ENSURE THE CONTINUED OPERATION OF THE CIRCUIT. EXISTING CONDUITS EXPOSED DURING DEMOLITION WHICH REMAIN TO SERVE EQUIPMENT SHALL BE RE-SUPPORTED IN ACCORDANCE WITH THE REQUIREMENTS OF THE N.E.C.
9. EQUIPMENT REMOVED BUT NOT RELOCATED SHALL BE STORED AT LOCATION DIRECTED BY OWNER.
10. DISPOSAL OF LAMPS AND BALLASTS:
    - A. DOCUMENTATION: CONTRACTOR SHALL MAINTAIN RECORDS OF QUANTITY AND TYPE OF LAMPS, BALLASTS, AND LIGHTING FIXTURES REMOVED.
    - B. REMOVAL AND DISPOSAL OF BALLASTS AND LAMPS: CONTRACTOR SHALL DISPOSE OF REMOVED FLUOR. LAMPS AND PCB-CONTAINING BALLASTS MANUFACTURED PRIOR TO 1979 AT AN EPA APPROVED WASTE REDUCTION/RECYCLING INCINERATION SITE. NON-PCB-CONTAINING BALLASTS SHALL BE DISPOSED OF BY THE CONTRACTOR IN ACCORDANCE WITH LOCAL, STATE, AND FEDERAL REQUIREMENTS. THE CONTRACTOR SHALL SUBMIT A MANIFEST INDICATING ACKNOWLEDGMENT OF RECEIPT OF ALL LAMP AND PCB-CONTAINING BALLASTS BY THE WASTE DISPOSAL FACILITY SUB-CONTRACTOR. THE CONTRACTOR SHALL SUBMIT A CERTIFICATE OF PROOF OF DESTRUCTION (INCINERATION) FROM THE WASTE DISPOSAL FACILITY SUB-CONTRACTOR.

GENERAL ELECTRICAL NOTES:

- A. ALL LIGHTING SWITCHES INDICATED SHALL BE REMOVED FOR REPLACEMENT WITH NEW DEVICES.
- B. INTERCOM SYSTEM - ALL SPEAKERS AND CALL SWITCHES SHALL BE DISCONNECTED AND REMOVED.
- C. CLOCK SYSTEM - ALL CLOCKS SHALL BE DISCONNECTED AND REMOVED.
- D. SEE MECHANICAL DEMOLITION PLANS ON SHEETS M0.1, M0.2 AND M0.3 FOR MECHANICAL EQUIPMENT THAT REQUIRES ELECTRICAL DISCONNECTIONS. VERIFY WITH ELECTRICAL POWER PLANS FOR CIRCUITS TO REMAIN FOR RECONNECTION

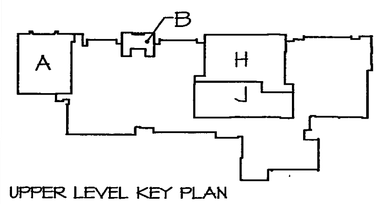

UPPER LEVEL KEY PLAN

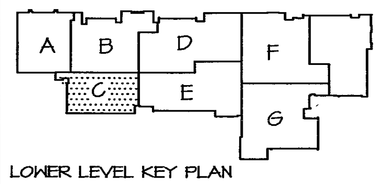

LOWER LEVEL KEY PLAN

NORTH

SCALE: 1/8" = 1'-0"

ARCHITECTS
ENGINEERS
PLANNERS

VEAZEY PARROTT DURKIN & SHOULDERS

525 Main Street
Suite 400
Evansville, In 47708

RENOVATION PROJECT FOR:

DUNELAND SCHOOL CORP.

CHESTERTON HIGH SCHOOL/MIDDLE SCHOOL

CHESTERTON, INDIANA

Drawing Title:

DEMOLITION PLAN - UNIT 'C'

THOMAS H. DURKIN REGISTERED No. 19257 STATE OF INDIANA PROFESSIONAL ENGINEER

Project No:	9980.00
Project Date:	JUNE 2000
Drawn By:	BWH
Approved By:	TLM
Drawing No:	E 0.3

2000-E-06