


- 54 SAVE AT NOTE 6, EXCEPT PROVIDE WITH 30W, 10
THRESHOLD RECEPTACLE. CONTRACTOR SHALL COORDINATE
WITH OWNER FOR EXACT TYPE THRESHOLD RECEPTACLE TO
PROVIDE. COORDINATE WIRE AND CONDUIT SIZE WITH TYPE
OF RECEPTACLE REQUIRED BY OWNER. CIRCUIT BREAKER
AT PAIN'S 20' x 12" SHALL MATCH THE RECEPTACLE.
- 55 30W, 40W, 70W FIBER OPTIC DISCONNECT MEDIA RAY FREE AS
REQUIRED BY INSTALLED DATA COLLECTOR. PROVIDE
FINAL CONNECTION TO DATA COLLECTOR.

GENERAL ELECTRICAL NOTES

A. FOR TYPICAL COMPUTER CIRCUITS AND LAYOUT REQUIRED IN CLASSROOMS, OFFICES, LABS, ETC., SEE TYPICAL LAYOUT ELEVATIONS ON SHEET E-1. COORDINATE INSTALLATION OF ALL SURFACE MOUNTED RACEWAY WITH DW-41.

- [illegible]

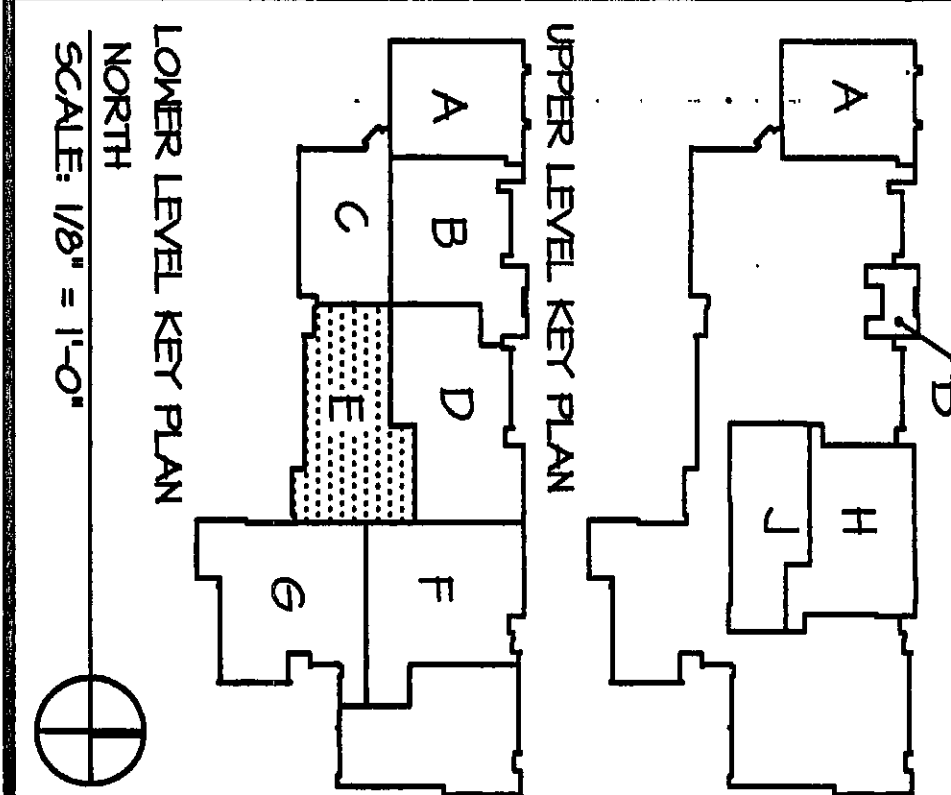

**VEAZEY
PARROT
DURKIN &
SHOULDERS**

**ARCHITECT
ENGINEERS
PLANNERS**

605 Main Street
Beverly Hills, Ca 91605

RENOVATION PROJECT FOR:
DUNEAND SCHOOL CORP.
CHESTERTON HIGH SCHOOL/MIDDLE SCHOOL
CHESTERTON, INDIANA

POWER PLAN - UNIT 5

9480.00

Project Date: LINE 2000

Drawn By: EWH

Approved By: TLM

Drawing No: E 2.5