

FIRST FLOOR PLAN - CABLE TRAY LAYOUT
SCALE: 1/32" = 1'-0"

- CABLE TRAY PLAN GENERAL NOTES:**
1. SEE SPECIFICATION SECTION 1650 FOR CABLE TRAY REQUIREMENTS.
 2. CABLE TRAY ROUTING INDICATED IS DISCREETARY ONLY. EXACT ROUTING AND ELEVATIONS SHALL BE DETERMINED BY MECHANICAL ENGINEER AND STRUCTURAL ENGINEER.
 3. ALL CABLE TRAY SHALL BE INSTALLED IN CEILING CANNY UNLESS NOTED OTHERWISE.
 4. PROVIDE FRESH AIR INTAKE IN ACCORDANCE WITH SPECIFICATION SECTION 1650 AT ALL FREE RATED EXHAUST FAN INTAKES. STOP ALL CABLE TRAY SHORT OF RATED WALLS AND UNACCESSIBLE AREAS SUCH AS ABOVE PARTY ROOMS AND CEILING. SEE ARCHITECTURAL PLANS FOR EXHAUST FAN SIZES AND LOCATIONS.
 5. ALL CABLE HANGER SYSTEM SHALL BE WALL MOUNTED, EXCEPT WHERE NOTED OTHERWISE. THEN CENTER HANG SUPPORT SHALL BE USED.
- NOTES:**
1. WALL MOUNTED CABLE TRAY SHALL BE MOUNTED TO WALL WITH THE LEAST AMOUNT OF OBSTRUCTIONS. FIELD VENTILATION.


ARCHITECTS
ENGINEERS
PLANNERS

SEE SHEET 3.1
FOR CABLE TRAY LAYOUT

RENOVATION PROJECT FOR:
DUNELAND SCHOOL CORP.
CHESTERTON HIGH SCHOOL/MIDDLE SCHOOL
CHESTERTON, INDIANA

Drawing Title:
FIRST FLOOR PLAN - CABLE TRAY LAYOUT

Project No.: 990000
Project Date: JUNE 2000
Drawn By: BWH
Approved By: TLM
Drawing No.:
E 3.1

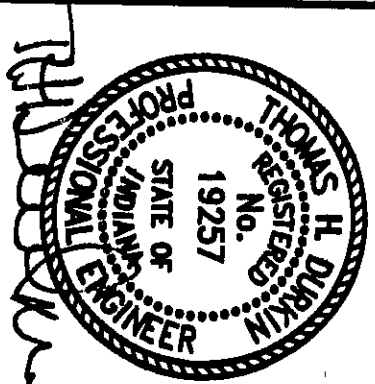

2000-E-3.1