




WEST SECTION - GYMNASIUM AREA - SERVICE #1

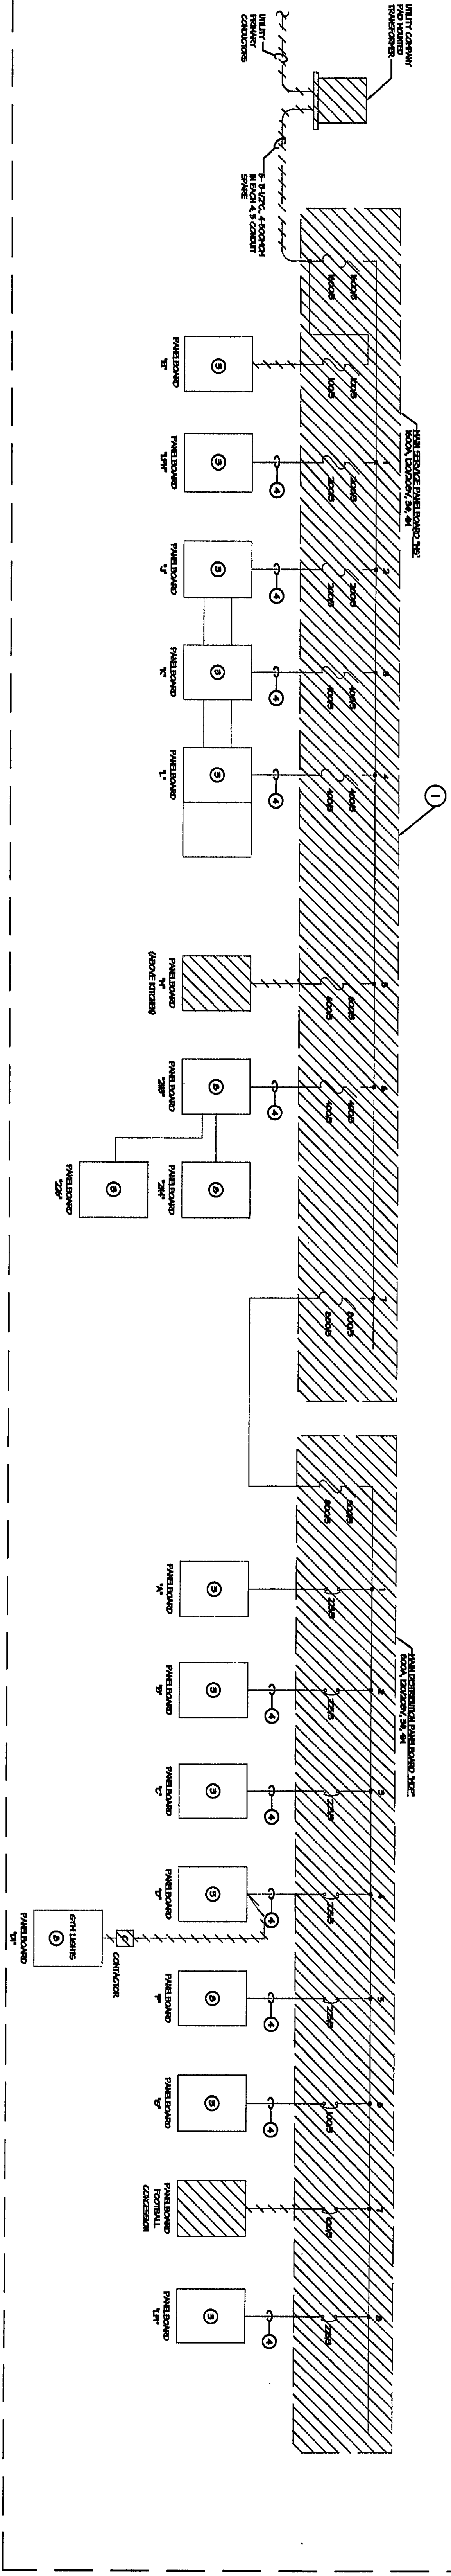

MAIN BOILER ROOM - SERVICE #2

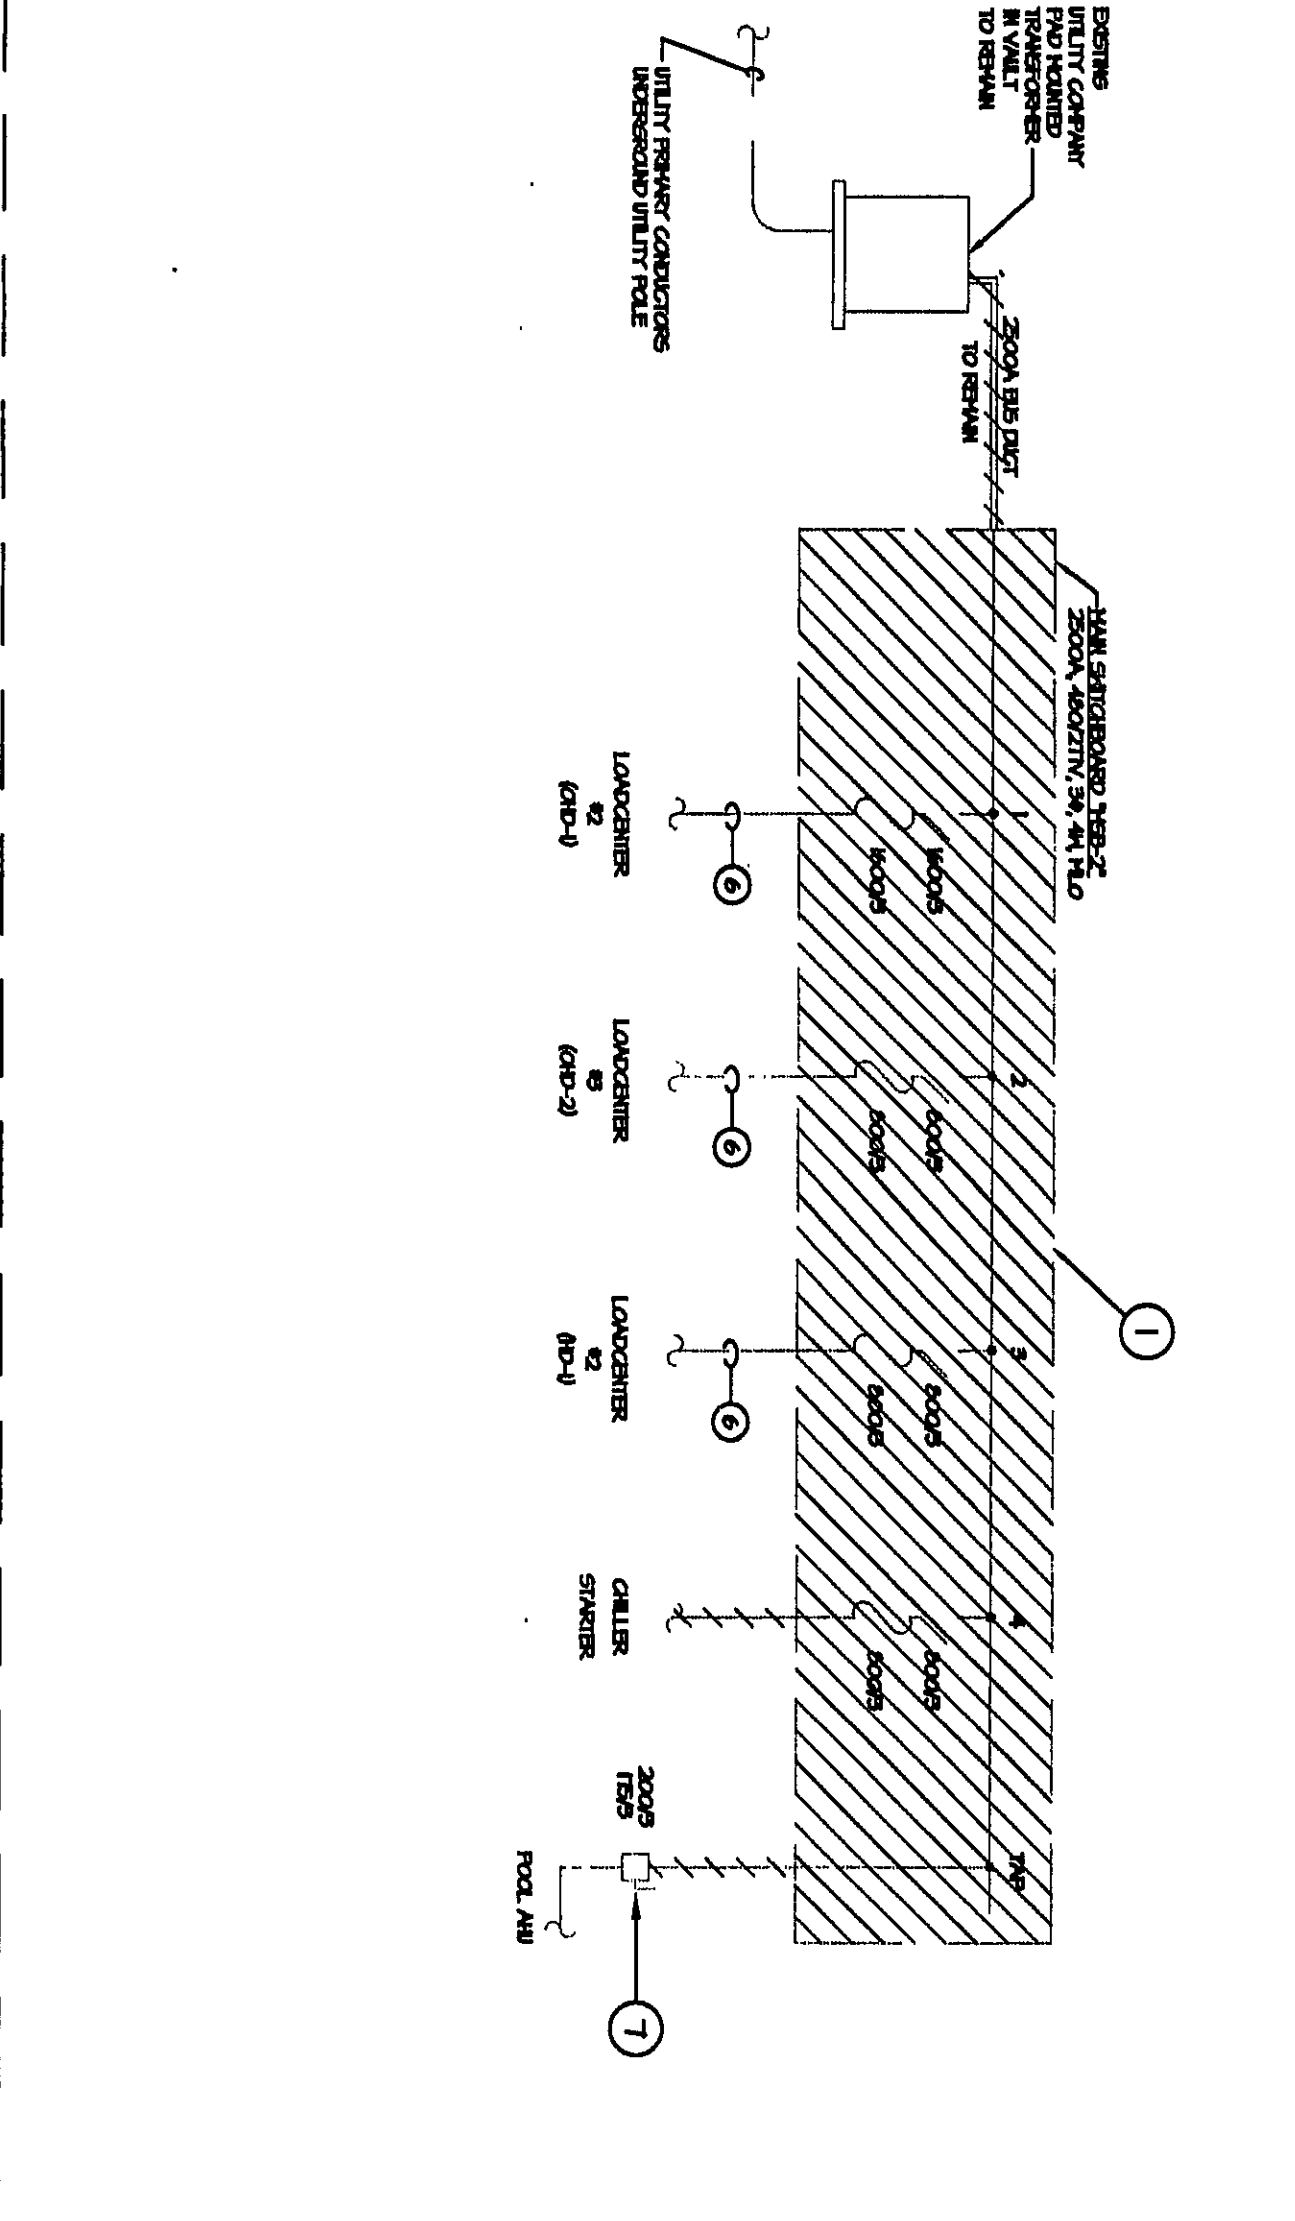

LOAD CENTER #3

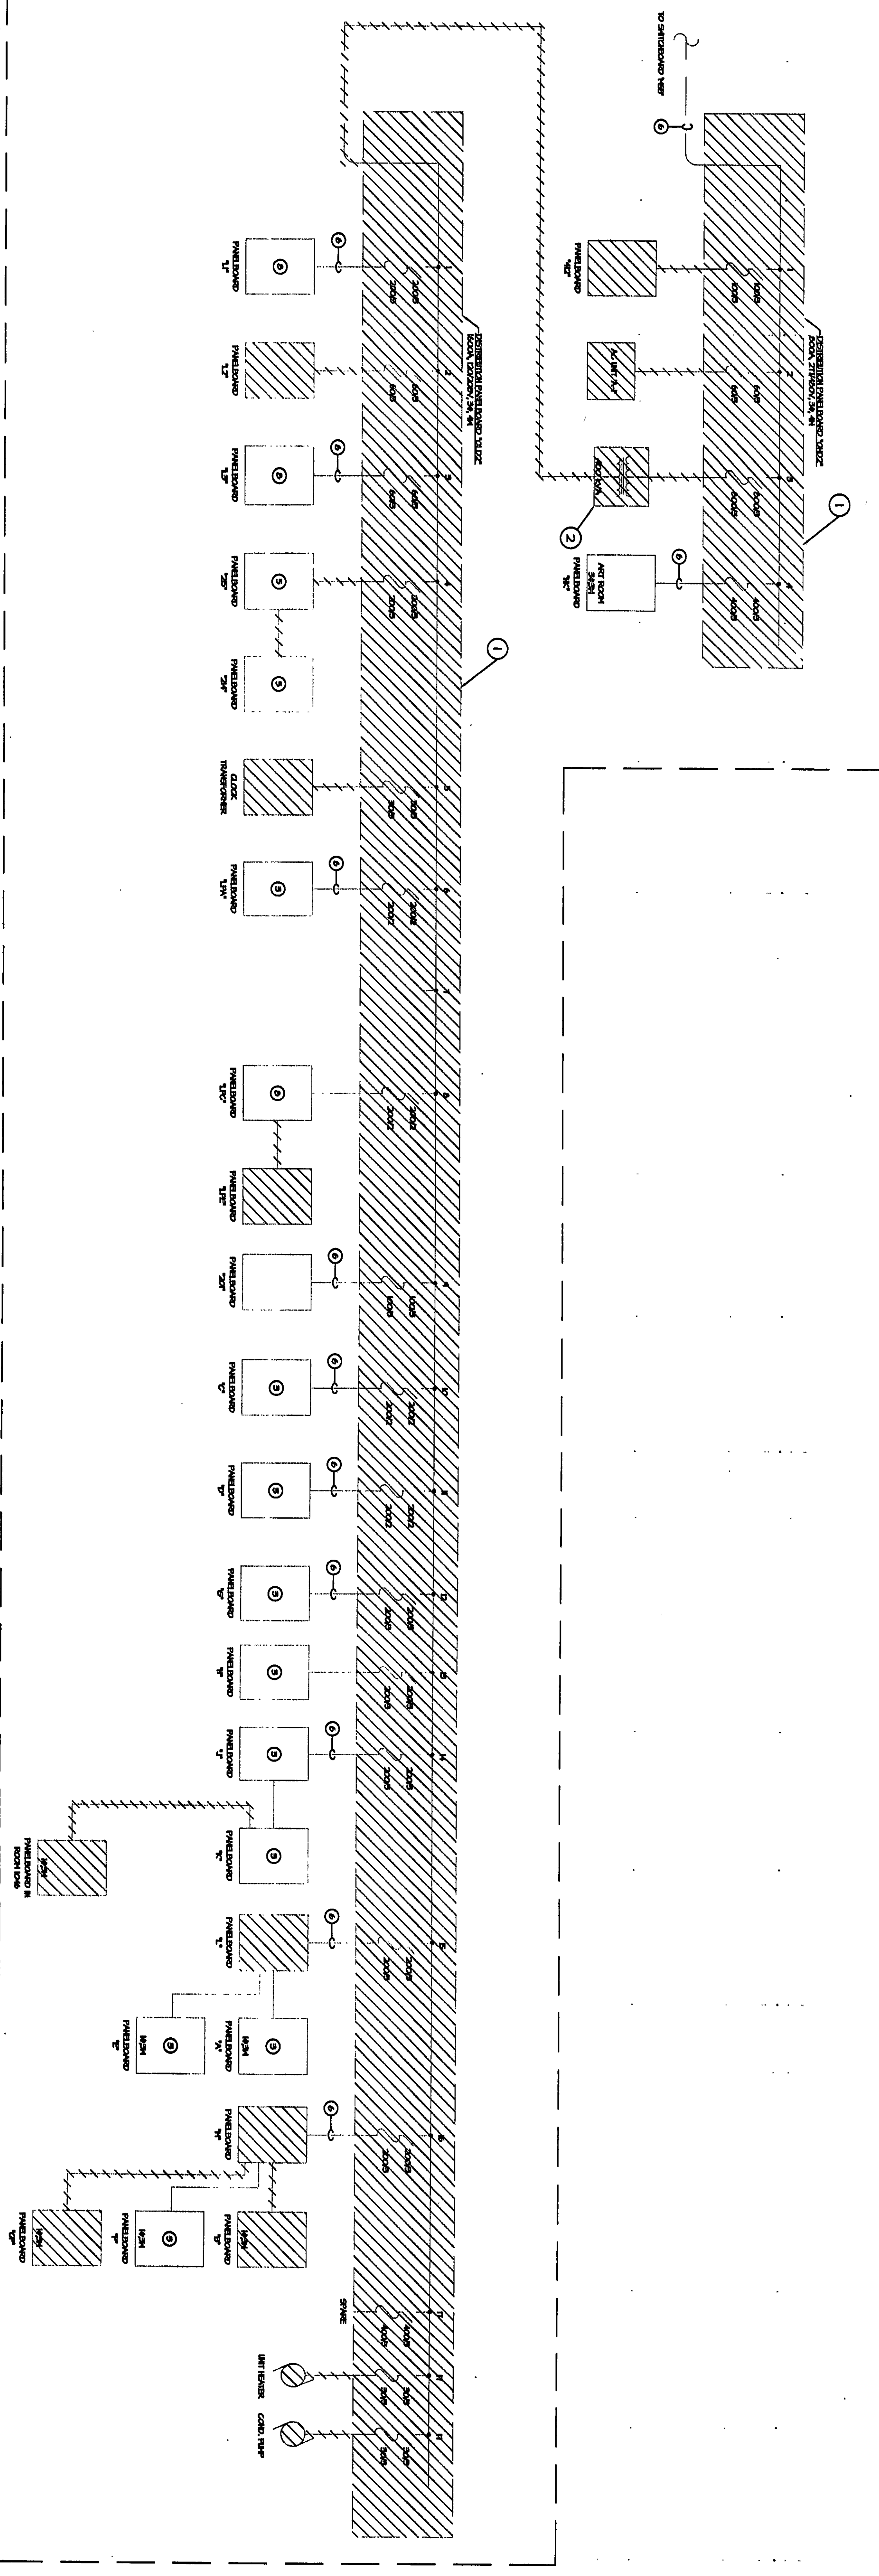

GENERAL ELECTRICAL NOTES

1. RE-USE EXISTING SERVICE/PANEL WITH NEW EQUIPMENT. SEE SHEET E-4.
2. RE-USE EXISTING TRANSFORMER WITH NEW EQUIPMENT. SEE SHEET E-4.
3. DISCONNECT AND REMOVE PANELS AND CIRCUIT TO TEN PANEL INTERIOR.
4. CONDUIT TO REMAIN. REMOVE FEEDER CONDUCTORS.
5. EXISTING PANEL SHALL BE RELOCATED.
6. CONDUIT AND FEEDER CONDUIT TO REMAIN FOR EXISTING AND RECONNECTION TO NEW SERVICE AND TEN PANEL INTERIOR (WHERE INDICATED).
7. DISCONNECT AND REMOVE EXISTING 200V DISCONNECT CIRCUIT TO TEN SERVICE/BOILER ROOM.
8. PANELS AND CONDUIT TO REMAIN. CONDUIT TO NEW FEEDER WERE INDICATED. SEE SHEET E-4.



HATCHING INDICATES ELECTRICAL DEMOLITION

VEAZEY
PARROTT
DURKIN &
SHOULDERS

ARCHITECTS
ENGINEERS
PLANNERS

RENOVATION PROJECT FOR:
DUNEILAND SCHOOL CORP.
CHESTER HIGH SCHOOL/MIDDLE SCHOOL
CHESTER, INDIANA

Drawing Title
DEMOLITION PLAN - EXISTING
ELECTRICAL RISE DIAGRAM
Project No. 948000
Drawn By: EKH
Approved By: TLM
Drawing No. E 5.0