
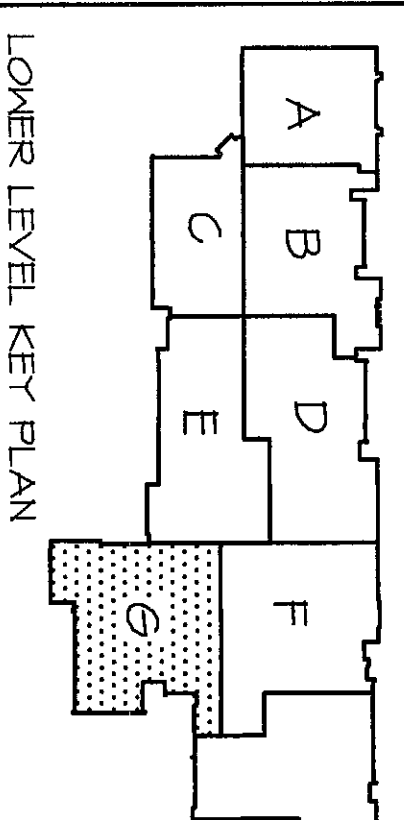
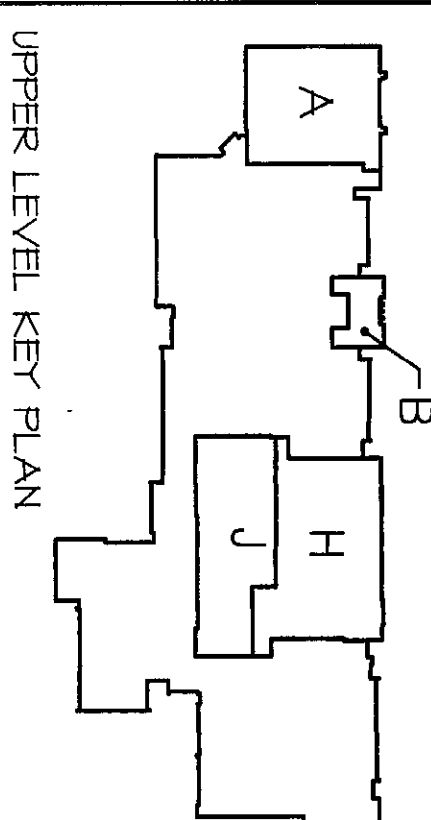


- REFERENCE NOTES:**
- 1 REMOVE EXIST. DOWNSTAGE WATER PIPING AS INDICATED IN DASHED LINES.
 - 2 REMOVE EXIST. ELECTRIC WATER COOLER. REMOVE ROUGH-IN AS REQUIRED FOR NEW EXC. SEE FUTURE SCHEDULE.
 - 3 REMOVE EXIST. WATER PIPING IN CRAWL SPACE BELOW FLOOR.
 - 4 REMOVE WATER PIPING IN CHASE.
 - 5 CM PIPING BELOW SLAB SHALL BE ABANDONED.
 - 6 REMOVE EXIST. CARRIAGE WASTE AND VENT REMAIN FOR NEW FIXTURES.

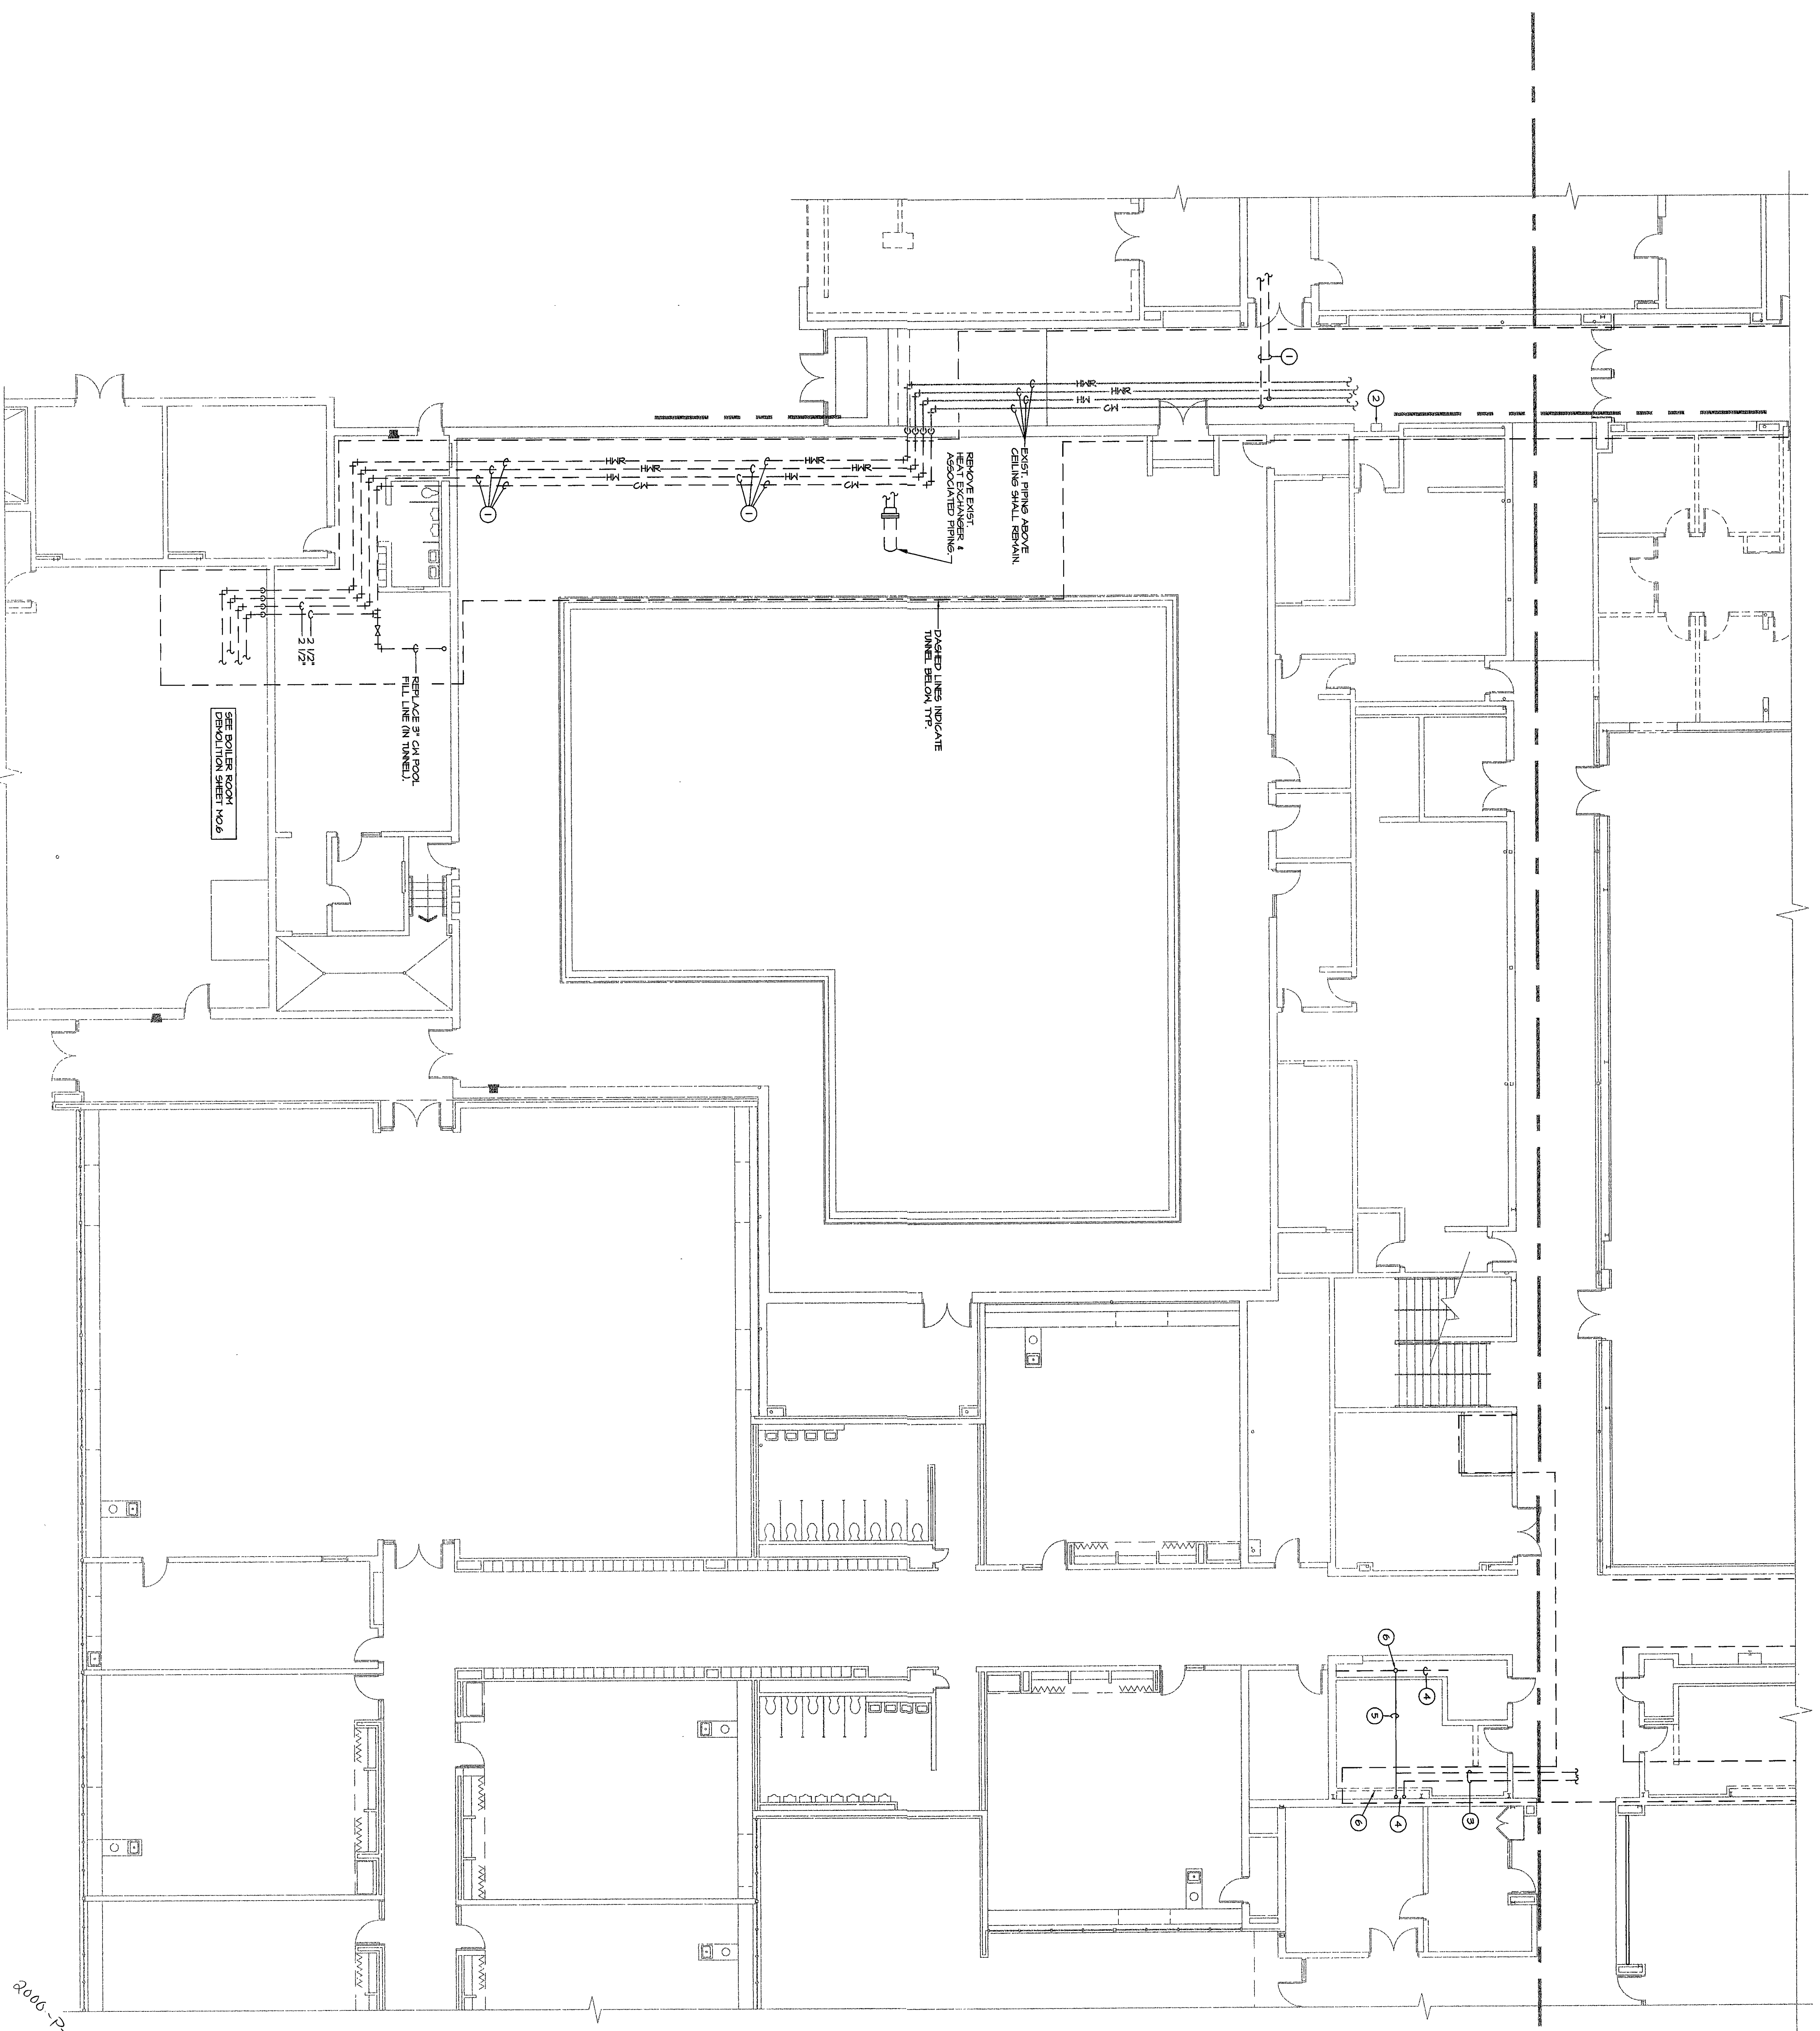

NORTH
SCALE: 1/8" = 1'-0"

ARCHITECTS
ENGINEERS
PLANNERS

**VEAZEY
PARROTT
DURKIN
&
SHOULDER**

RENOVATION PROJECT FOR:
**DUNELAND SCHOOL
CORPORATION**
CHESTERTON MIDDLE SCHOOL
CHESTERTON, INDIANA

Drawing Title
DEMOLITION PLAN - UNIT 'G'

Project No.	448000
Project Date	06-12-00
Drawn By	RLM
Approved By	KLF
Drawing No.	P 0.7

Professional Engineer
No. 19257
STATE OF INDIANA
H. B. BROWN
1000 N. ALBANY ST., SUITE 200
INDIANAPOLIS, IN 46204