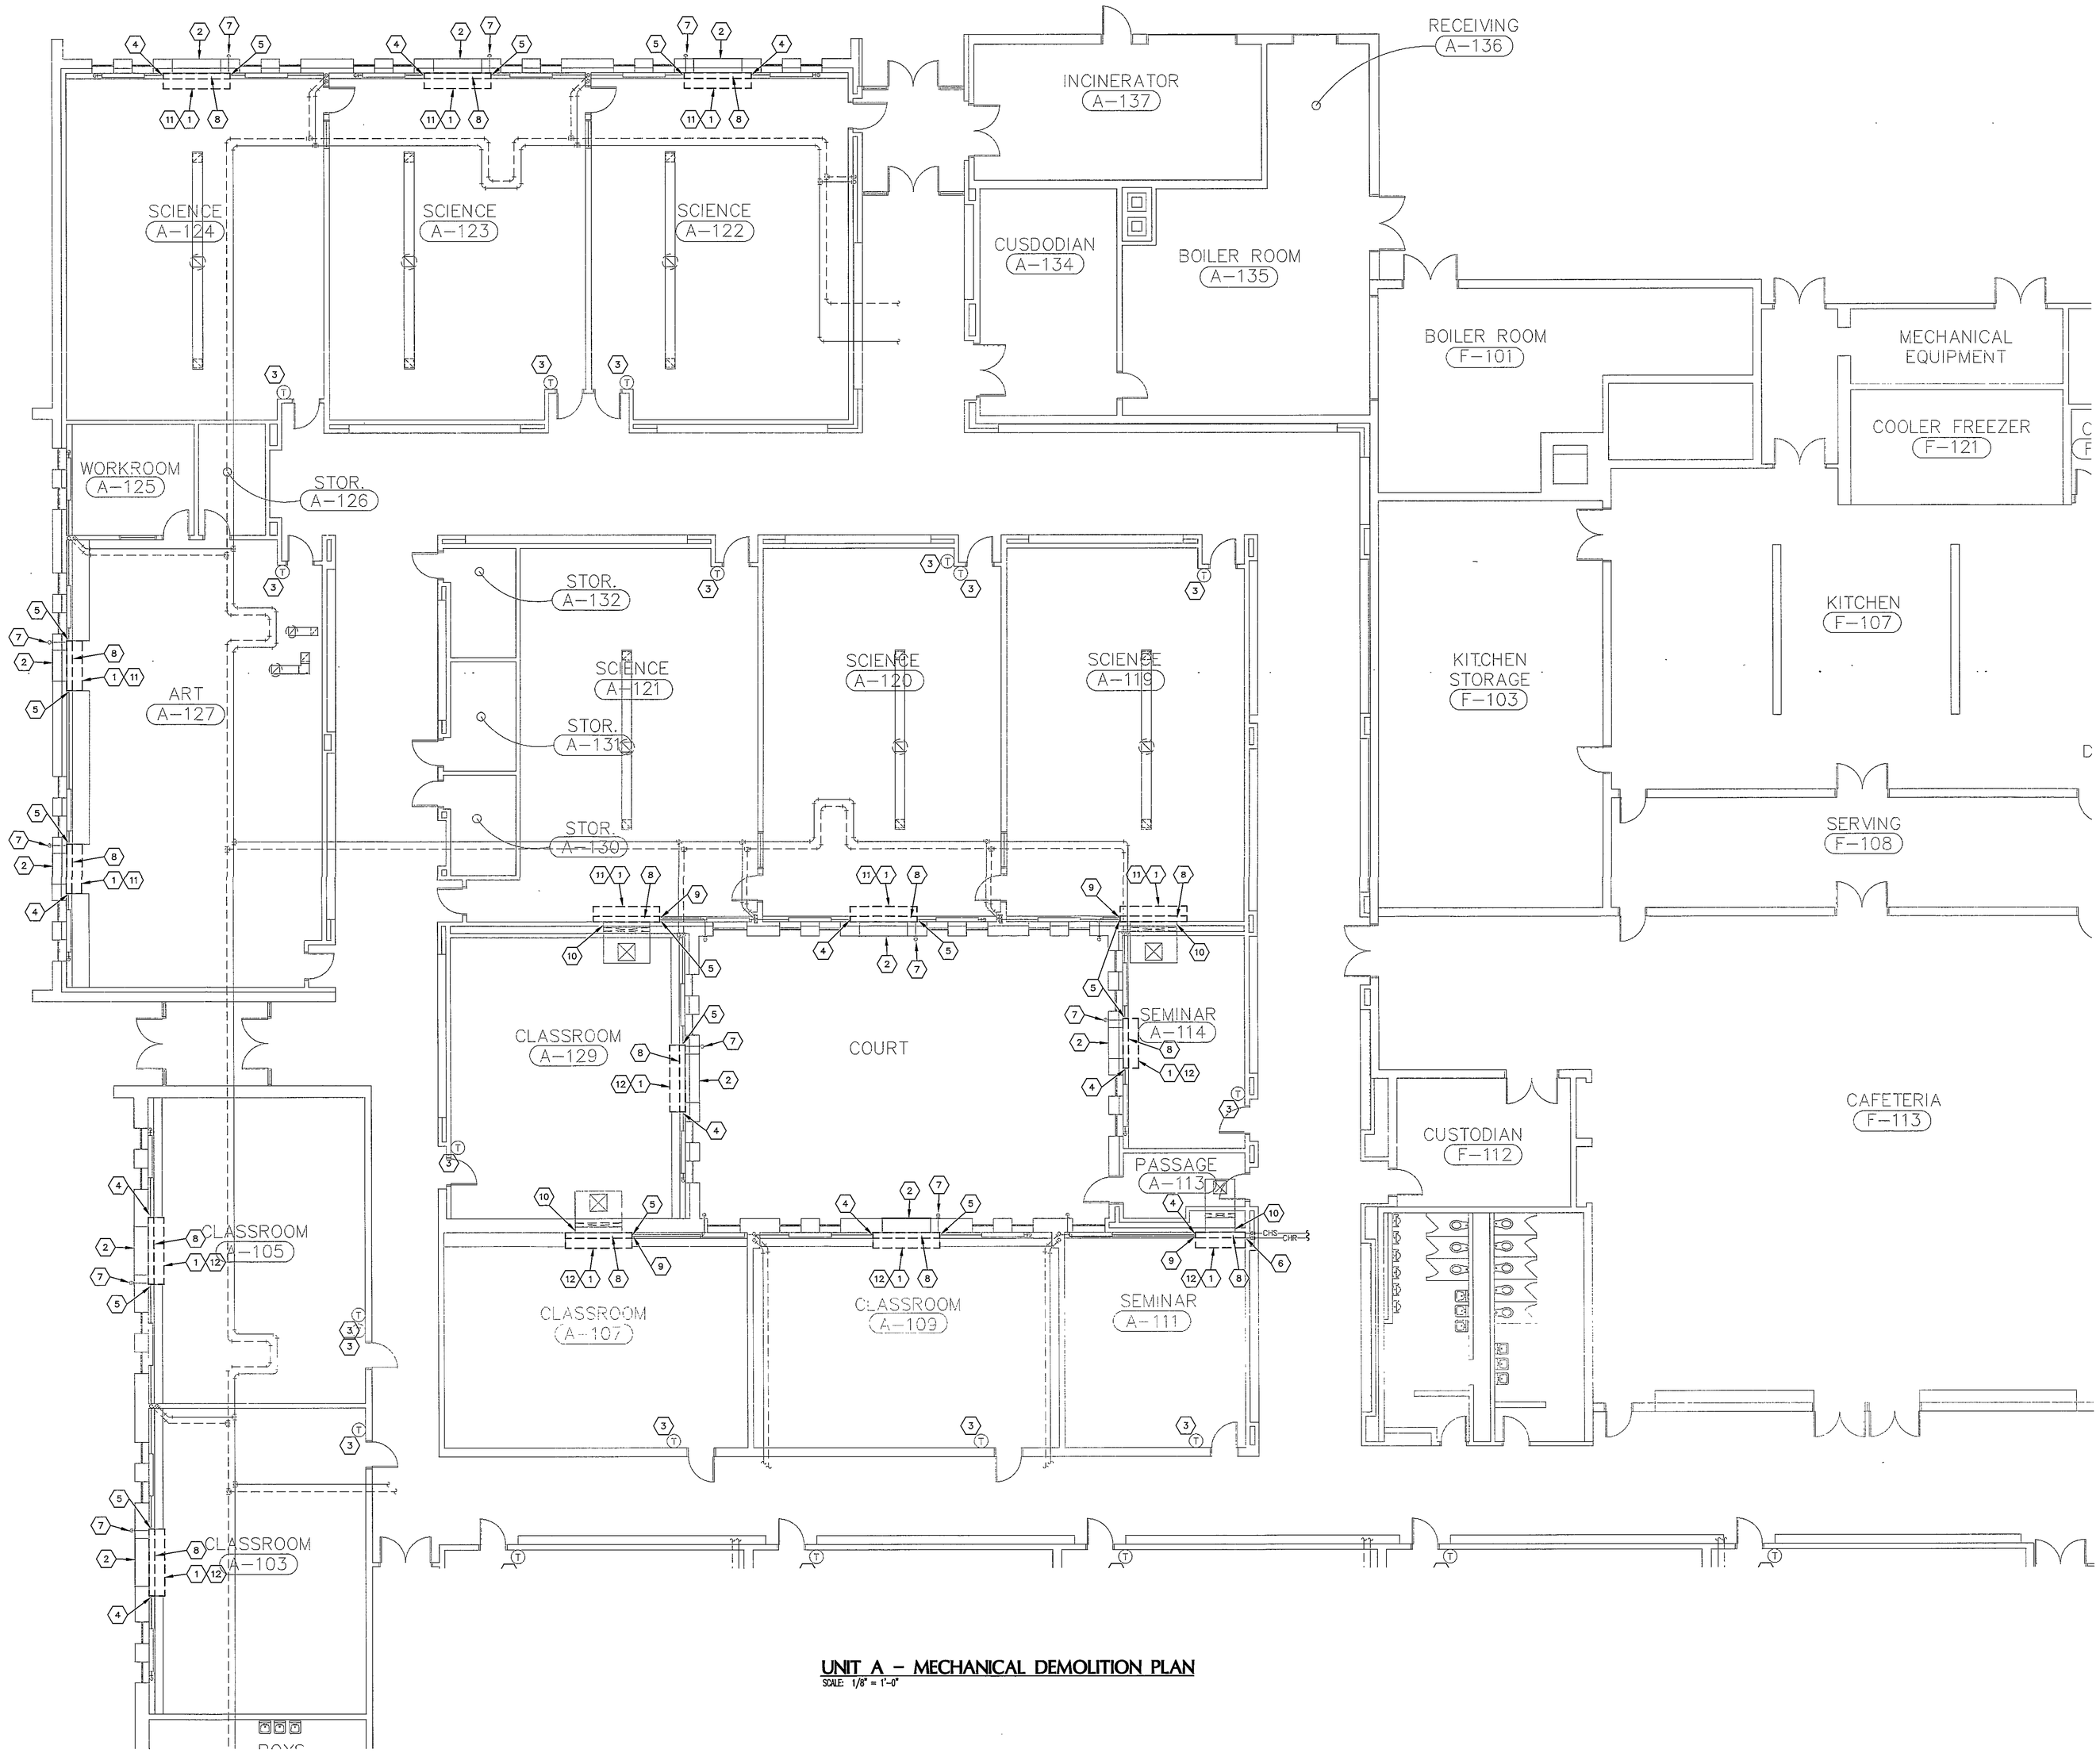

UNIT A – MECHANICAL DEMOLITION PLAN

SCALE: 1/8" = 1'-0"

DEMOLITION NOTES:

1. REMOVE EXIST. UNIT VENTILATOR AND RELATED HEATING HW SUPPLY & RETURN LINES, CHILLED WATER SUPPLY & RETURN LINES, CONDENSATE DRAIN LINE, VALVES, CONTROLS AND ACCESSORIES COMPLETE. CONTRACTOR TO REMOVE UNIT VENT. FROM THE BUILDING TO THE REAR PARKING LOT WHERE THE OWNER WILL TAKE POSSESSION FOR SALVAGE AND SCRAP.
2. EXISTING OUTSIDE AIR LOUVER AND WALL SLEEVE TO REMAIN. PREPARE WALL SLEEVE FOR RECONNECTION. SEE SHEET ME-3 & ME-4 FOR NEW WORK.
3. EXISTING THERMOSTAT AND RELATED AIR LINES TO BE REMOVED AND REPLACED BY OWNER.
4. REMOVE EXIST. HEATING HOT WATER SUPPLY & RETURN LINES TO THIS POINT COMPLETE AND PREPARE FOR RECONNECTION AS REQUIRED. SEE SHEET ME-3 & ME-4 FOR NEW WORK.
5. REMOVE EXIST. HEATING HOT WATER SUPPLY & RETURN LINES AND CHILLED WATER SUPPLY & RETURN LINES TO THIS POINT COMPLETE AND PREPARE FOR RECONNECTION AS REQUIRED. SEE SHEET ME-3 & ME-4 FOR NEW WORK.
6. REMOVE EXIST. CHILLED WATER SUPPLY & RETURN LINES TO THIS POINT COMPLETE AND PREPARE FOR RECONNECTION AS REQUIRED. SEE SHEET ME-3 & ME-4 FOR NEW WORK.
7. EXISTING CONDENSATE DRAIN LINE THRU WALL TO REMAIN. REMOVE EXIST. CONDENSATE DRAIN LINE COMPLETE TO INTERIOR WALL AND PREPARE FOR RECONNECTION AS REQUIRED. SEE SHEET ME-3 & ME-4 FOR NEW WORK.
8. REMOVE EXIST. RADIATION COVER OVER TOP OF EXIST. UNIT VENTILATOR AND MODIFY AS REQUIRED FOR RE-INSTALLATION. SEE SHEET ME-3 & ME-4 FOR NEW WORK.
9. REMOVE EXIST. CONDENSATE DRAIN LINE TO THIS POINT COMPLETE AND PREPARE FOR RECONNECTION AS REQUIRED. SEE SHEET ME-3 & ME-4 FOR NEW WORK.
10. EXISTING OUTSIDE AIR DUCT TO REMAIN. PREPARE O.A. DUCT FOR RECONNECTION. SEE SHEET ME-3 & ME-4 FOR NEW WORK.
11. EXISTING 120 VOLT WIRING AND CONDUIT THRU FLOOR SERVING UNIT VENTILATOR TO REMAIN FOR EXTENSION TO NEW EQUIPMENT.
12. EXISTING 120 VOLT WIRING, CONDUIT AND 4"x 4" JUNCTION BOX SERVING UNIT VENTILATOR TO REMAIN FOR EXTENSION TO NEW EQUIPMENT.

STAIR ASSOCIATES INC.
MECHANICAL/ELECTRICAL
3760 W. 96TH STREET INDIANAPOLIS, IN. 46268
PHONE 317-228-1900 FAX 317-228-1700

REVISIONS:

UNIT VENTILATOR REPLACEMENT AT
LIBERTY INTERMEDIATE SCHOOL
50 W., 900 N.
CHESTERTON, INDIANA 46304

UNIT A – MECHANICAL DEMOLITION PLAN

PROJECT NO. 943

DATE 03/28/2008

DRAWN BY: RWT CHECKED BY: WWH

WOODLAND WARD HOLM REGISTERED No. 21458 STATE OF IND. LAND PROFESSIONAL ENGINEER

DUNELAND SCHOOL CORPORATION
700 W. PORTER AVE.
CHESTERTON, INDIANA 46304

KEY PLAN NORTH

STAIR ASSOCIATES INC.

SHEET NO.

ME-1

Set #1

03-31-09