
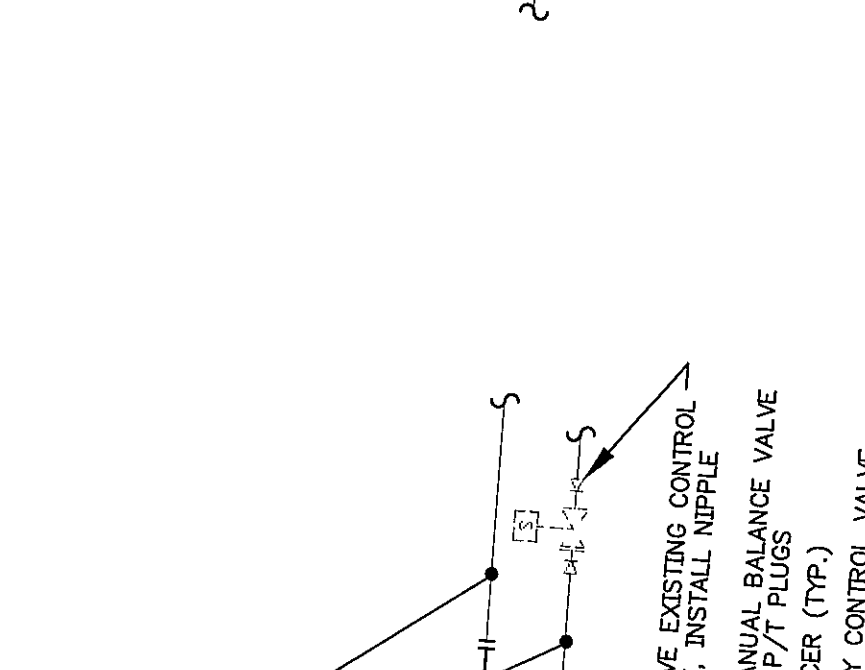
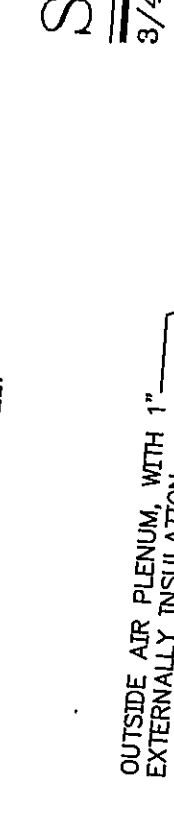
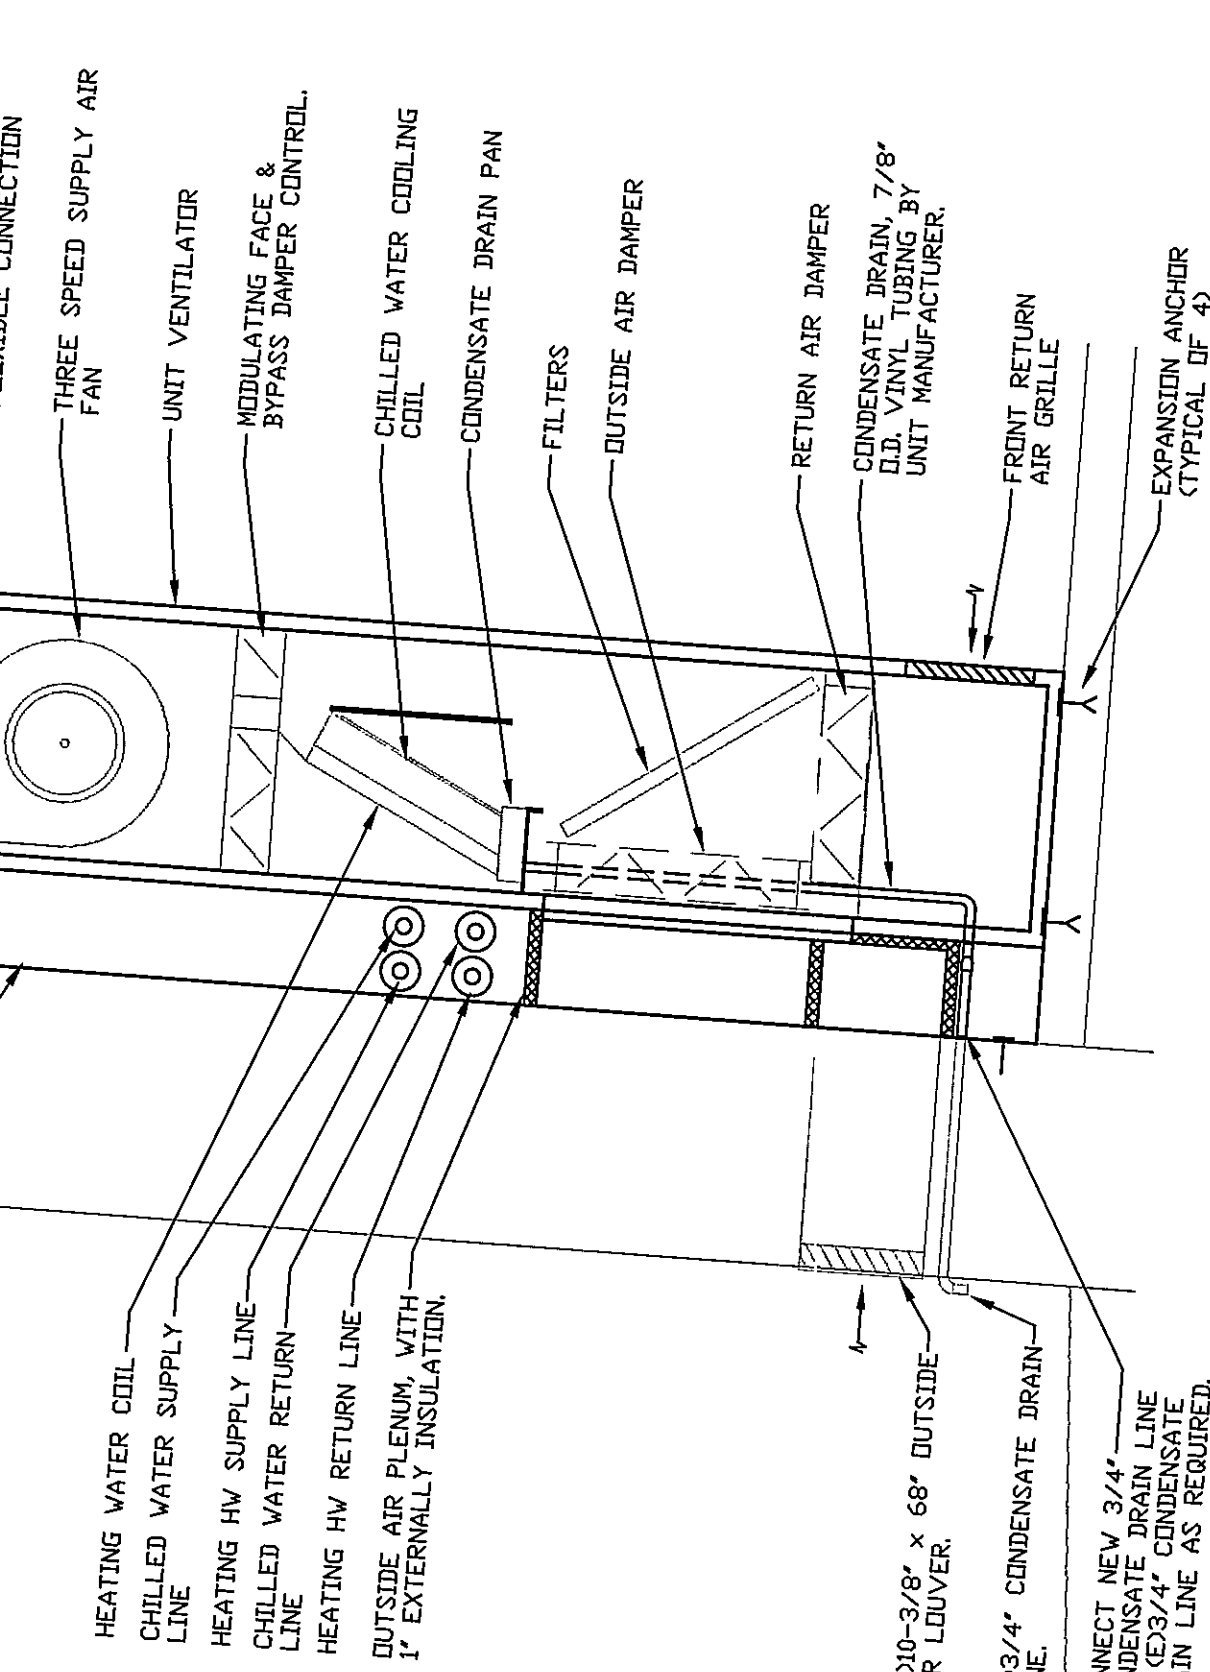
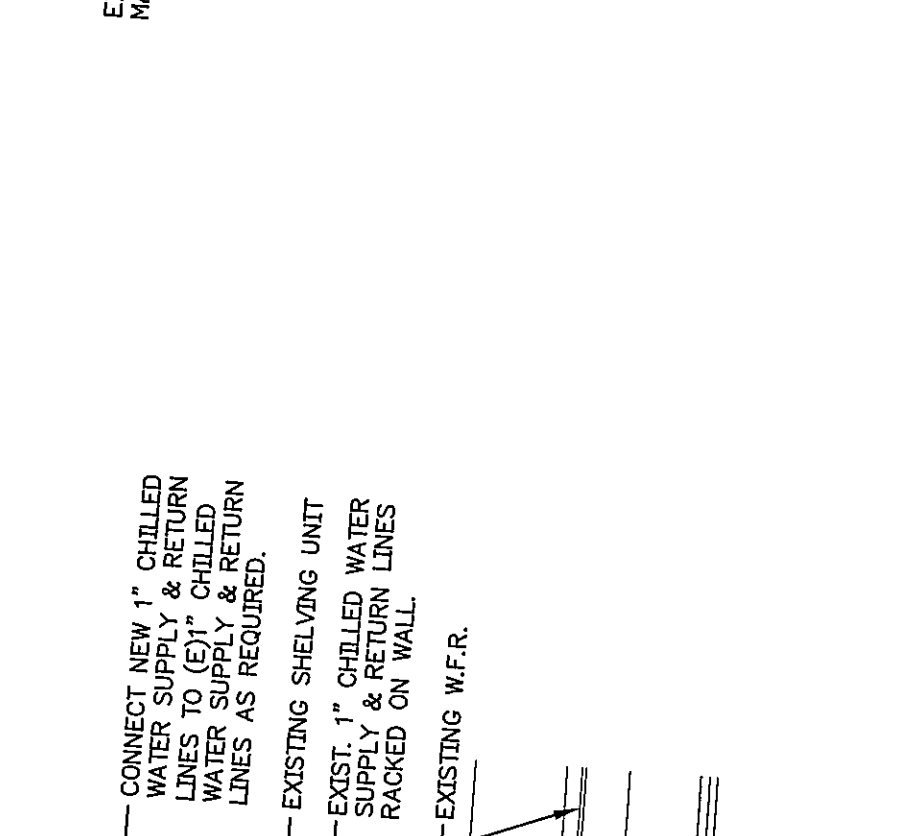


TAG	MODEL #	TOTAL	ELA	EXT	FAN	E/VAP
UV-1	TEMP/SPEC	VUD-1600	CFM	CFM	SP	HP
						L VLG ENT L VLG EXT HEATING

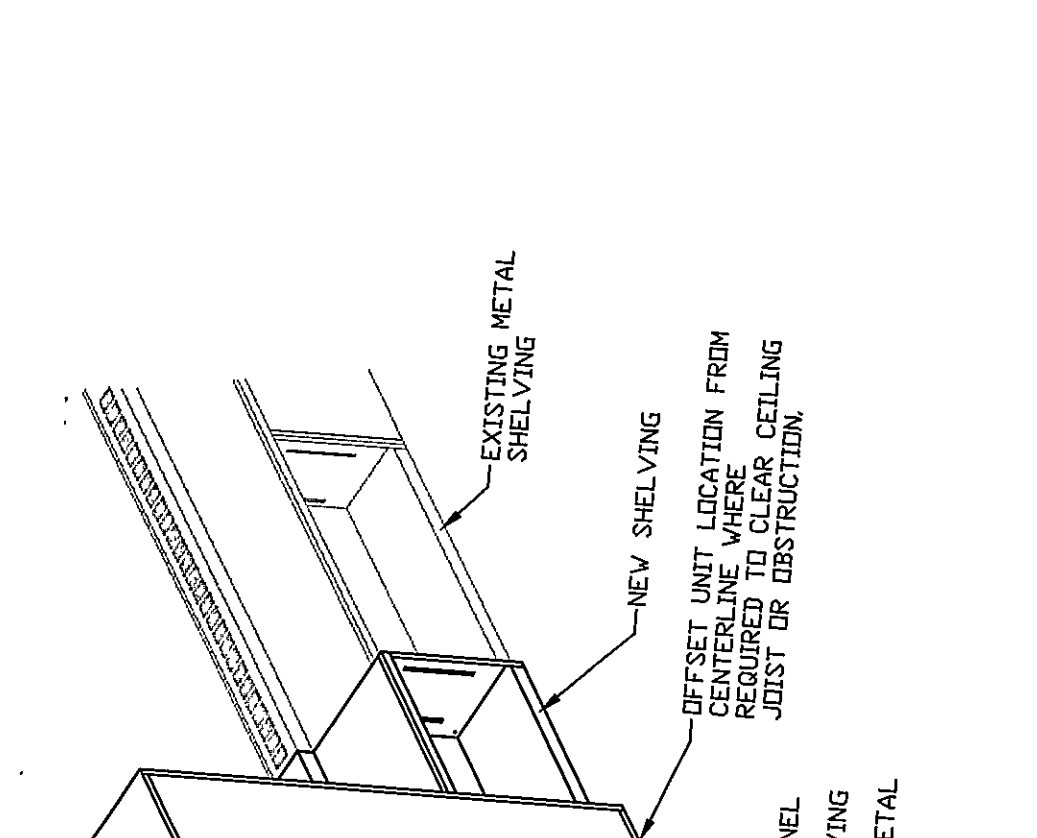


1


$$\mathbb{N}_{\text{no}}$$


UNIT DEPTH TO MATCH
EXISTING UNIT VENTILATOR
FOOTPRINT.

		CUBING				TOTAL SENSIBLE		MAX		MAX	
		LVE	ENT	LVE	WATER	MBH	MBH	30VS	WFB	WFB	WFB
ILATOR SCHEDULE	57/54/6	45	57	6.0	36.0	24.0	4	0.5	6.5	120/	120/
	60/54.0	45	57	3.0	31.0	24.0	4	0.5	6.0	120/	120/


1

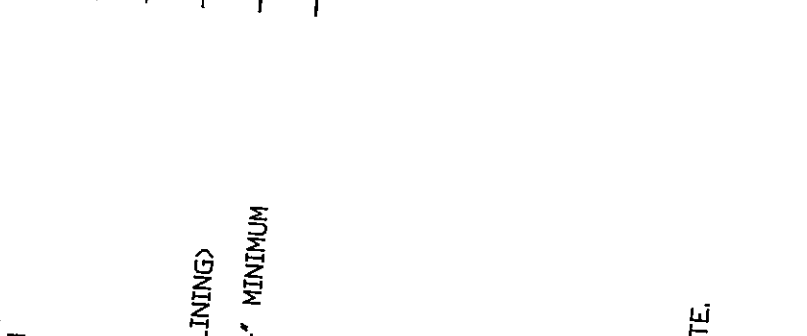

END

WATER SUPPLY
WATER RETURN
HOT WATER SUPPLY
HOT WATER RETURN
WATER SUPPLY

WATER RETURN

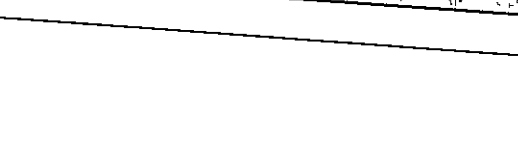

$\beta^0, \beta^1, \dots, \beta^k$
