





REVISIONS				
PROJECT NUMBER	16-026			
PROJECT MANAGER	PF			
DRAWN BY	PF			
ISSUED FOR PROPOSAL 06/03/2016				
EAST AND WEST BUS BARN				
FLOOR PLANS - POWER				

E0.12

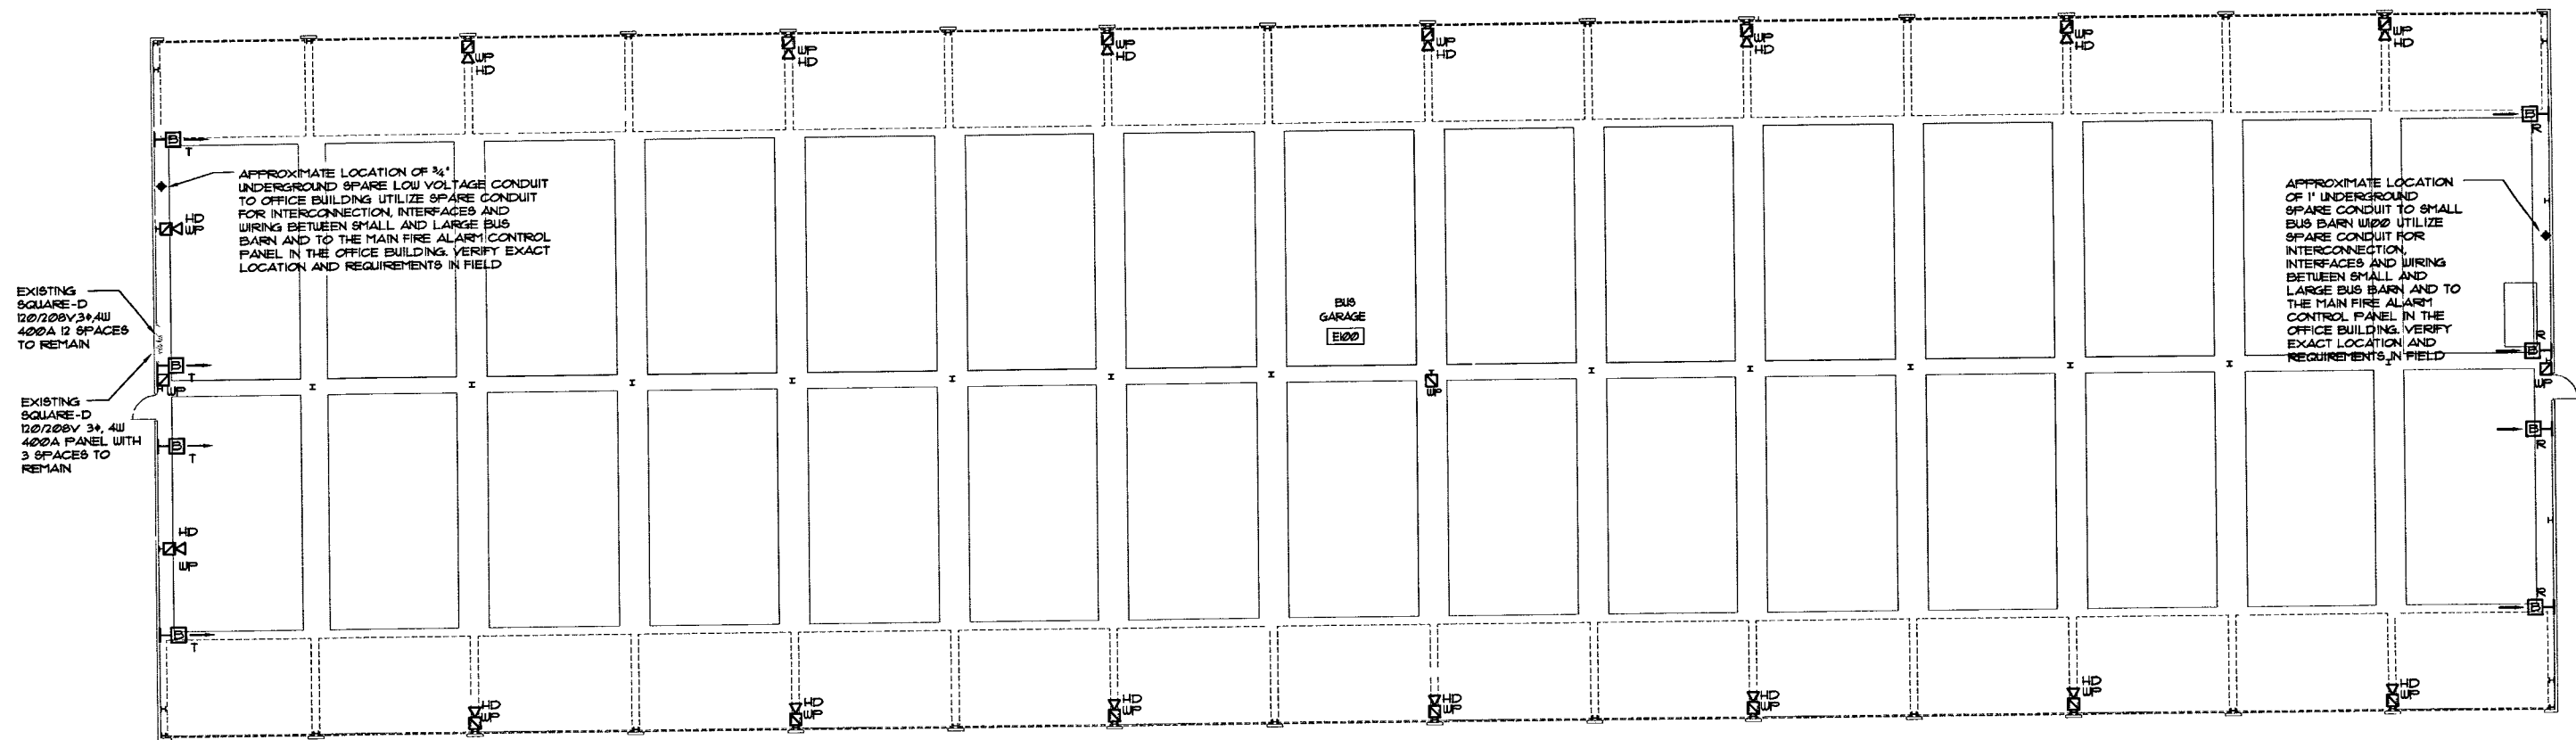

1 EAST BUS BARN - FLOOR PLAN - POWER
3/32" = 1'-0"

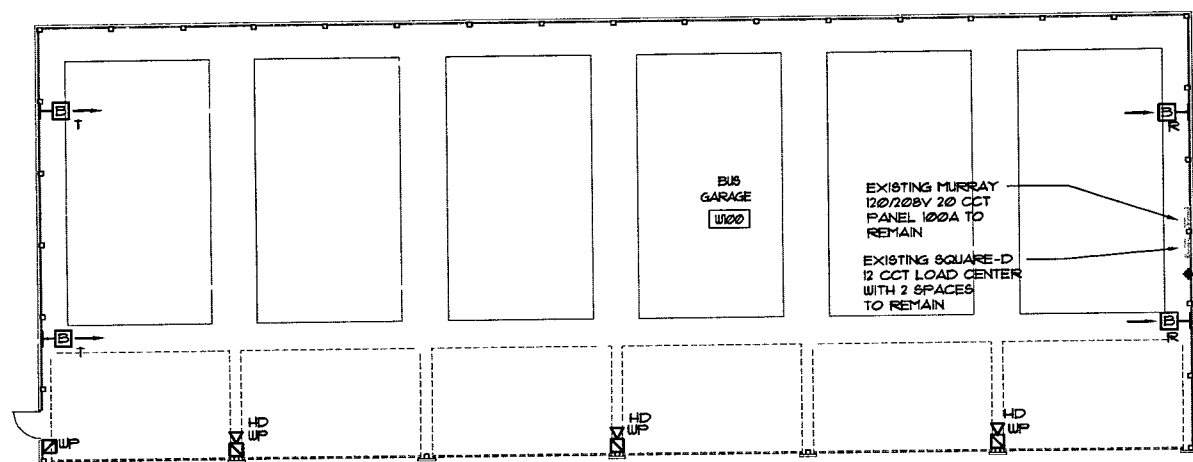

2 WEST BUS BARN - FLOOR PLAN - POWER
3/32" = 1'-0"

- 1 ALL DEVICES IN UNFINISHED STORAGE AND GARAGE SPACES SHALL BE MOUNTED TO STEEL FRAMING ONLY. HOLES SHALL NOT BE CUT INTO THE METAL BUILDING.
- 2 SURFACE MOUNTED RACEWAYS SHALL BE PROVIDED AT ALL OCCUPIED SPACES - COLOR TO BE SELECTED BY ARCHITECT
- 3 SURFACE MOUNTED CONDUIT AND KNOCK BOXES ARE TO BE PROVIDED AT ALL STORAGE AND GARAGE SPACES.
- 4 PANEL LOCATIONS SHALL BE VERIFIED IN FIELD BY CONTRACTOR
- 5 WALL DEVICES SHALL BE ATTACHED TO STEEL FRAMING ONLY

- APPROXIMATE LOCATION OF 1" UNDERGROUND SPARE CONDUIT TO LARGE BUS BARN ENDS UTILIZE SPARE CONDUIT FOR INTERCONNECTION, INTERFACES AND WIRING BETWEEN SMALL AND LARGE BUS BARN AND TO THE MAIN FIRE ALARM CONTROL PANEL IN THE OFFICE BUILDING. VERIFY EXACT LOCATION AND REQUIREMENTS IN FIELD

