

LIGHTING FIXTURE SCHEDULE

TAG	GENERAL LOCATION	MANUFACTURER CATALOG NUMBER	MANUFACTURER CATALOG NUMBER	LAMPS	MOUNTING	REMARKS
F-1	CLASSROOMS	SOLAR 25A224B	400-6604	2-40W T12 85-FLUOR	SURFACE	
F-2	GEN PURPOSE R DINING RM	SOLAR 25A44A	400-6607	4-40W T12 85-FLUOR	PENDANT	
F-3	CORRIDOR	SOLAR 25A44A	400-6607	2-30W T12 85-FLUOR	SURF.	
F-4	CORR. 32, 35 LOBBY ENT. OFFICE	DAYLITE WHITE	—	1-150W HANGDOWN	RECESSED	
F-5	OUTSIDE CAUPLY	MARCO AD-150-AZ	—	1-100W INC.	SURF.	
F-6	TOILET ROOMS	HALO H310	—	2-60W INC.	SURF.	
F-7	JAN. CLOSET	ALABAX 3140	—	1-100W INC.	SURF.	
F-8	SOILER RM. MECH EQ. RM.	BENJAMIN 5642	—	1-150W INC.	PEND.	W/TH SELF ALIGNING HANGER & COUD. STEM, LENGTH AS REQUIRED
F-9	DISPLAY CASE	MARCO J34-45-P	—	1-150W INC.	REC.	
F-10	KITCHEN	LUMINEX CELL INC	—	2-40W T12 85-FLUOR	SURF	WHITE ACETIC PLASTIC, GARINET
F-11	GEN PURPOSE R DINING RM.	PRESTOLITE W5-20	—	1-150W INC.	SURFACE WALL	
F-12	SITE LIGHTING	BEVERLY ELER, I F 2633, F 400	—	1-150W INC.	POLE 740/620 W/1/4" ARM - 6'0" LONG 200-240V, BALLAST	
F-13	PIPE TUNNEL	BENJAMIN 7125-X	—	1-150W INC.	SURF	VAPOR PROOF
PK-1	EXIT SIGN	WUS ELER, I 9414-F-56	—	2-3W T5 FLUOR.	SURF	TO MEET INDIANA & LOCAL CODE GREEN LETTERS ON WHITE BACKGROUND, SINGLE FACE, GLASS SHIELD, ALUMINUM WHERE INDICATED
PK-2	EXIT SIGN	WUS ELER, I 9414-F-56	—	2-3W T5 FLUOR.	SURF	D-T-O


ELECTRICAL SYMBOL LIST

- CEILING LIGHT OUTLET
- WALL LIGHT OUTLET
- EXIT SIGN - ARROWS INDICATED THUS:
- FLUORESCENT LIGHT
- LIGHT ON CIRCUIT "A" AND SWITCH "A"
- LIGHTING FIXTURE TAG, SEE SCHEDULE
- POWER PANEL
- MAIN DISTRIBUTION PANEL
- JUNCTION OR PULL BOX
- CONDUIT & WIRE, CEILING OR WALL
- CONDUIT & WIRE, FLOOR
- CONDUIT UP
- CONDUIT DOWN
- HOMERUN TO PANELBOARD, i.e. LIGHT PANEL "A", CIRCUITS 1-3
- SINGLE POLE SWITCH
- 3-WAY SWITCH
- SWITCHES IN GANG BOX (NUMBER INDICATES QUANTITY)
- MOMENTARY CONTACT SWITCH
- MOTOR
- COMBINATION MAGNETIC STARTER & DISCONNECT SWITCH
- DISCONNECT SWITCH
- THERMAL TYPE MOTOR DISCONNECT
- GENERAL CONVENIENCE DUPLEX RECEPTACLE
- FLOOR BOX, WATERPROOF (WITH DEVICE AS INDICATED)
- PUSH BUTTON STATION WITH PILOT LIGHT
- UNIT HEATER
- UNIT VENTILATOR
- WEATHERPROOF
- ELECTRICAL CONTRACTOR
- FIRE ALARM GENERAL SIGNAL
- FIRE ALARM PULL STATION
- AUTOMATIC FIRE DETECTOR
- FIRE ALARM CONTROL PANEL
- SIGNAL SYSTEM CONDUIT, CEILING OR WALL
- SIGNAL SYSTEM CONDUIT, FLOOR
- TELEPHONE OUTLET
- TELEPHONE TERMINAL BOX
- CLOCK-SPEAKER UNIT
- CORRIDOR SPEAKER - SURF MTD.
- MICROPHONE OUTLET
- CALL ORIGINATION SWITCH ASSOCIATED WITH CLOCK-STEAMER UNIT
- TELEVISION OUTLET
- CLOCK

SECTION B
1/4" = 1'-0"







SECTION A
1/4" = 1'-0"

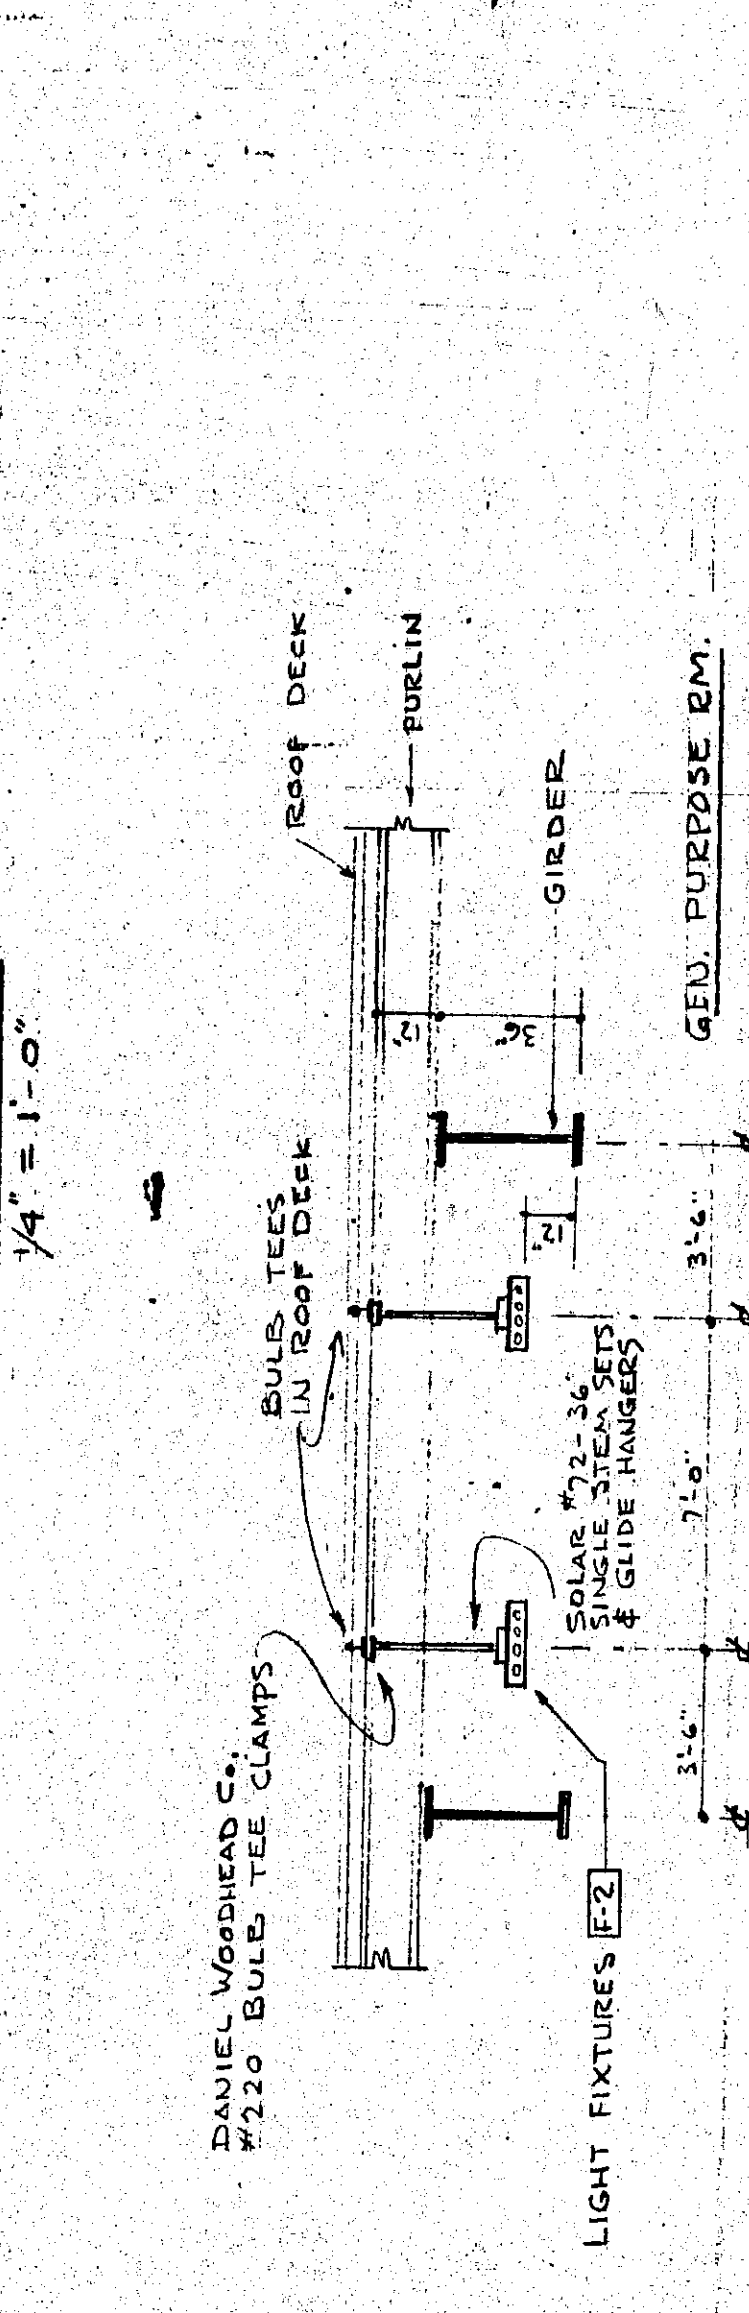

PANELBOARD SCHEDULE 208/200V 30-40 5N

PANEL TAG	CABINET TAG	1-POLE	2-POLE	3-POLE	REMARKS
LP-EM	S	100A-3P-3W	100A-3P-3W	100A-3P-3W	EM LIGHTS
LP-A	S	100A-3P-3W	100A-3P-3W	100A-3P-3W	CONSTANT SECT. EXIT SIGNS
LP-B	S	100A-3P-3W	100A-3P-3W	100A-3P-3W	CONTROLLER CONTROLLED
LP-C	F	100A-3P-3W	100A-3P-3W	100A-3P-3W	CONTROLLER CONTROLLED
LP-D	F	100A-3P-3W	100A-3P-3W	100A-3P-3W	CONTROLLER CONTROLLED
LP-E	F	100A-3P-3W	100A-3P-3W	100A-3P-3W	CONTROLLER CONTROLLED
LP-F	F	100A-3P-3W	100A-3P-3W	100A-3P-3W	CONTROLLER CONTROLLED
LP-G	F	100A-3P-3W	100A-3P-3W	100A-3P-3W	CONTROLLER CONTROLLED
PP-H	S	100A-3P-3W	100A-3P-3W	100A-3P-3W	CONTROLLER CONTROLLED
PP-J	S	100A-3P-3W	100A-3P-3W	100A-3P-3W	CONTROLLER CONTROLLED

NOTE: "PLUG FUSE ONLY" BRANCH CIRCUITS IN LP-EM
ALL OTHER PANELS SHALL BE CIRCUIT BREAKER TYPE

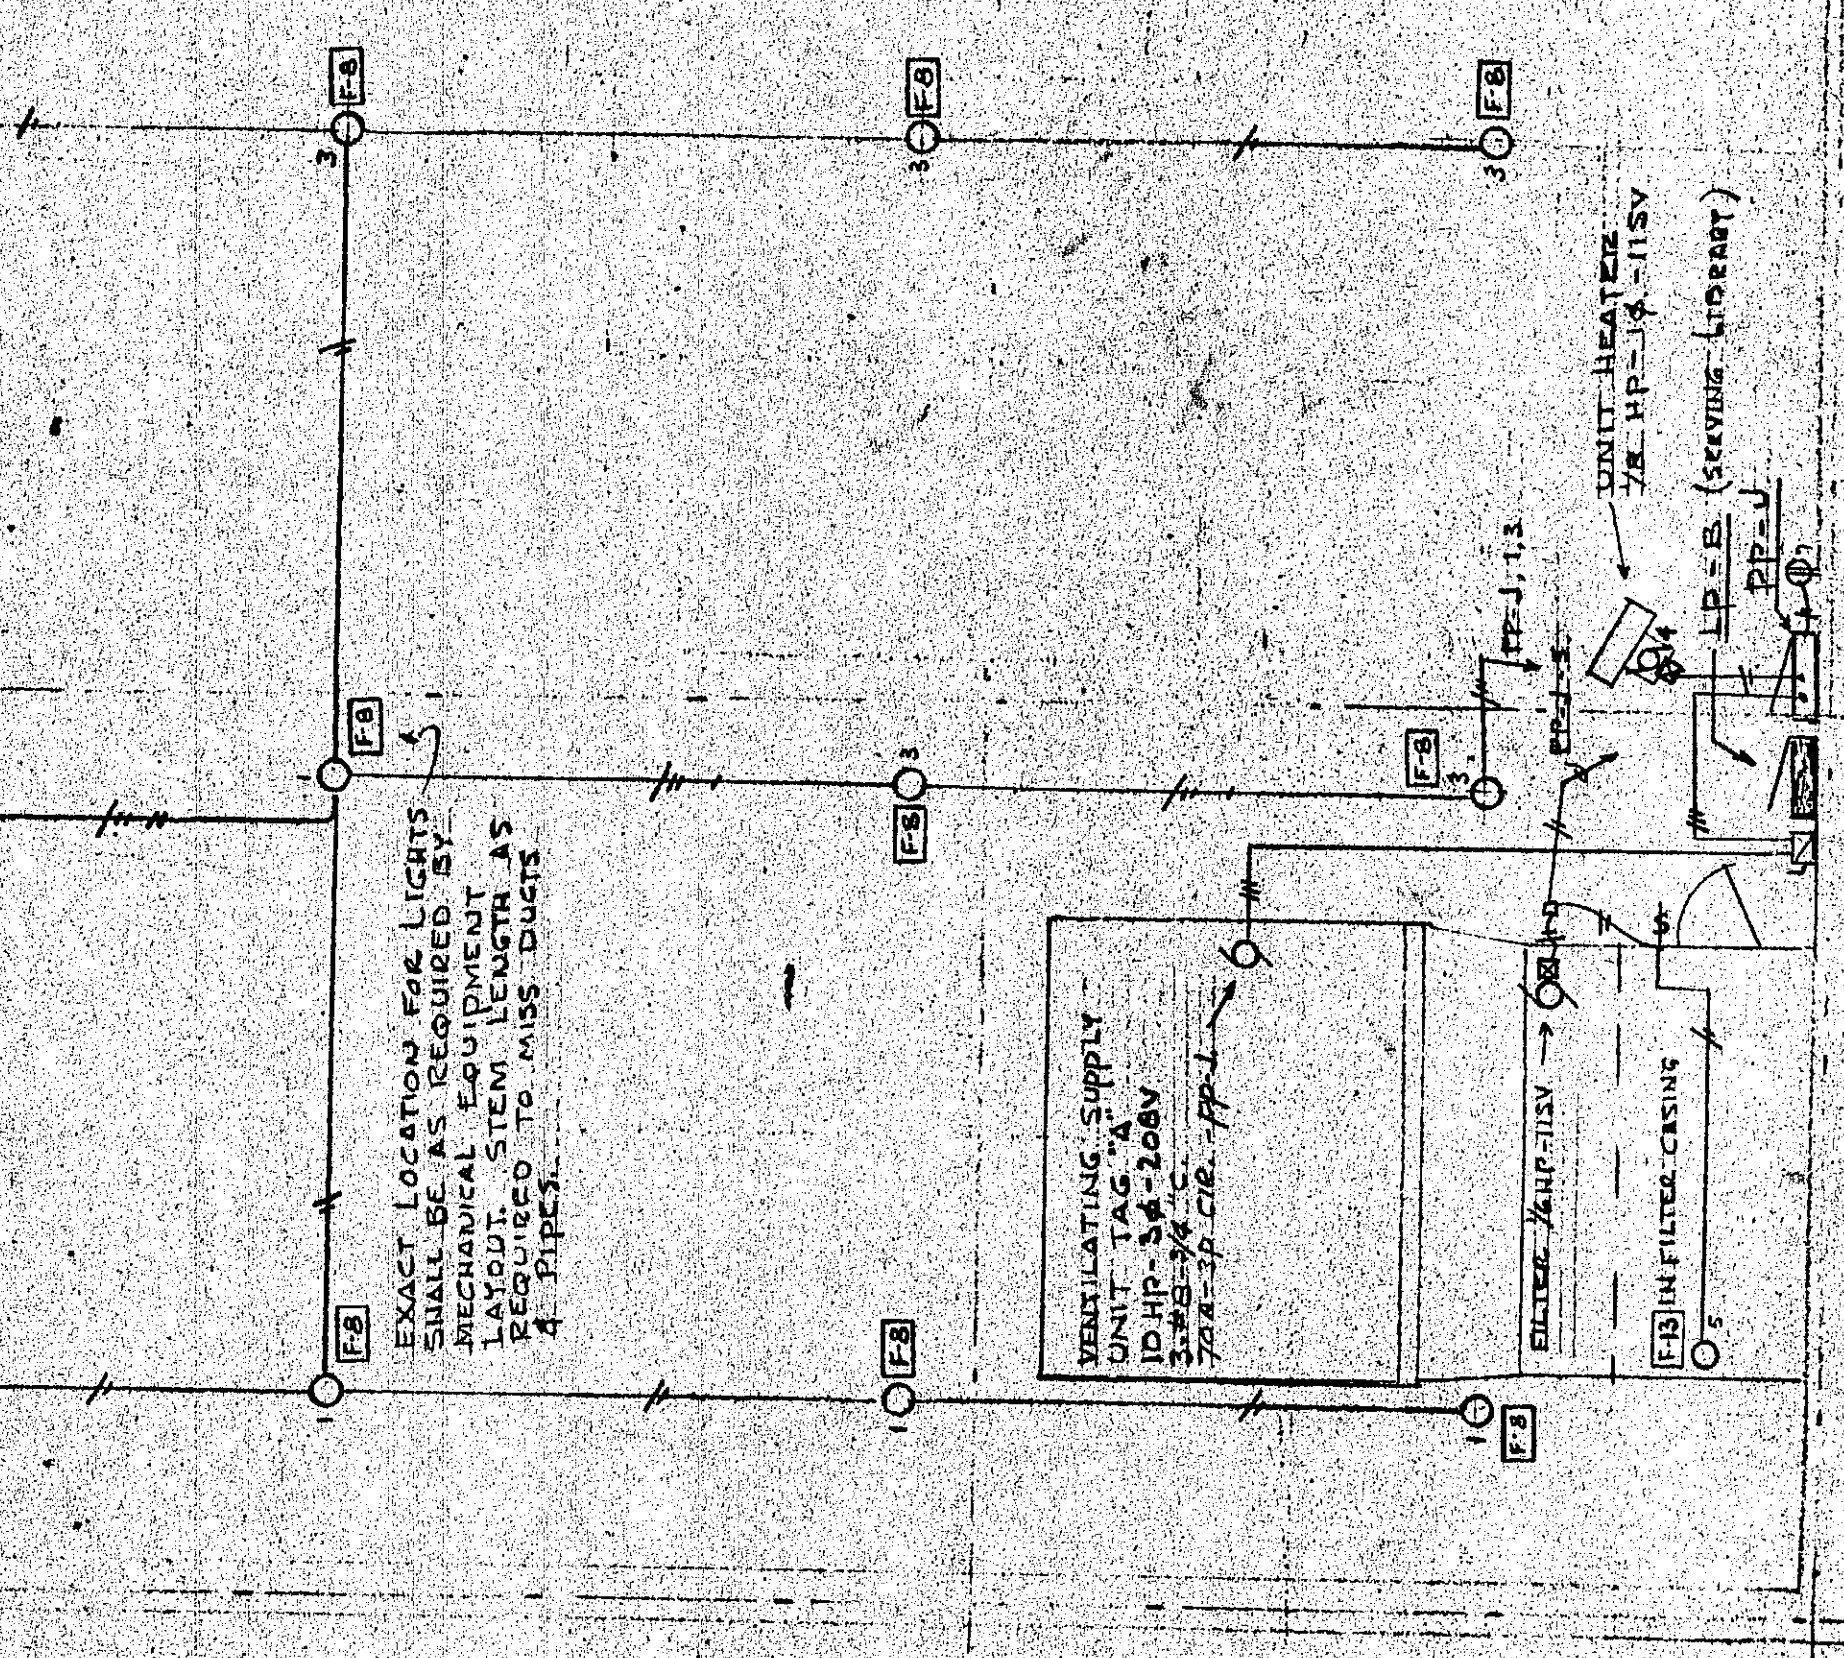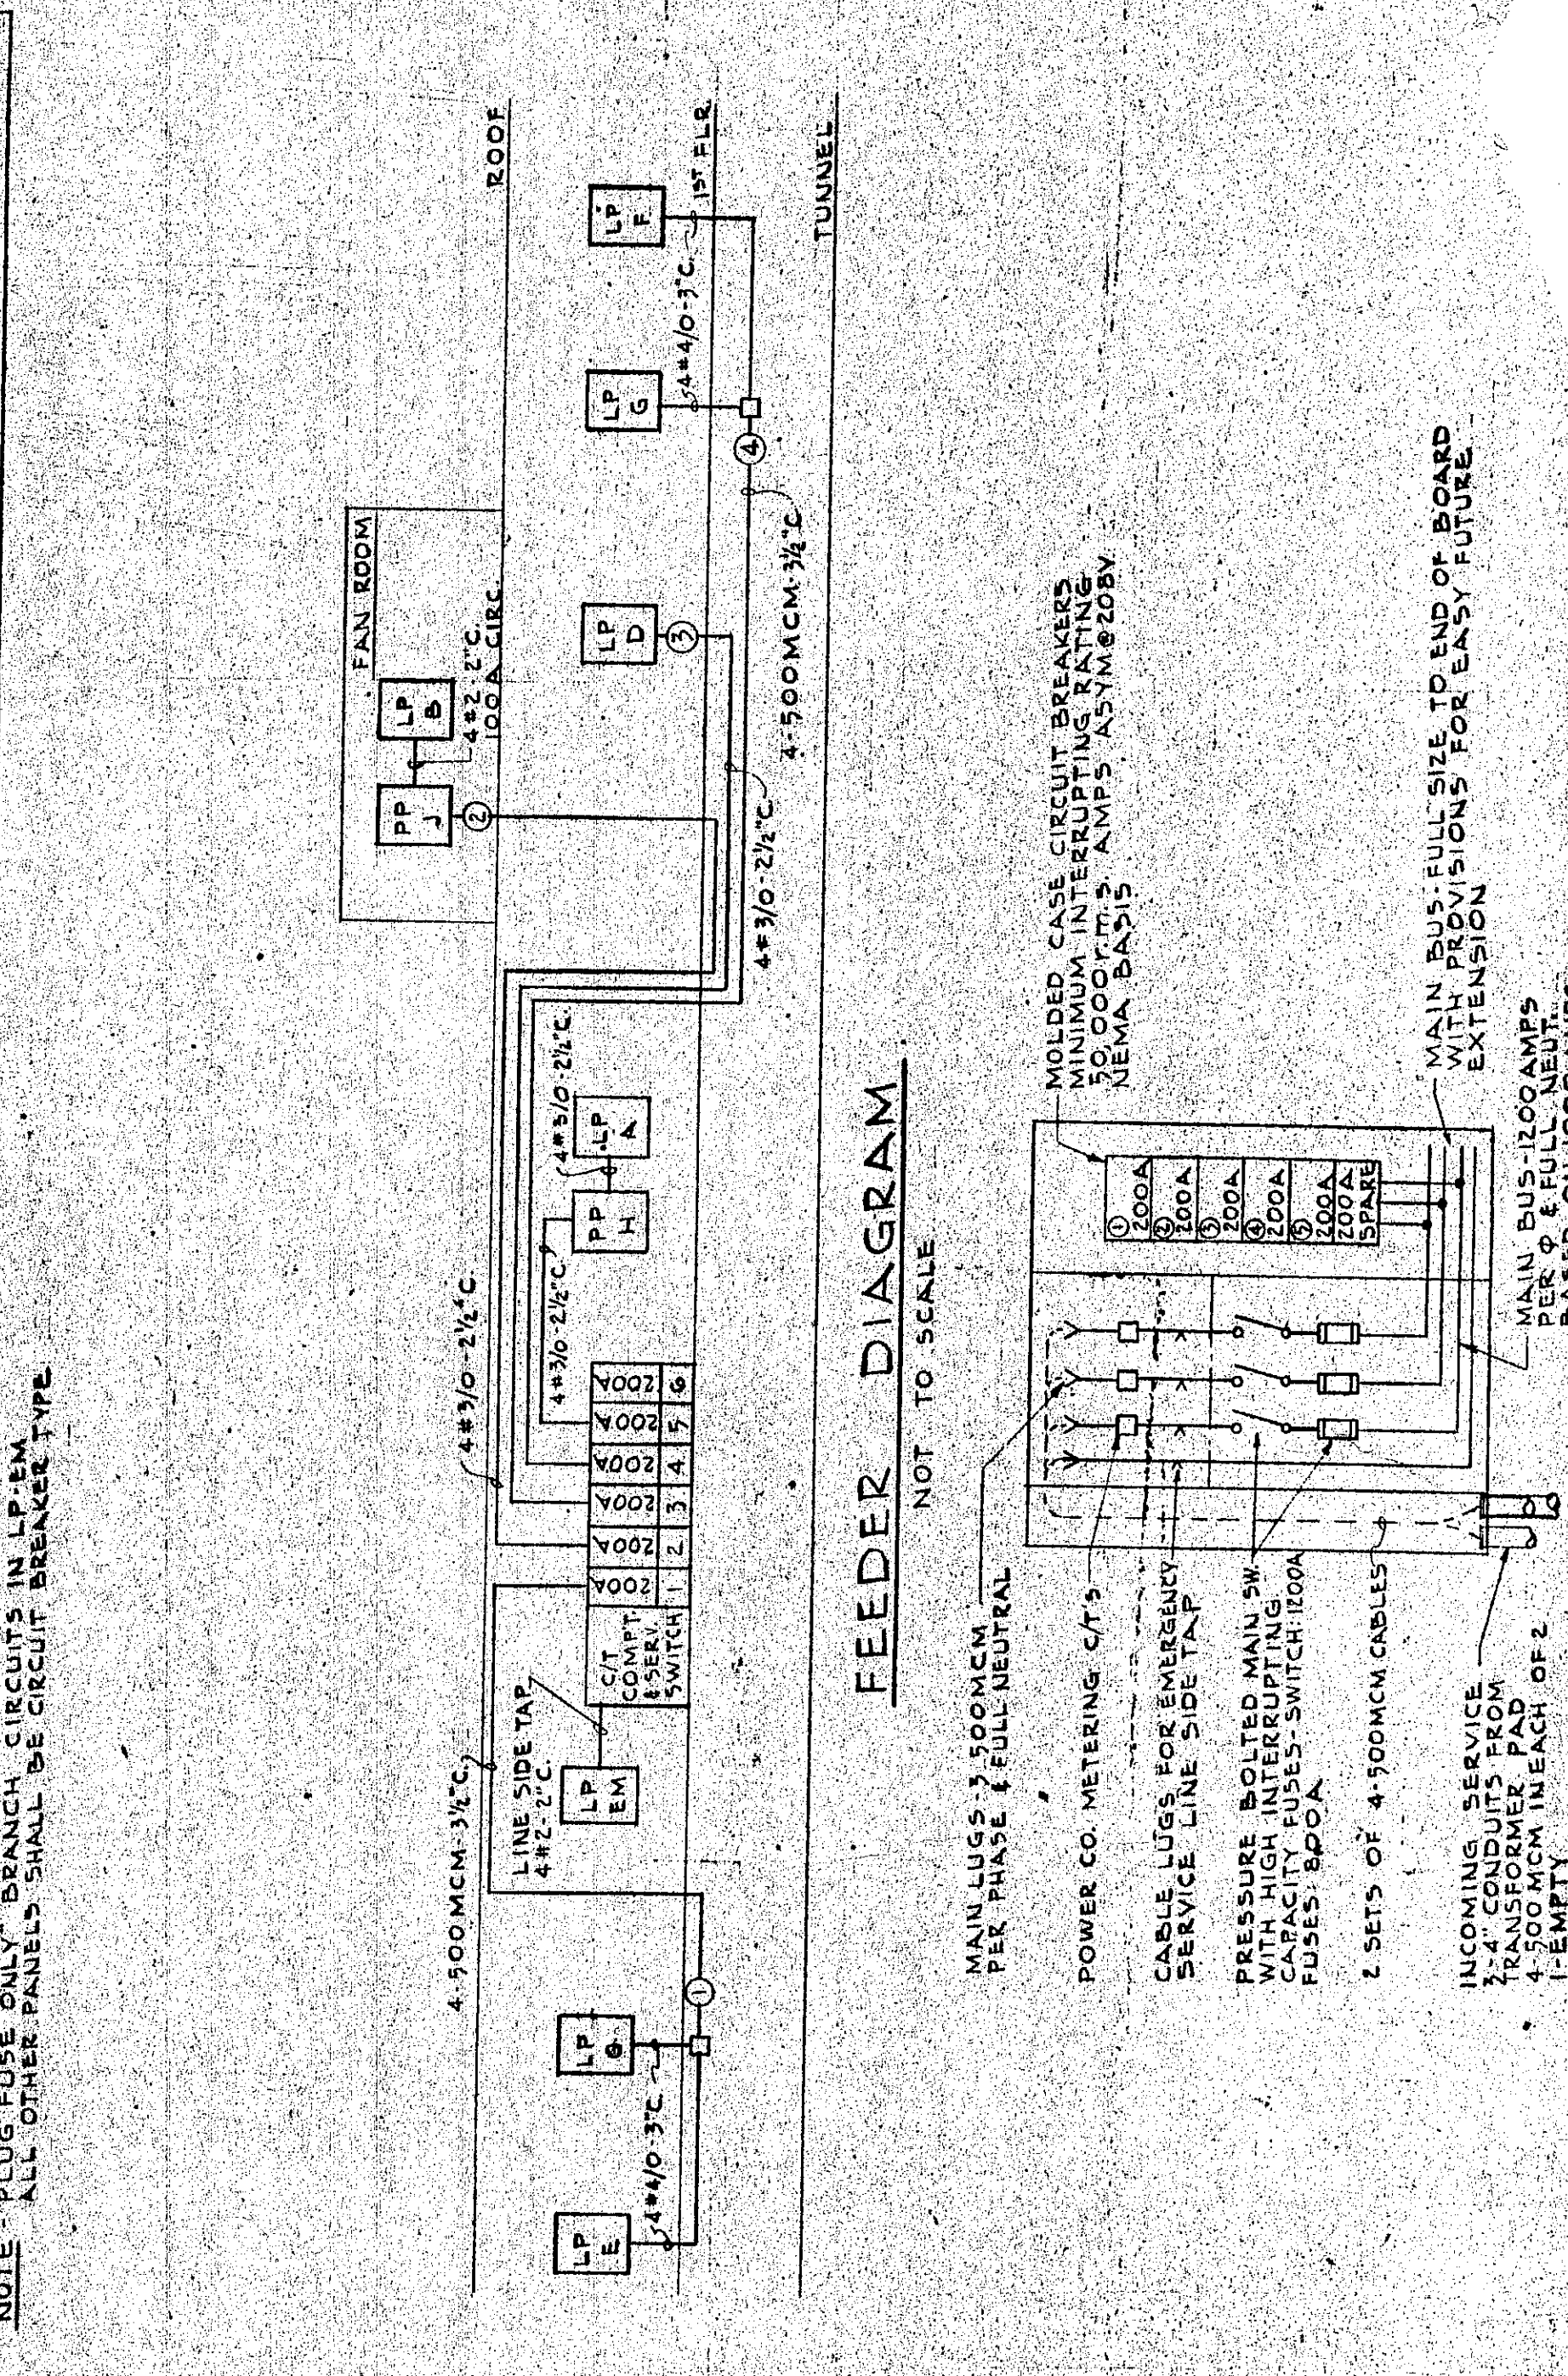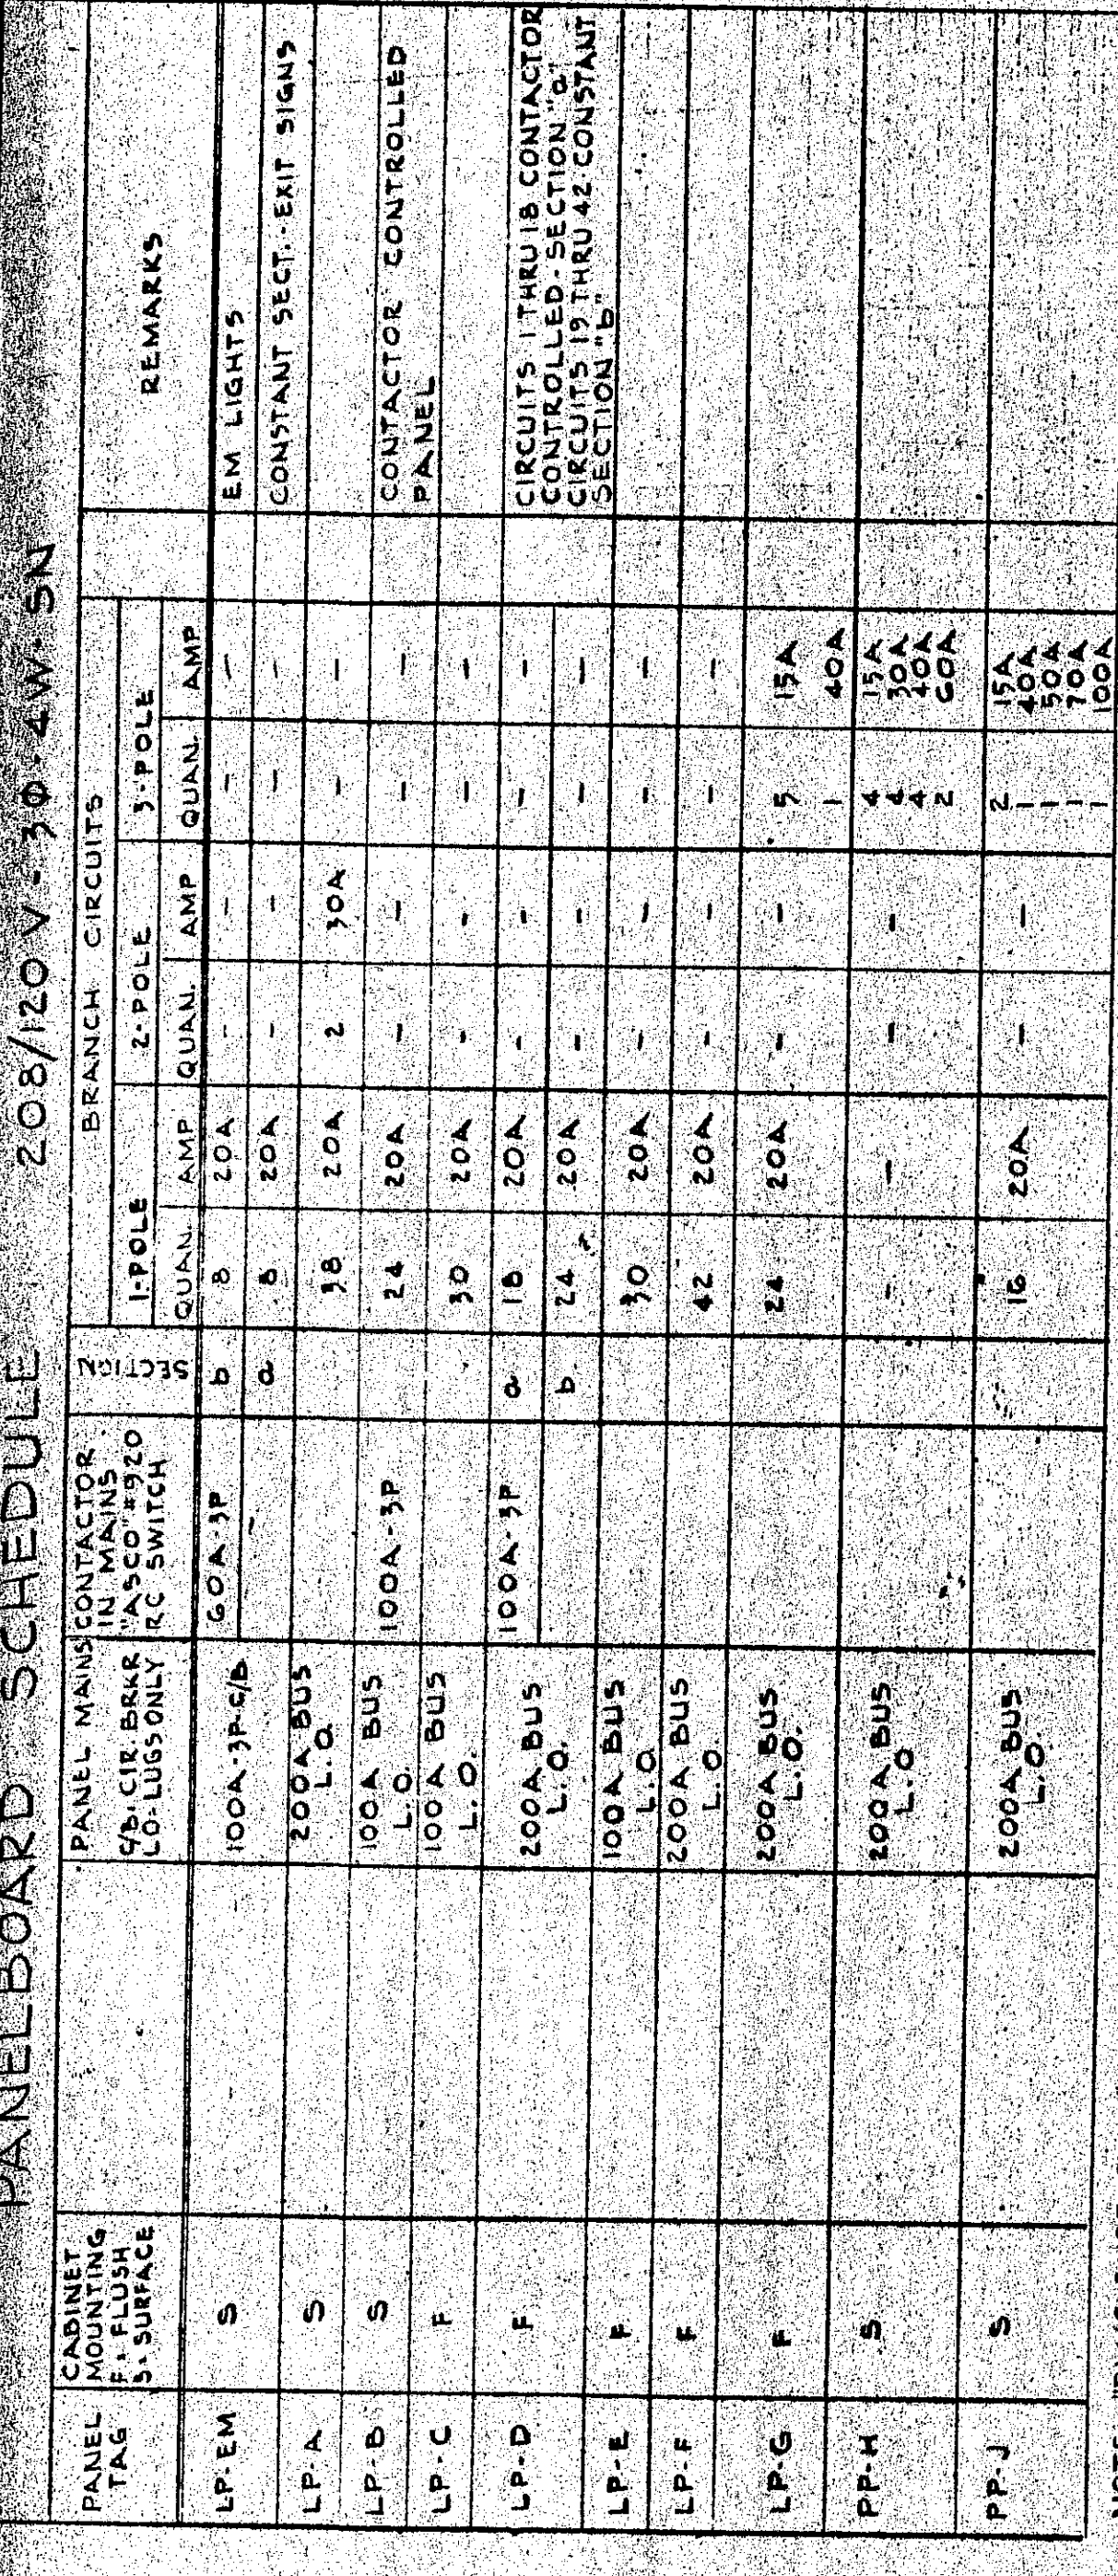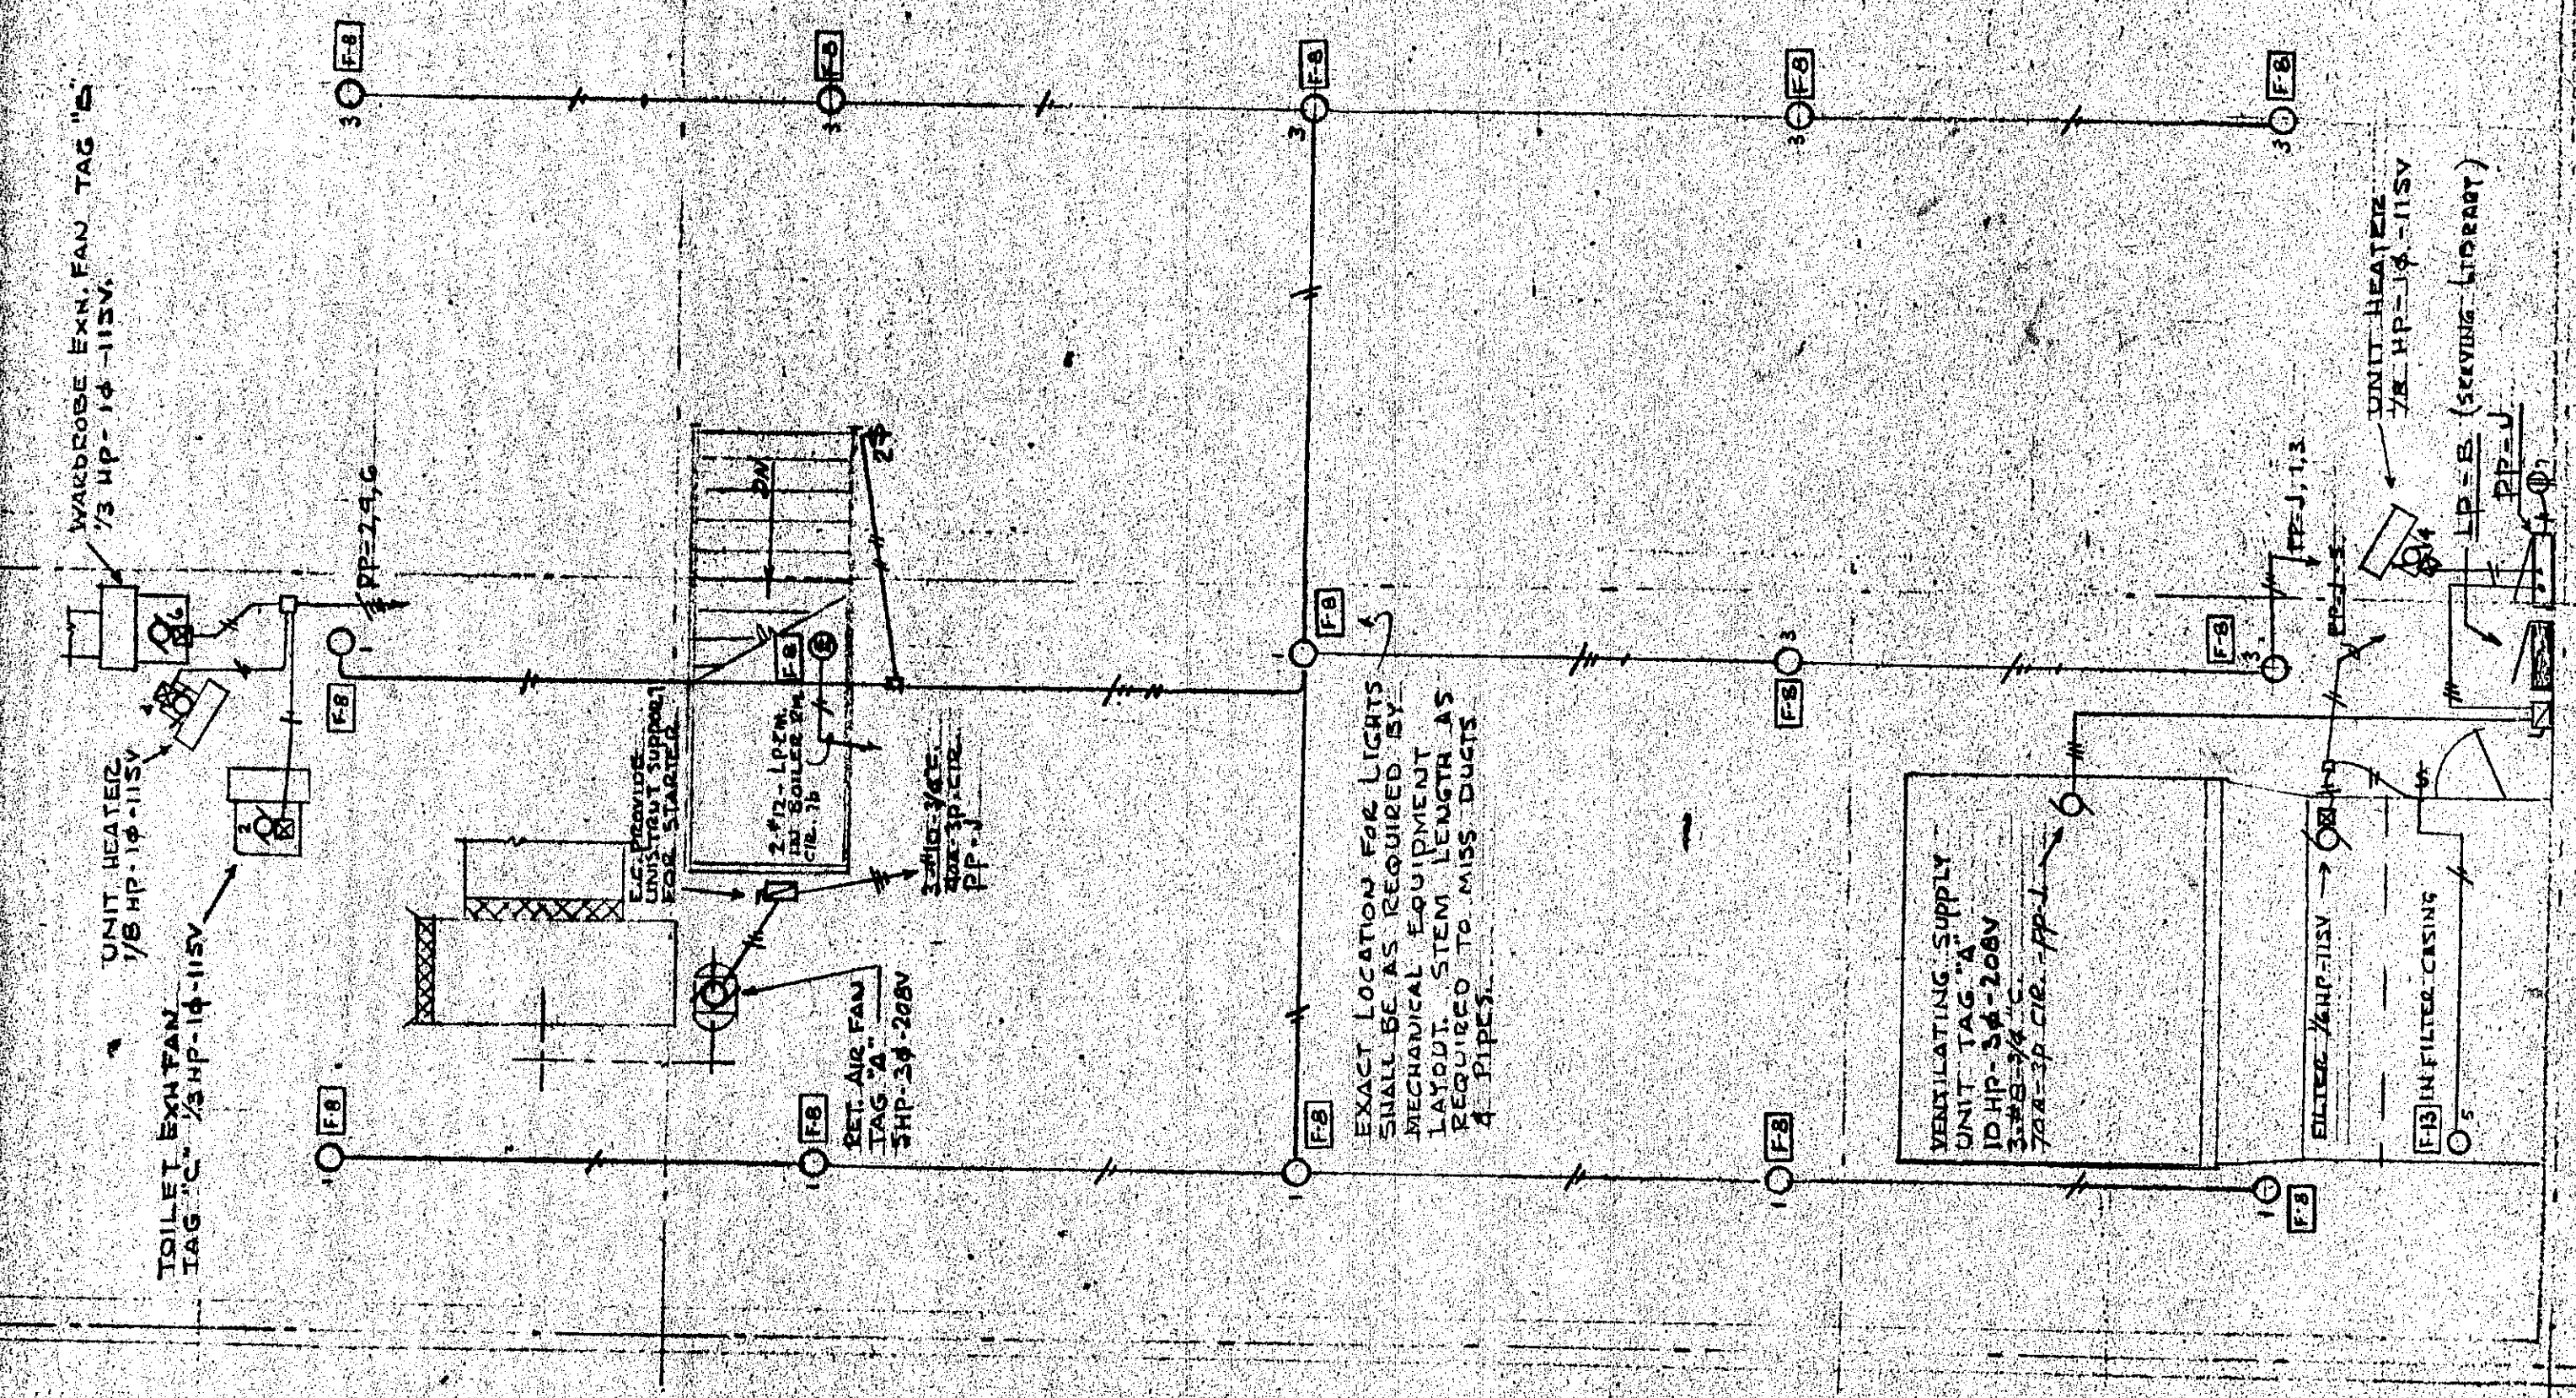

WESTCHESTER TOWNSHIP ELEMENTARY SCHOOL FOR THE WESTCHESTER TOWNSHIP SCHOOL CORPORATION

MECH. EQUIP. ROOM PLAN- SCHEDULES & DETAILS

ARCHITECTS ASSOCIATES ENGINEERS

MECHANICAL EQUIPMENT ROOM PLAN