PLAN NOTES

1. ALL STATION DEVICES ON THIS DRAWING SHALL BE ROUTED TO TERMINAL RACK NO. 2.
2. CONTRACTOR SHALL SURFACE MOUNT CONDUIT AS HIGH TO CEILING AS POSSIBLE. WHEN AVAILABLE RUN CONDUIT ABOVE ACCESSIBLE CEILINGS TO THE NEW CABLE TRAY.
3. THE FOLLOWING IS A DESCRIPTION OF WIRING DEVICE TO BE INSTALLED AT EACH STATION.
   a. DATA
   b. DATA
   c. TELEPHONE
   d. SERVER

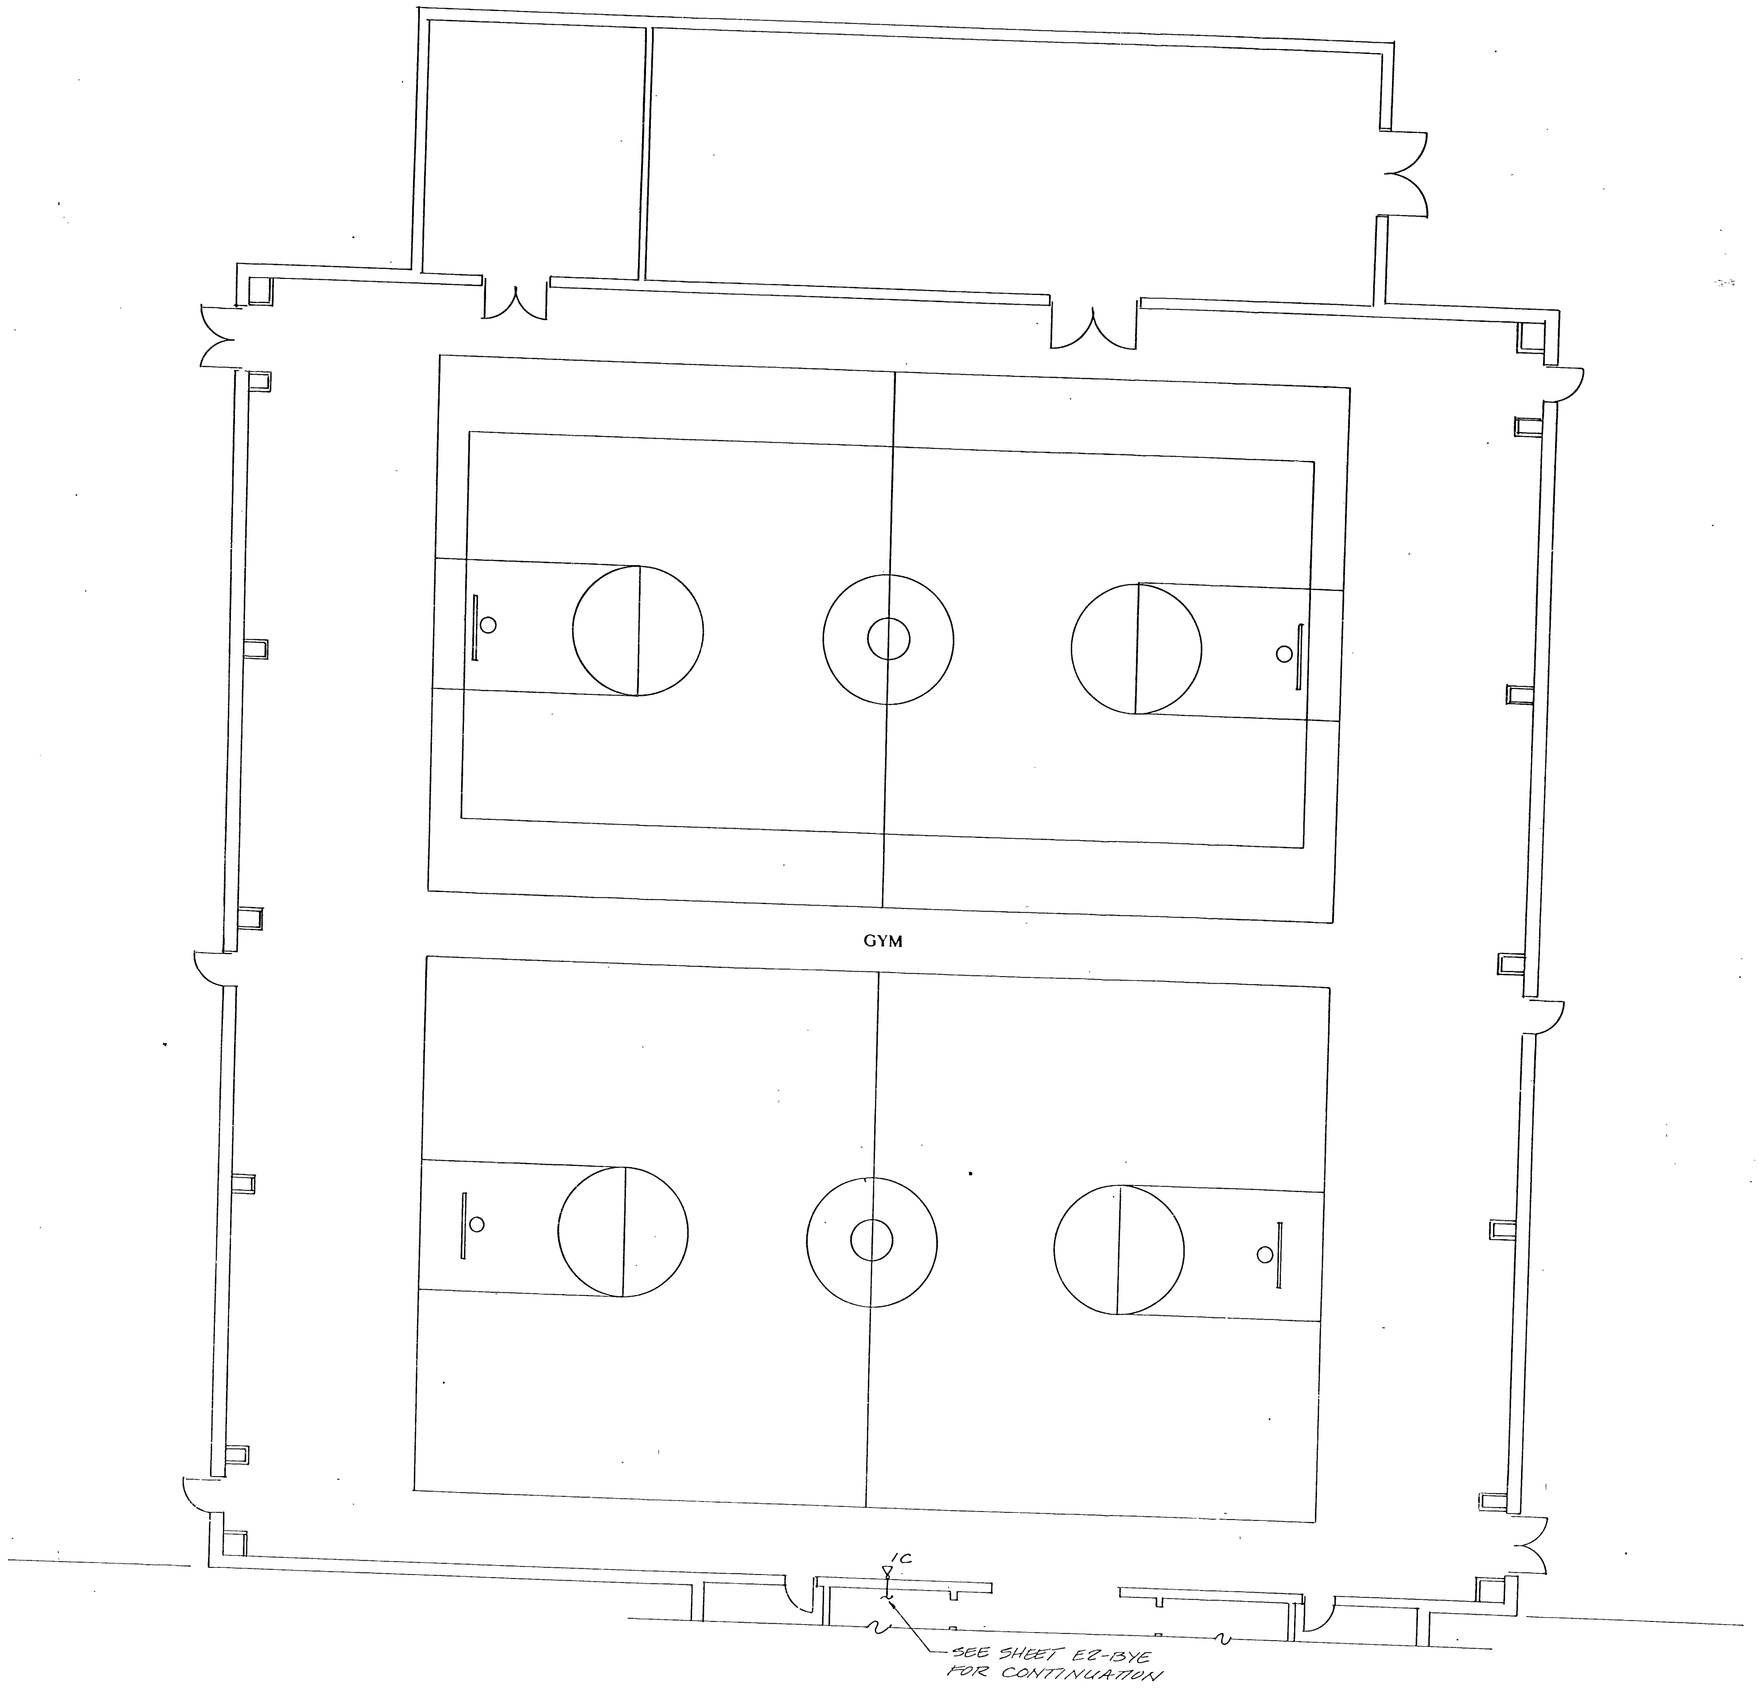

ELECTRICAL SYSTEM PLAN – UNIT E



KEY PLAN

NORTH

PRINCIPAL

PROJECT ENGINEER

CERTIFIED BY:

PRINCIPAL

CERTIFIED BY:

PROJECT ENGINEER

CERTIFIED BY:

PROJECT DESIGNER

REVISIONS

MARK	DATE	DESCRIPTION

MOORE ENGINEERS
A PROFESSIONAL CORPORATION
9245 N. Meridian Street, Suite 105
Indianapolis, Indiana 46260-1832
(317) 848-5045 FAX: (317) 848-2765

COPYRIGHT NOTICE:
THIS ENGINEERING DRAWING IS GIVEN IN CONFIDENCE AND SHALL BE USED ONLY PURSUANT TO THE AGREEMENT WITH MOORE ENGINEERS, PC NO OTHER USE OR DUPLICATION MAY BE MADE WITHOUT PRIOR WRITTEN CONSENT OF MOORE ENGINEERS, PC ALL OTHER COPYRIGHT AND COMMON LAW RIGHTS ARE HEREBY SPECIFICALLY RESERVED

COMMUNICATIONS INFRASTRUCTURE FOR DUNELAND SCHOOL CORPORATION

DUNELAND SCHOOL CORPORATION
CHESTERTON, INDIANA

TITLE:

BAILLY ELEMENTARY SCHOOL

DATE:	12 / 5 / 94	SHEET NO:
SCALE:	1/8" = 1'- 0"	E4-BYE
COMM. NO:	94054	
DRAWN BY:	R.D.C.	

06-13-96