	DOOR AND FRAME SCHEDULE																
INT/ EXT			DOOR					FRAME					DETAILS				
	ROOM OPN'G	SIZE		TYPE	₩ ٨ + 11	HDWR	PROT.	SIZE		TYPE	MAT'L	PROT. RATING	LIEAD	JAMB	JAMB	SILL	REFERENCED NOTES
		WIDTH	HEIGHT		MAT'L	SET	RATING HOURS	WIDTH	HEIGHT	TIPE	I I I I I I	HOURS	HEAD	JAIID	JAITID	SILL	
FIRST	FL <i>OO</i> R																
INT	1015E 1015E	3'-Ø"	7'-Ø"	А	WD	3	-	3'-4"	7'-2"	В	HM	-	1/42.10	6/A2.1Ø	4/42.10	-	
INT	1015H 1015H	3'-Ø"	7'-Ø"	С	WD	2	-	3'-4"	7'-2"	В	ΗМ	-	2/42.10	5/A2.IØ	5/42.10	-	
INT	1015J 1015J	3'-Ø"	7'-Ø"	Д	WD	4	-	3'-4"	7'-2"	В	нм	-	1/42.10	4/A2.1Ø	7/42.10	-	
INT	1016 1016	3'-Ø"	7'-Ø"	А	WD	4	-	5'-Ø"	7'-4"	А	нМ	-	3/42.10	8/A2.IØ	9/42.10	3/49.10	
SECON	ND FLOOR	_		•	•	•				1							
INT	2000 2000	3'-Ø"	7'-Ø"	А	WD	4	-	5'-Ø"	7'-2"	Д	нм	-	1/42.10	4/A2.1Ø	4/42.10	-	
INT	2001 2001	3'-Ø"	7'-Ø"	А	WD	4	-	3'-4"	7'-2"	В	нм	-	1/A2.1Ø	4/A2.IØ	11/42.10	-	
INT	2001 2001E	3'-Ø"	7'-Ø"	А	WD	4	-	5'-Ø"	7'-2"	А	нм	-	1/A2.1Ø	4/A2.1Ø	4/42.10	-	
INT	2005 2005	3'-Ø"	7'-Ø"	А	WD	1	-	12'-Ø"	7'-2"	С	нм	-	1/A2.1Ø	1Ø/A2.1Ø	11/42.10	-	
INT	2006 2006	3'-Ø"	7'-Ø"	А	WD	4	-	3'-4"	7'-2"	А	нм	-	1/A2.1Ø	4/A2.1Ø	4/42.10	-	
INT	2007 2007	3'-Ø"	7'-Ø"	В	WD	4	-	3'-4"	7'-2"	В	нм	-	1/42.10	4/A2.1Ø	4/A2.10	-	

DOOR AND FRAME ABBREVIATIONS

ALUMINUM $\mathsf{E} \mathsf{X}$ EXISTING

FRP FIBERGLASS REINFORCED POLYESTER


HMHOLLOW METAL ME MATCH EXISTING SIM SIMILAR TYP TYPICAL VIF VERIFY IN FIELD

WOOD

WD


DOOR AND FRAME GENERAL NOTES


- CONTRACTOR TO VERIFY DIMENSIONS, QUANTITIES AND CONDITIONS OF ALL ROUGH OPENINGS IN FIELD.
- REFER TO WALL TYPES FOR WALL CONSTRUCTION AT DOOR LOCATIONS.
- REFER TO SPECIFICATIONS FOR DESCRIPTIONS OF HARDWARE SETS.
- ALL EXPOSED ANCHORS ON HOLLOW METAL FRAMES ARE TO BE COUNTERSUNK INTO FRAMES, COVERED IN BONDO, SANDED SMOOTH, AND PAINTED TO MATCH FRAME.
- REFER TO STRUCTURAL DRAWINGS FOR LINTEL INFORMATION.
- VERIFY DIMENSIONS OF ALL DOORS AND FRAMES TO BE INSTALLED IN EXISTING WALL OPENINGS PRIOR TO SUBMITTING SHOP DRAWINGS.
- HEIGHT OF DOOR OPERATING HARDWARE SHALL BE NO LESS THAN 34" AND NO MORE THAN 48" ABOVE FINISHED FLOOR. COORDINATE EXACT HEIGHT WITH OWNER
- DOOR HARDWARE SHALL NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF
- INTERIOR HINGED DOORS: 5 LB
- ALL EGRESS DOORS ARE TO UTILIZE KEYLESS LOCKETS ON THE EGRESS SIDE. NO FLUSH BOLTS, DEAD OR DRAW BOLTS, ETC. WILL BE ALLOWED.
- FRAMES (NEW AND EXISTING).
- 13. ALL EXISTING FIRE RATED OPENINGS ARE TO BE MAINTAINED.
- 14. ALL ROOM SIGNAGE BY OWNER.

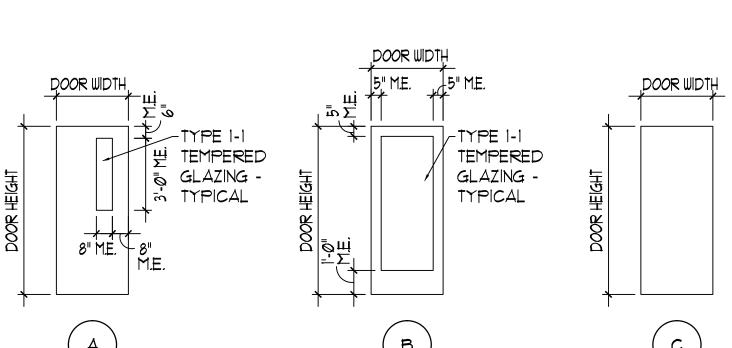




NOT TO SCALE

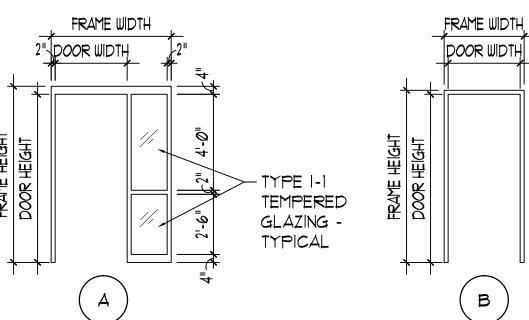

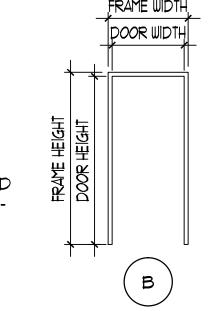

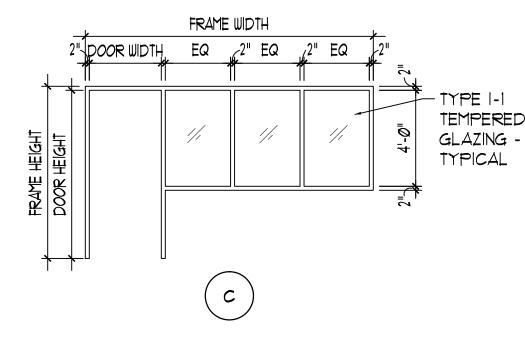

FRAME TYPES NOT TO SCALE

EXISTING DECK PROVIDE LONG LEGGED RUNNER CHANNEL TO ALLOW FOR DEFLECTION OF STRUCTURE ABOVE 3 5/8" METAL STUD FRAMING -AT 16" O.C. (12" O.C. BELOW WINDOW AND SIDE LITES) WITH CONTINUOUS RUNNER CHANNELS TOP AND BOTTOM 5/8" GYPSUM BOARD -BOTH SIDES SOUND ATTENUATION BATT -INSULATION PROVIDE WOOD BLOCKING -AT ALL COUNTERTOP SUPPORT LOCATIONS


UL# - U419


1" THICK HARDWOOD CAP - -FINISH TO MATCH WOOD HANDRAIL AT EXISTING STAIR 3 5/8" METAL STUD FRAMING — AT 16" O.C. (12" O.C. BELOW WINDOW AND SIDE LITES) WITH CONTINUOUS RUNNER CHANNELS TOP AND BOTTOM 5/8" GYPSUM BOARD - -BOTH SIDES SOUND ATTENUATION BATT -INSULATION PROVIDE WOOD BLOCKING -AT LIFT GATE SUPPORT LOCATIONS


WALL TYPES NOT TO SCALE

WALL TYPE GENERAL NOTES

- ALL WALL TYPES ARE TO EXTEND UP THROUGH, AND AROUND, ALL STRUCTURES, AND INTERFERENCES TO MAINTAIN CONTINUITY UP TO DECK - UNLESS NOTED OTHERWISE.
- PROVIDE FIRESAFING AT PERIMETER AND AT ALL PENETRATIONS OF ALL FIRE RATED WALL CONSTRUCTION.
- 3. ALL WALL TYPES TO EXTEND ABOVE AND BELOW ALL OPENINGS AND PENETRATIONS.







CORPORATION

CHOOL

S

DUNELAND

SCHOOL TERTON,

DDLE CHES

CHESTE MORGAN

20

GROUT JAMBS SOLID AT ALL FRAMES INSTALLED IN MASONRY OPENINGS. OAS, LLC O'HIGGINS AND ARNOLD SUS'

AND ARCHITECT. THE WRIST TO OPERATE. 10. DOOR OPERATING FORCE SHALL NOT EXCEED: EXTERIOR HINGED DOORS: 8.5 LB

12. AT ALL OPENINGS SCHEDULED TO RECEIVE WORK - BONDO AND PAINT ALL